



CHB

NOTE USE C.M 1:7 IN THE FOUNDATION AND PLINTH IN ALL THE WALLS AND PILLARS

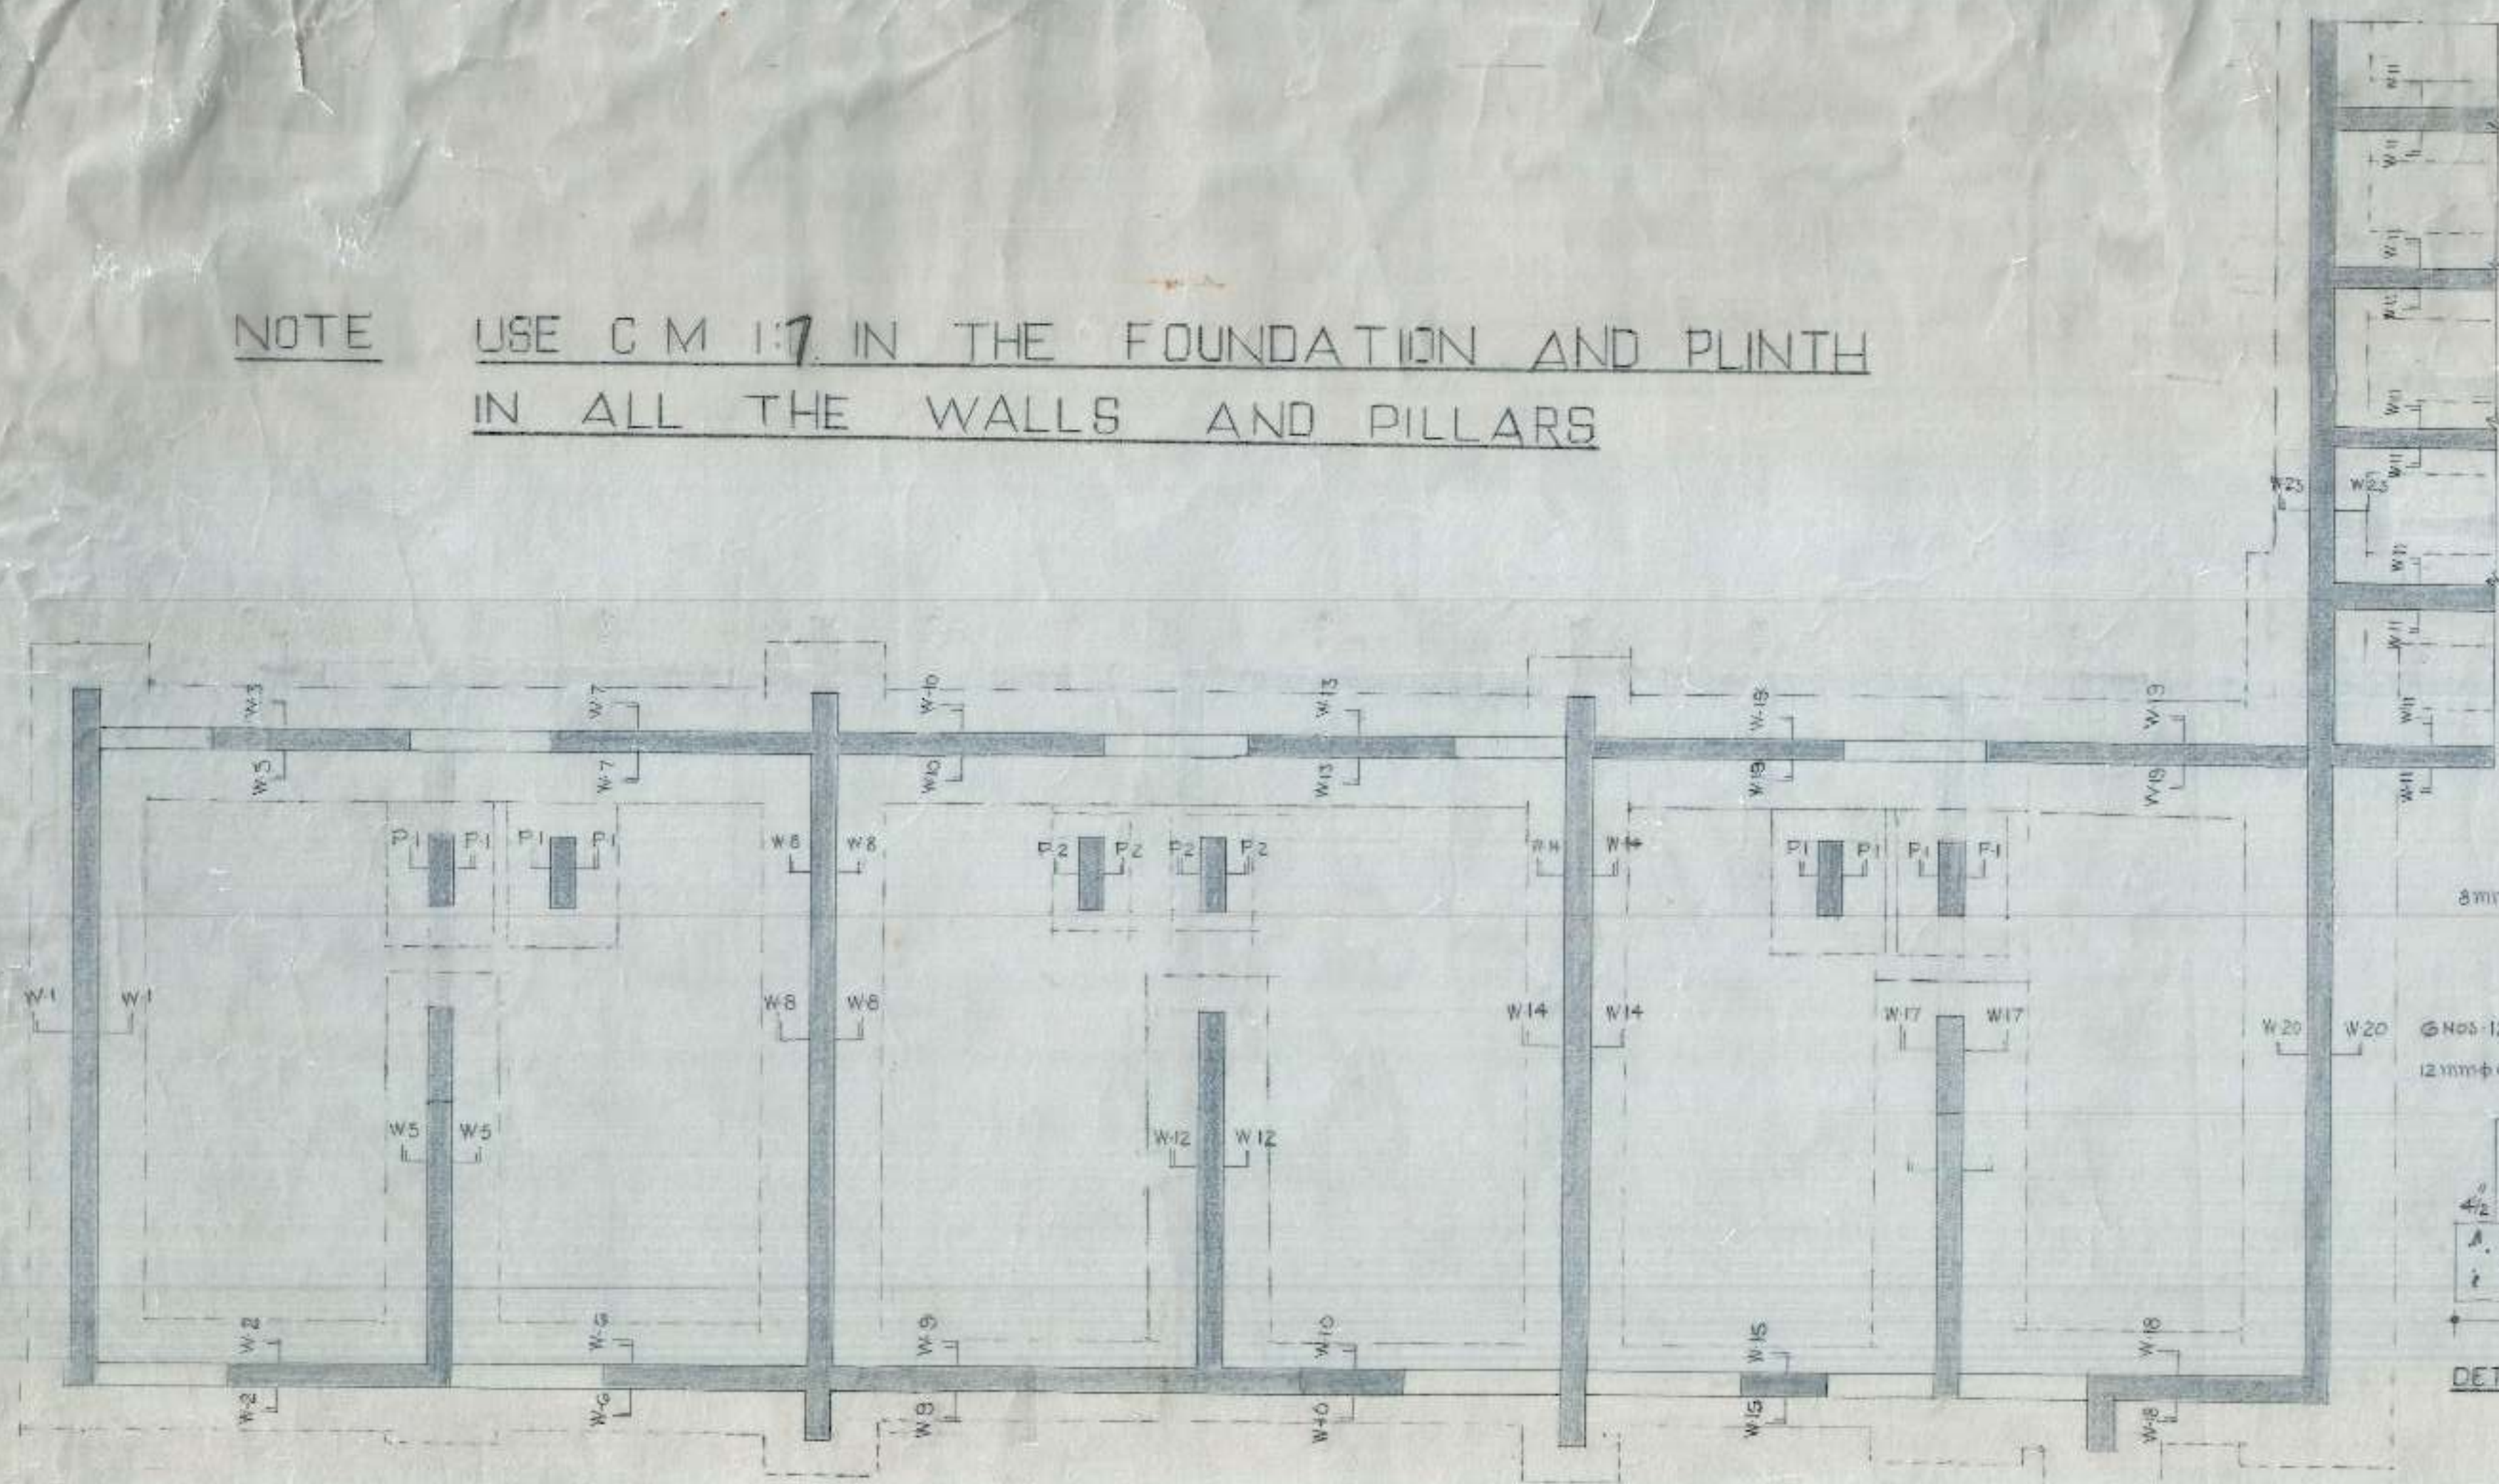

SCHEDULE OF BARS IN COL C-5
1.2, 4.5 16 mm ϕ
3.6 12 mm ϕ

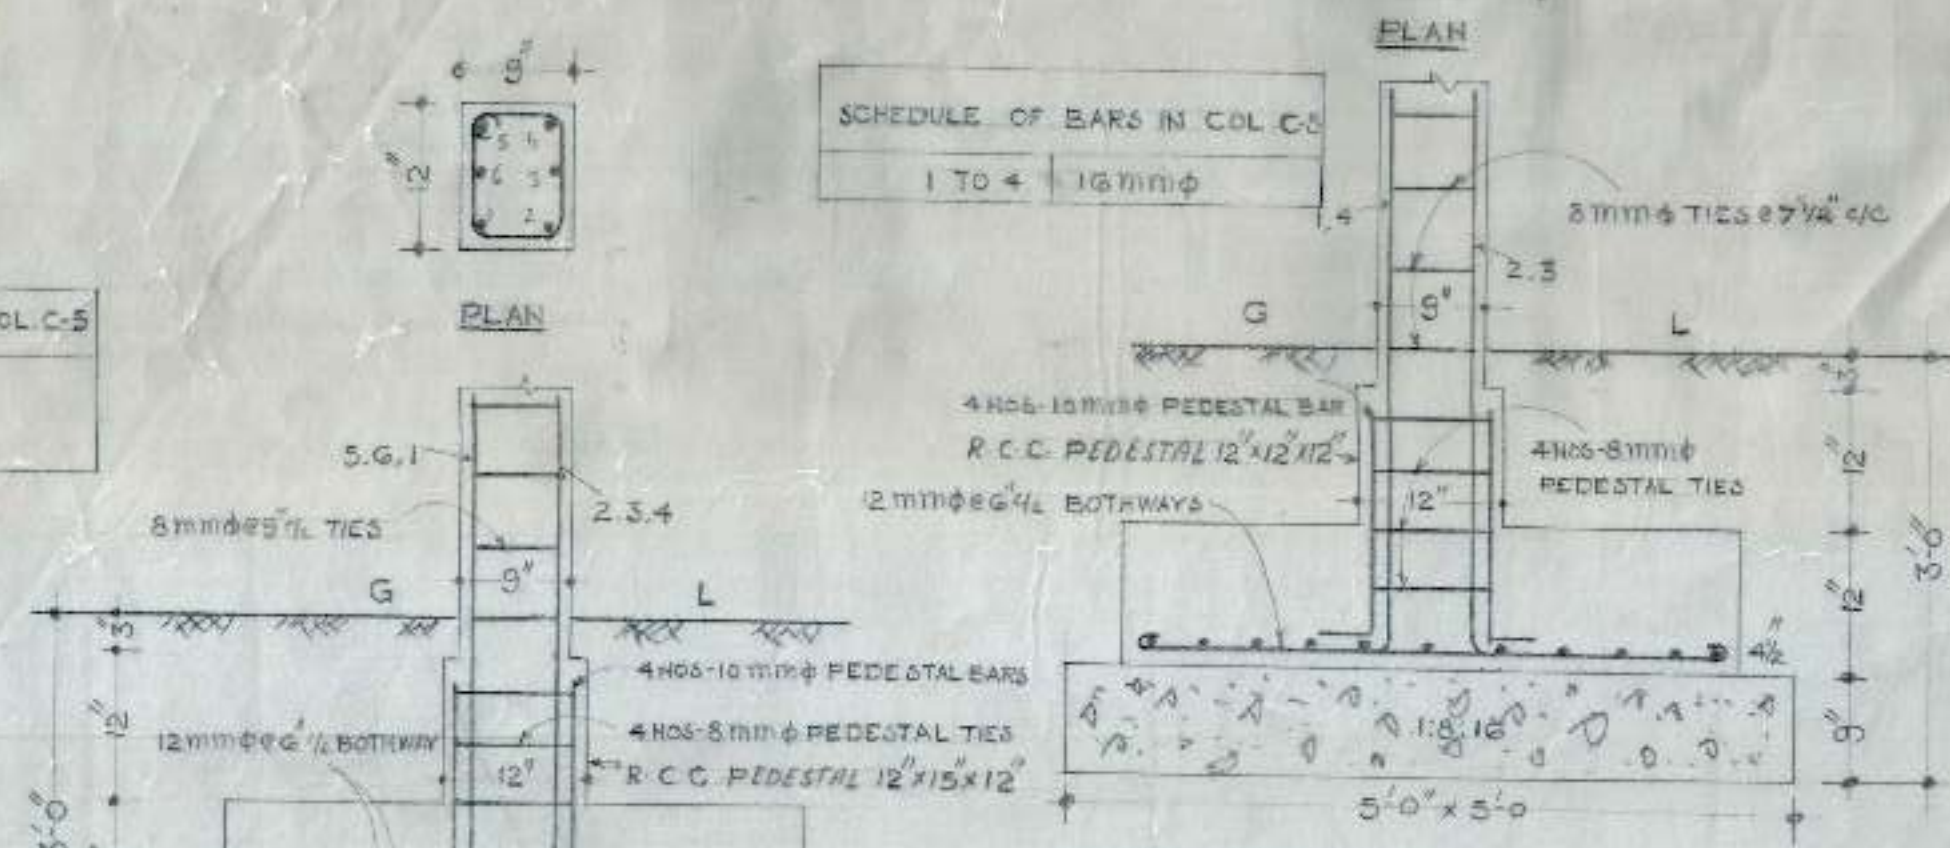


DETAIL OF COL C-5

CEMENT MORTAR TO BE USED IN S-STRUCTURE			
WALL	UPTO 1ST FL. L	UPTO 2ND FL. L	UPTO 3RD FL. L
W1	1:6	1:7	1:7
W2	1:6	1:7	1:7
W3	1:6	1:7	1:7
W4	1:6	1:7	1:7
W5	1:6	1:7	1:7
W6	1:6	1:7	1:7
W7	1:6	1:7	1:7
W8	1:6	1:7	1:7
W9	1:6	1:7	1:7
W10	1:6	1:7	1:7
W11	1:6	1:7	1:7
W12	1:6	1:7	1:7
W13	1:6	1:7	1:7
W14	1:6	1:7	1:7
W15	1:6	1:7	1:7
W16	1:6	1:7	1:7
W17	1:6	1:7	1:7
W18	1:6	1:7	1:7
W19	1:6	1:7	1:7
W20	1:6	1:7	1:7
W21	1:6	1:7	1:7
W22	1:6	1:7	1:7
W23	1:6	1:7	1:7


- NOTES
- FOR CENTRE LINE DIMENSIONS REFER ARCH DRG. NO. 18, JOB NO. 79.
 - SUITABLE D.P.C. MAY BE PROVIDED AT SITE.
 - STRUCTURAL SIZES AS SHOWN IN THIS DRG. SHOULD BE ADOPTED INSIDE OF ANY CONTRARY SIZES SHOWN IN THE ARCH. DRG.
 - THE SAFE BEARING CAPACITY OF SOIL HAS BEEN ASSUMED AS 1.0 T/1' WHICH SHOULD BE ENSURED AT SITE.
 - THE CURE STRENGTH OF CONC. POURED AT SITE (FIELD STRENGTH) AFTER 28 DAYS SHALL NOT BE LESS THAN 2500 LB/SQ. INCH (MIN) AND MIN. NOT LEAVER THAN 1:2:4.
 - JAMBS OF 9" x 15" & 9" x 27" TO BE BUILT IN C.M. 1:4.
 - DIMENSIONS ARE TO BE READ NOT TO BE SCALED OFF.
 - DISCREPANCIES BETWEEN DETAILS SHOWN IN THIS DRG. AND ARCH DRGS. IF ANY SHOULD BE GOT CLARIFIED FROM THIS OFFICE BEFORE ADOPTING THIS DESIGN.

DETAIL OF COL C-1


SCHEDULE OF BARS IN COL C-2
1. TO 4 16 mm ϕ
5.6 12 mm ϕ

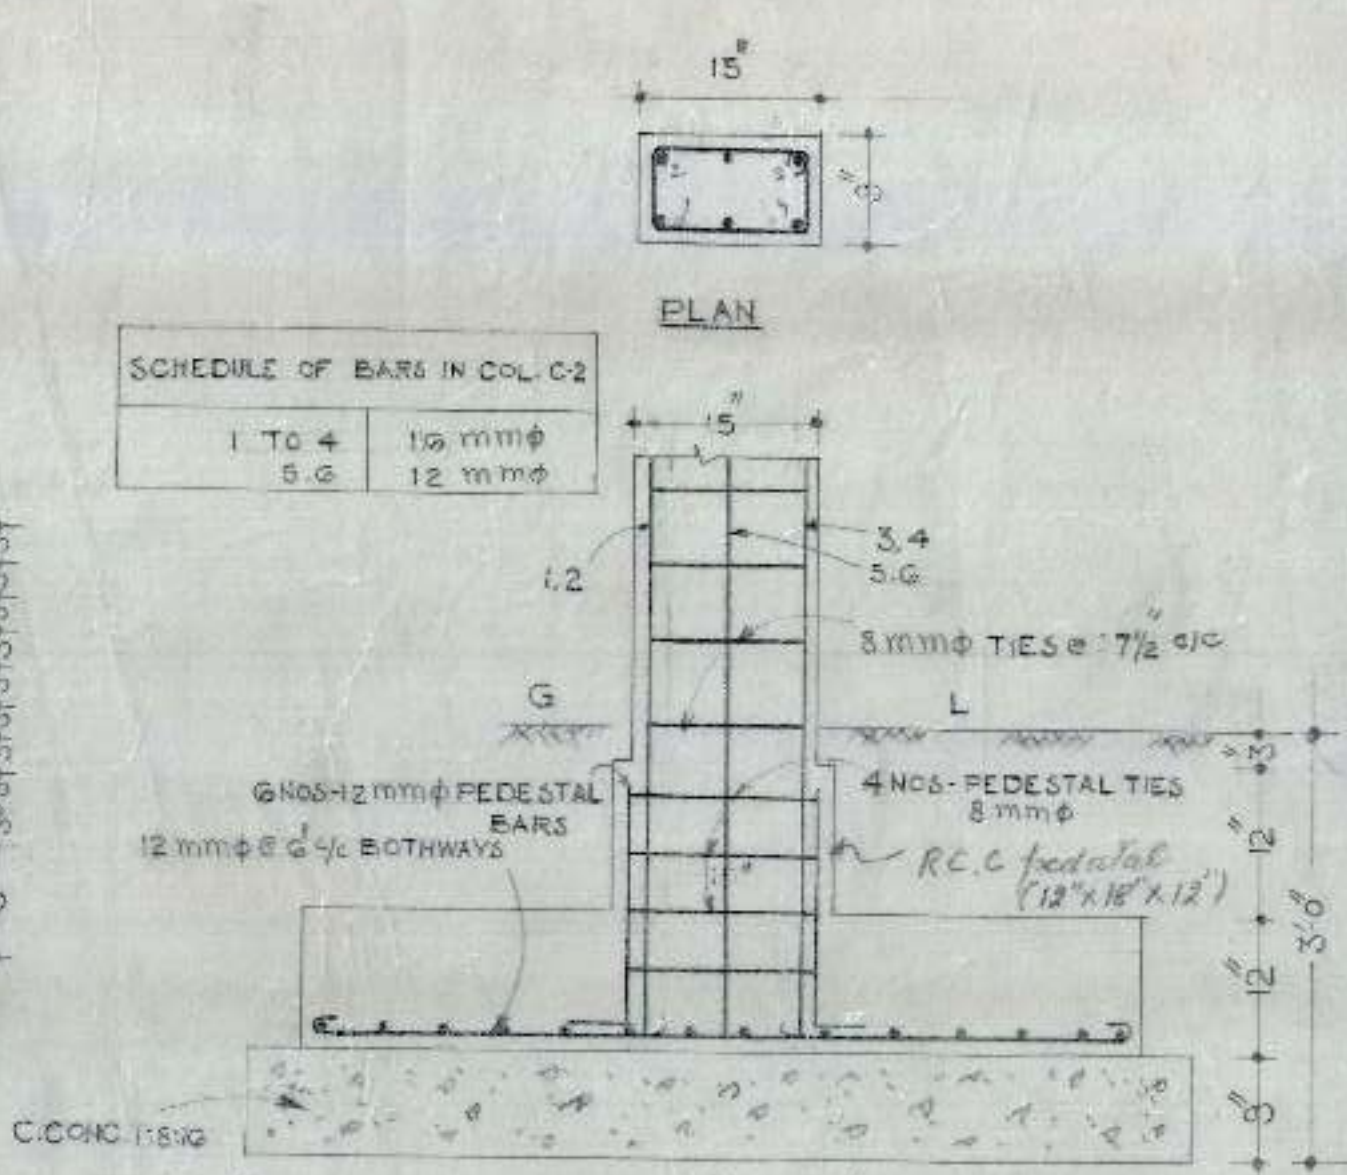


DETAIL OF COL C-2

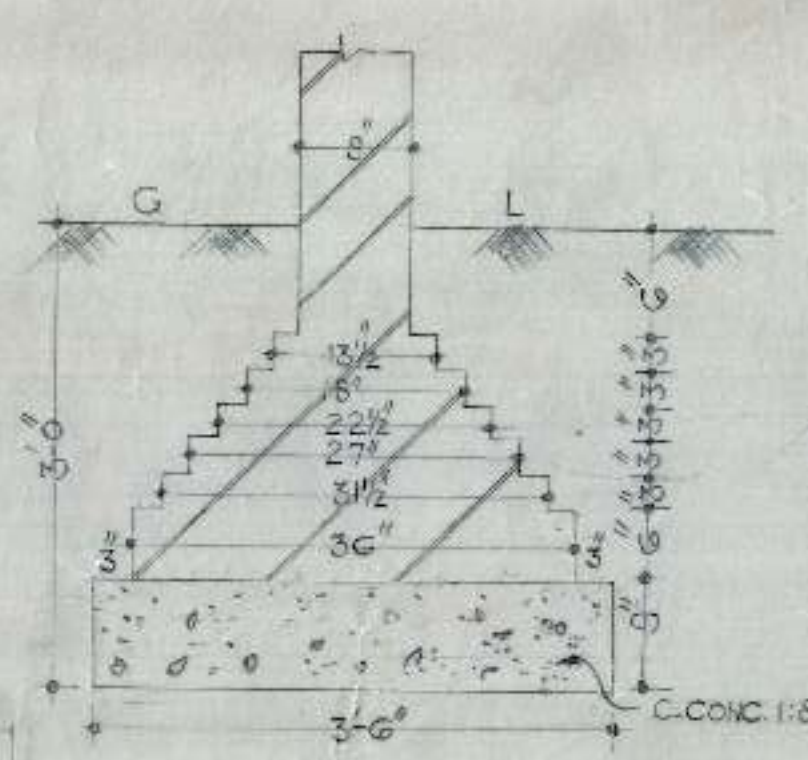


DETAIL OF W-1, W-6, W-7, W-18, W-21, W-22

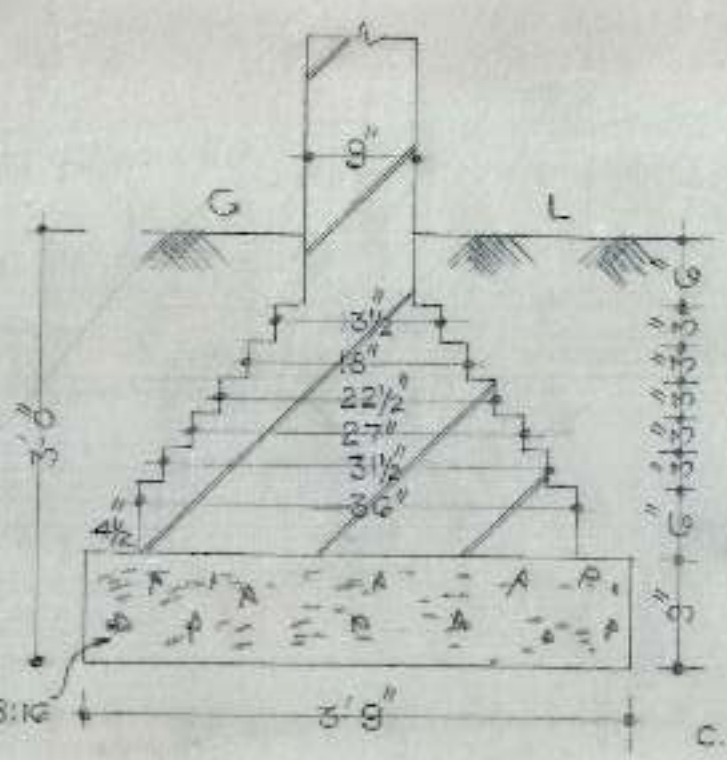



DETAIL OF W-5, W-8, W-9, W-10, W-11, W-12, W-13, W-14, W-15, W-16, W-17, W-19, W-20, W-23

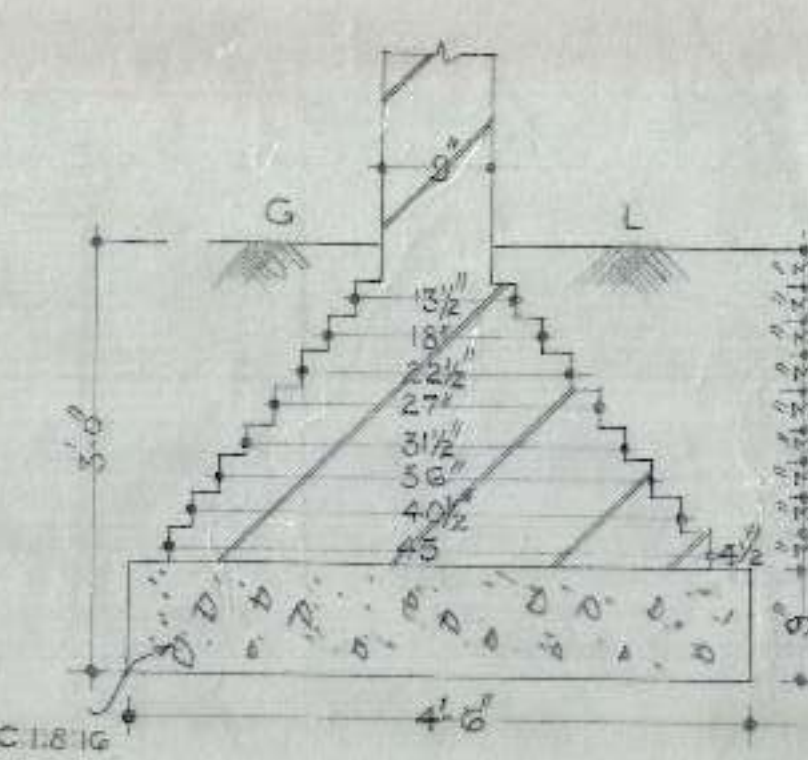


DETAIL OF W-17, W-20

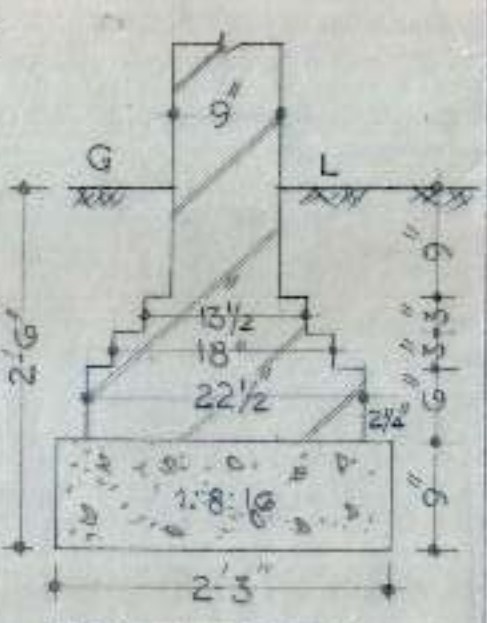


DETAIL OF P-2

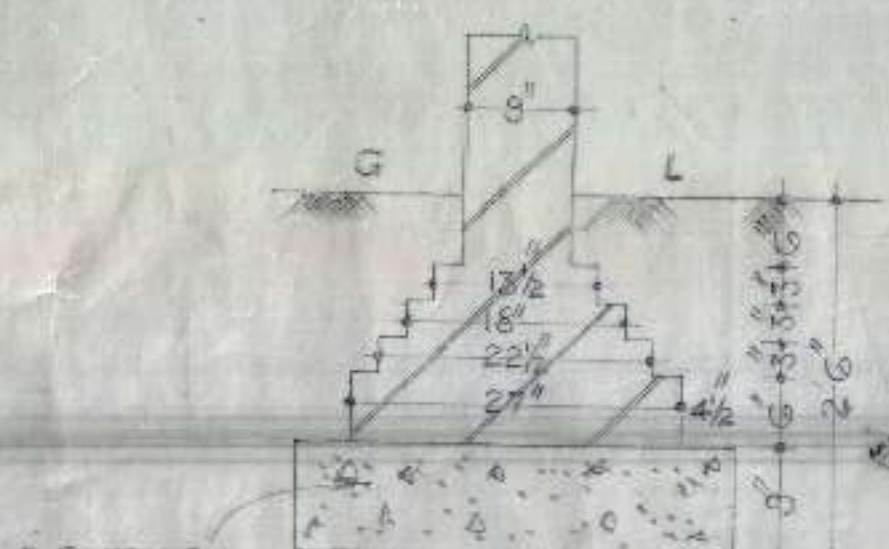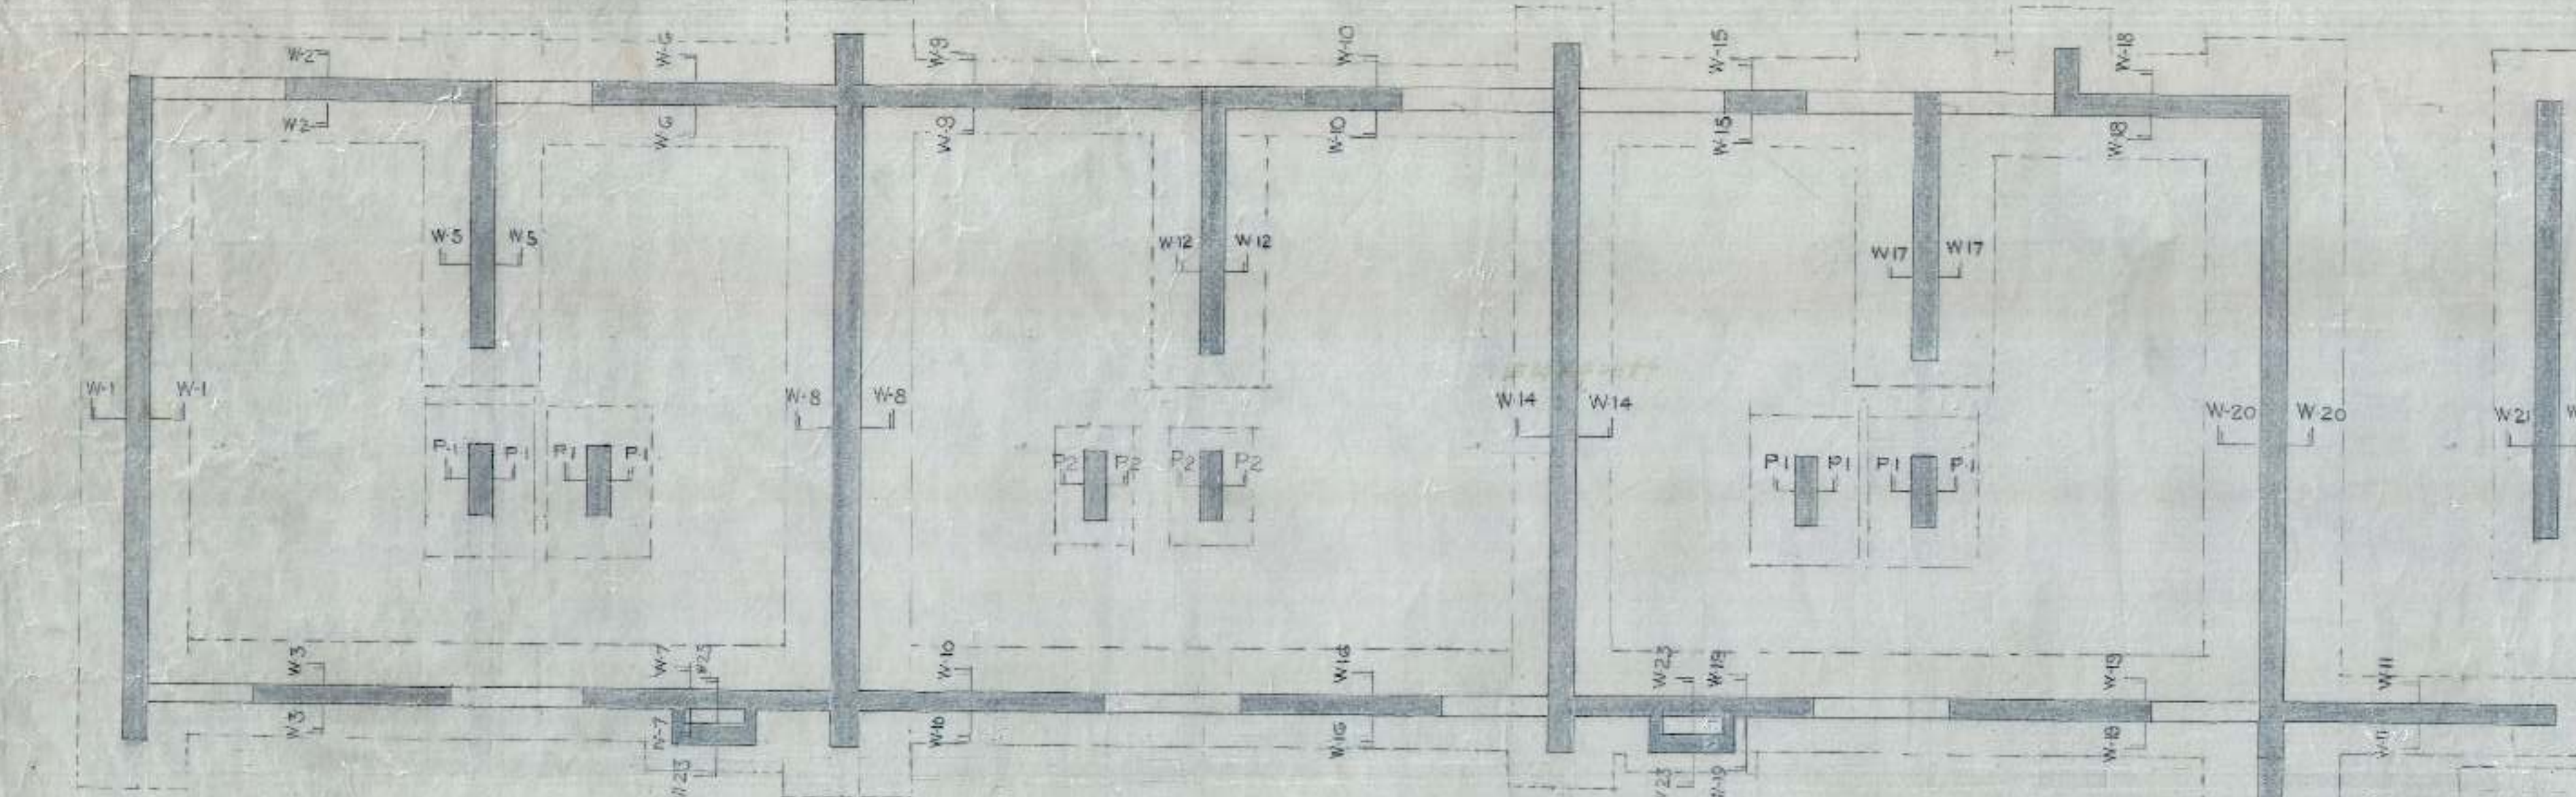


DETAIL OF W-14, W-19

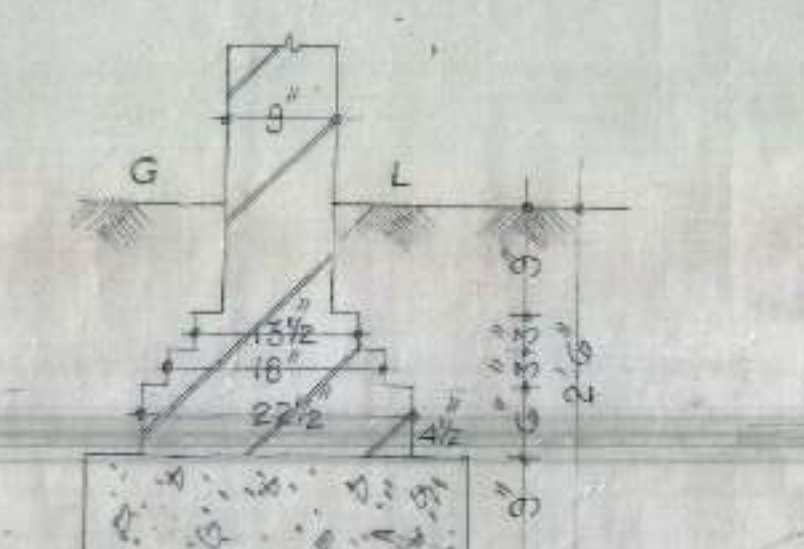


DETAIL OF W-3, W-15

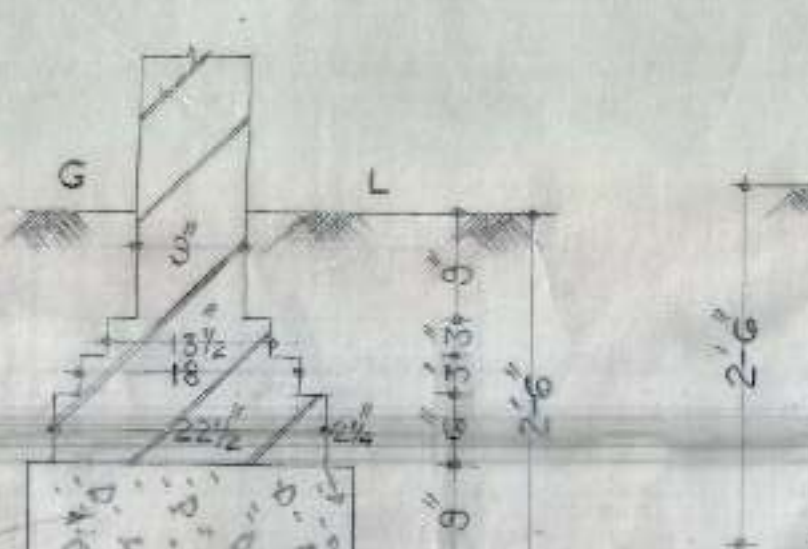


DETAIL OF W-9, W-10, W-11, W-12, W-13, W-16, W-23

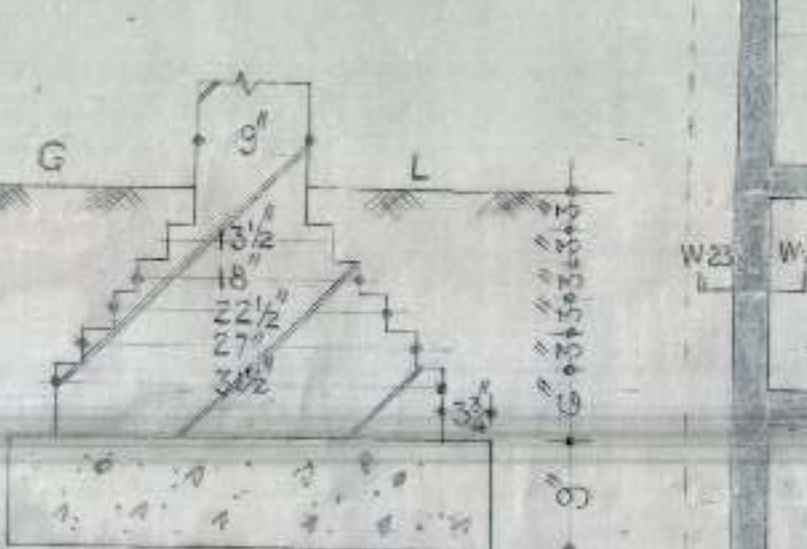

DETAIL OF P-1

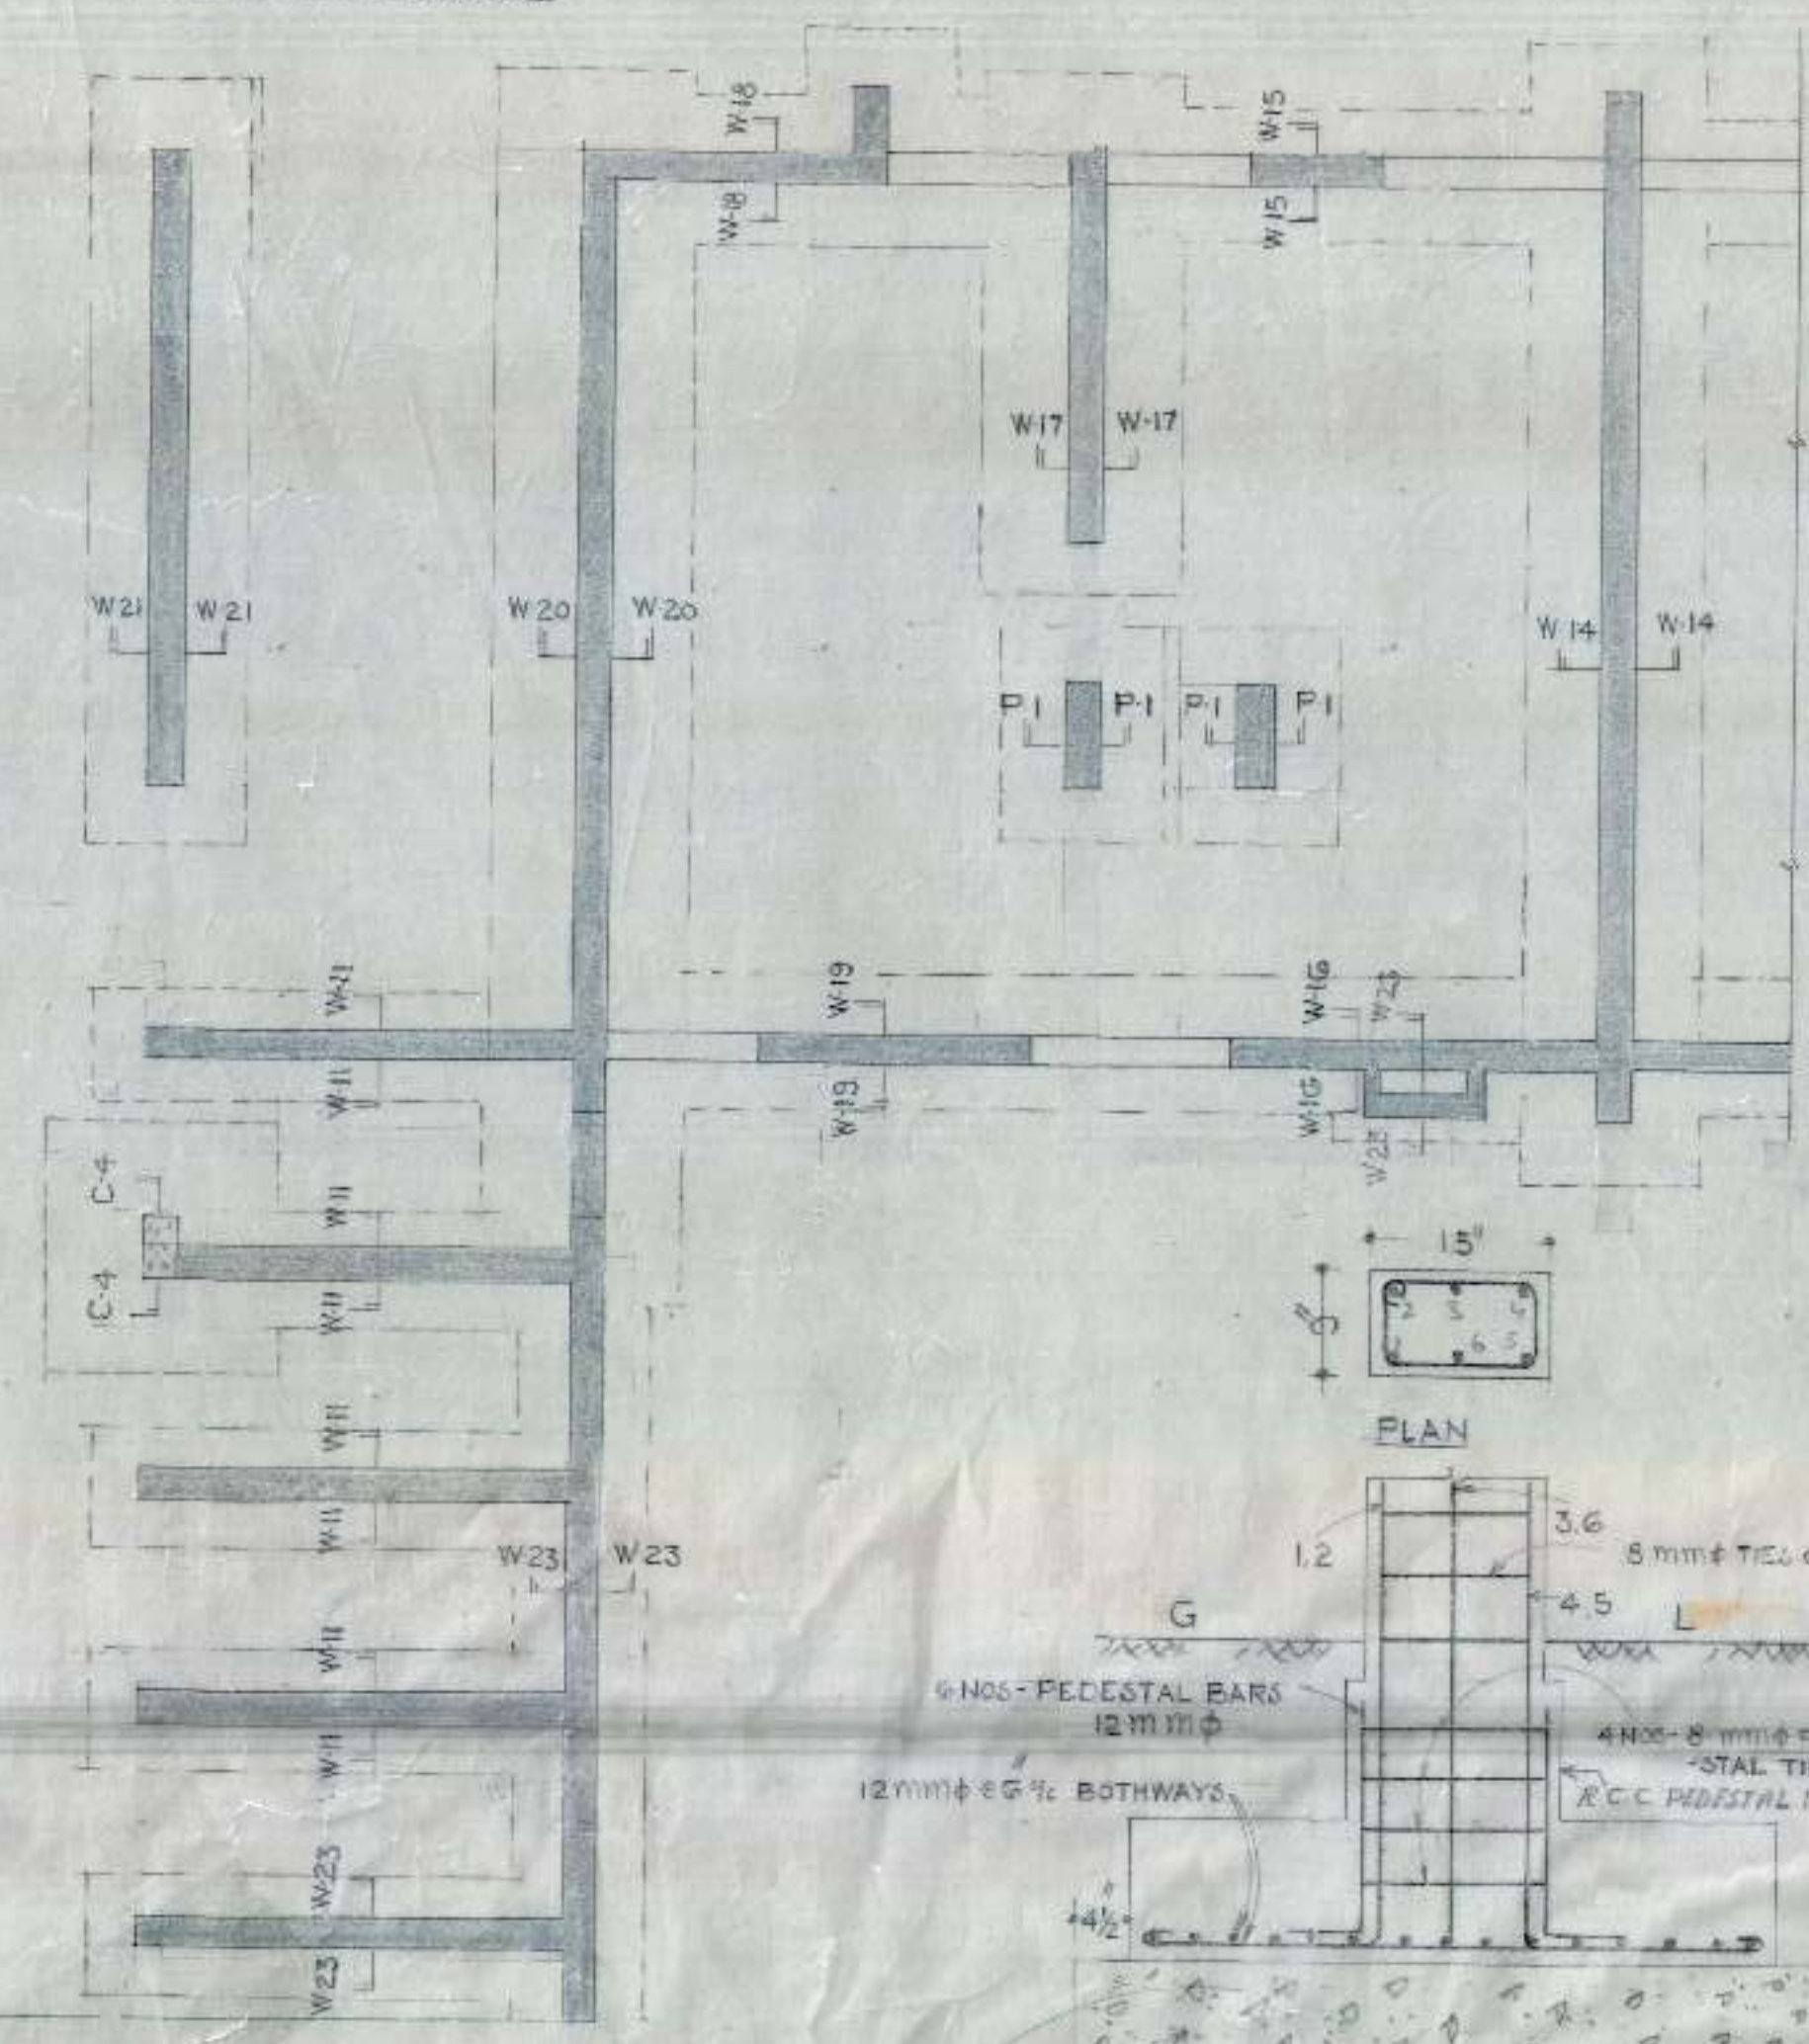


BARS IN COL C-4
1.2, 4.5 16 mm ϕ
3.6 16 mm ϕ

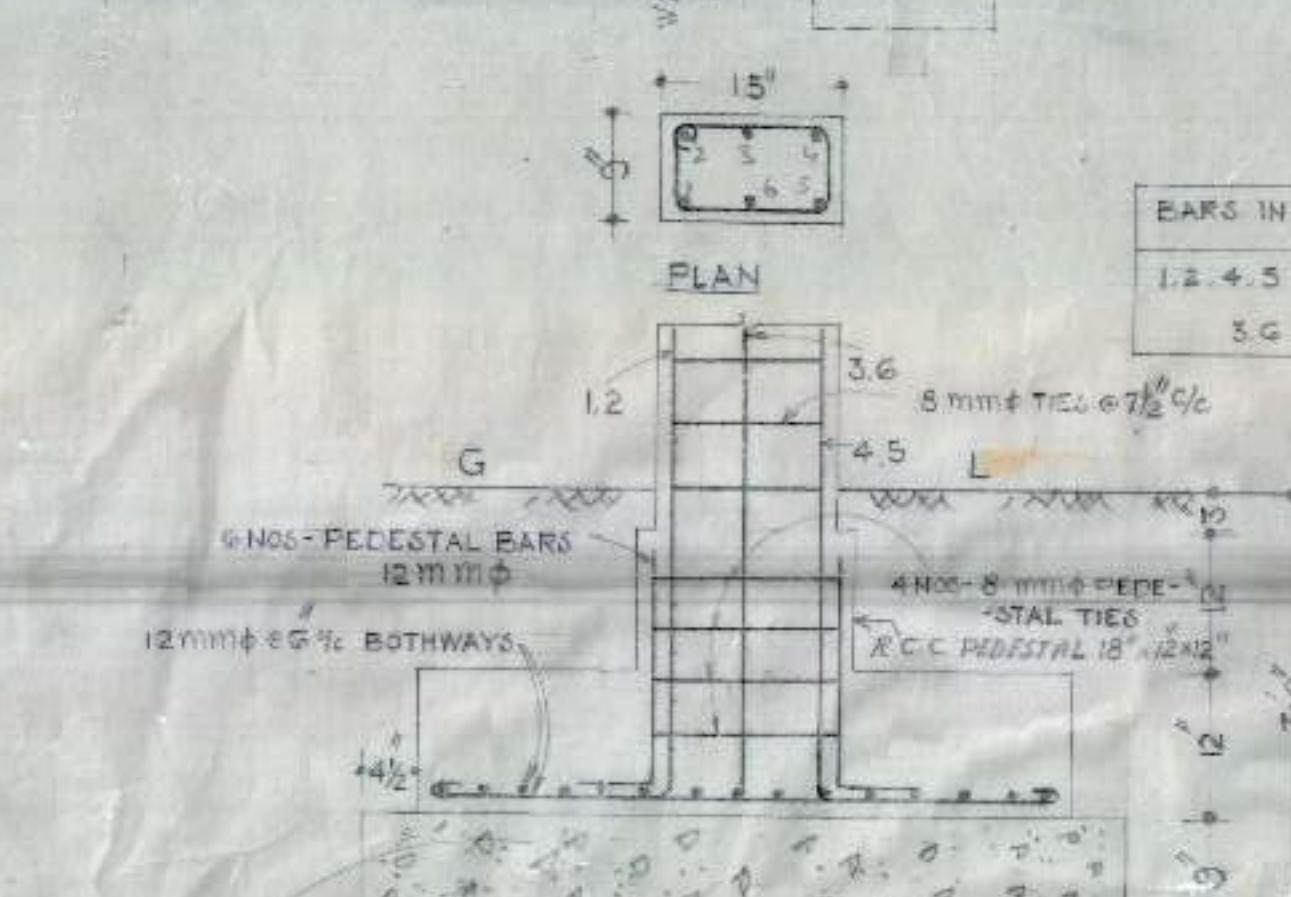


DETAIL OF COL C-4

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH		
DRG. NO.	M:1 G TWO ROOM SECTOR 45-D	DRG. NO. 1
SCALE 3/4" = 1'-0"	DETAIL OF FOUNDATIONS	JOB NO. 40
A.E.D.	E.E.H.	S.E.H.B.

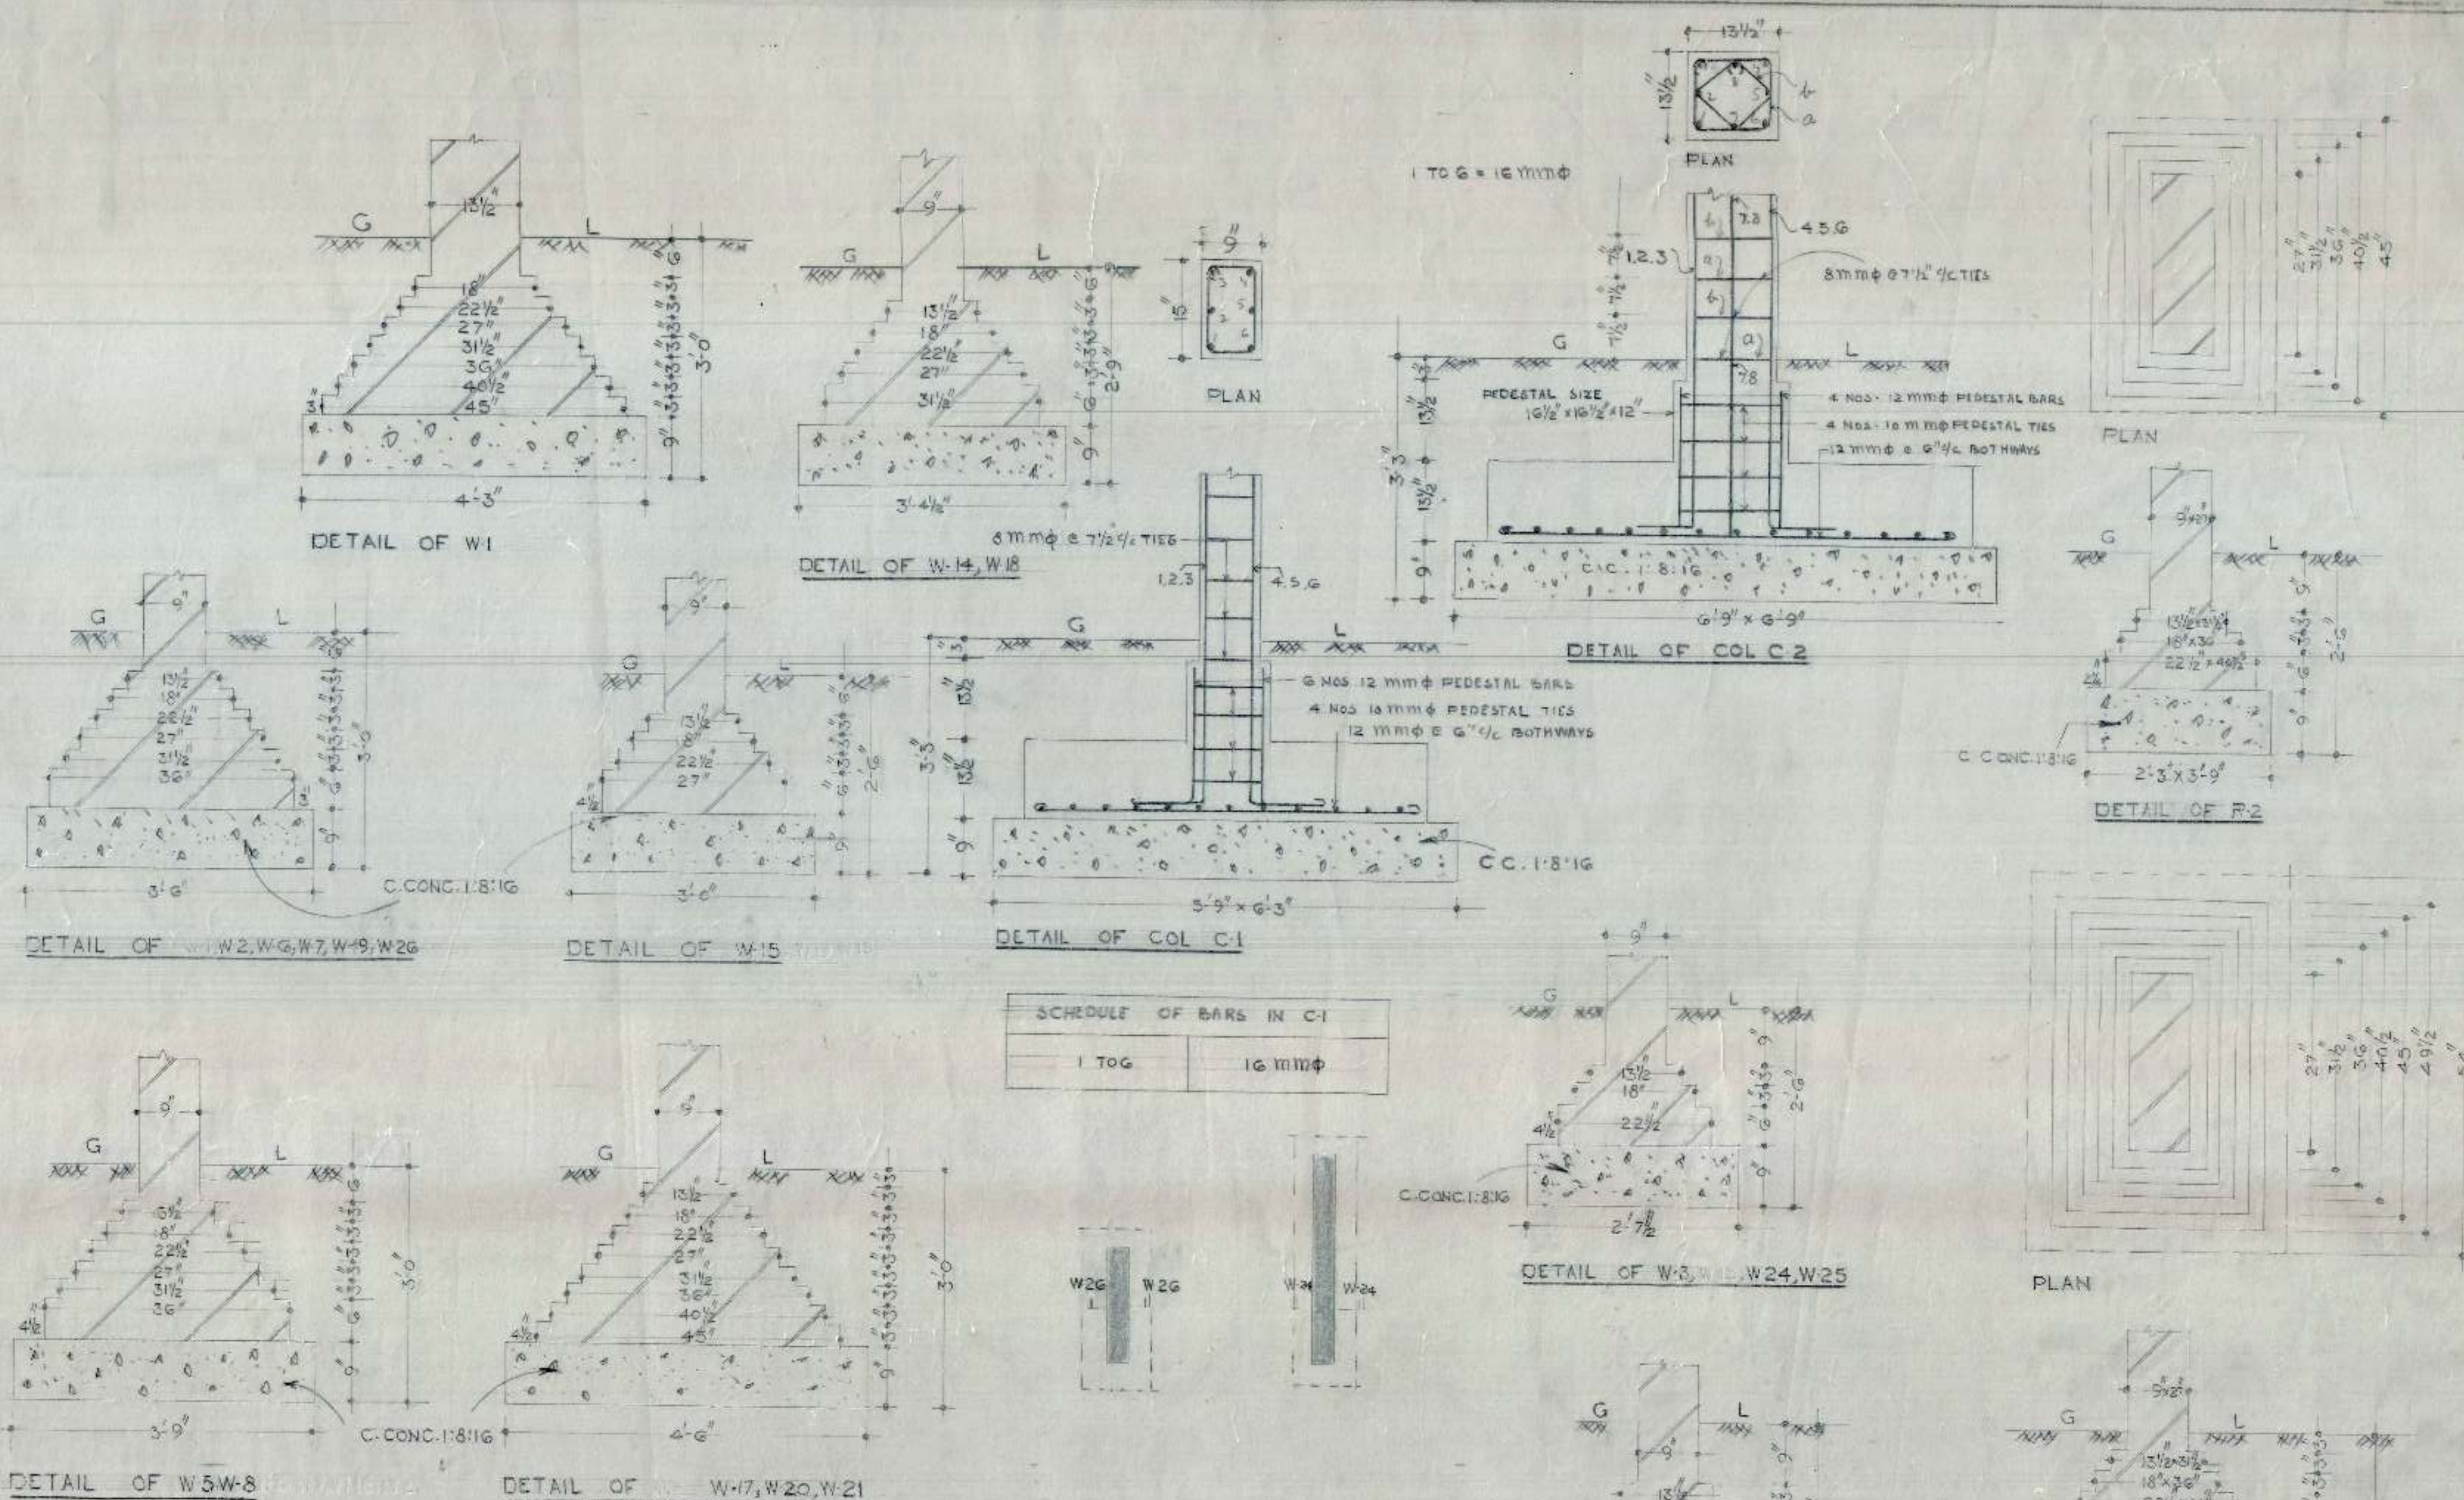

NOTE:- USE C.M 1:7 IN FOUNDATIONS & PLINTH IN ALL THE WALLS AND PILLARS

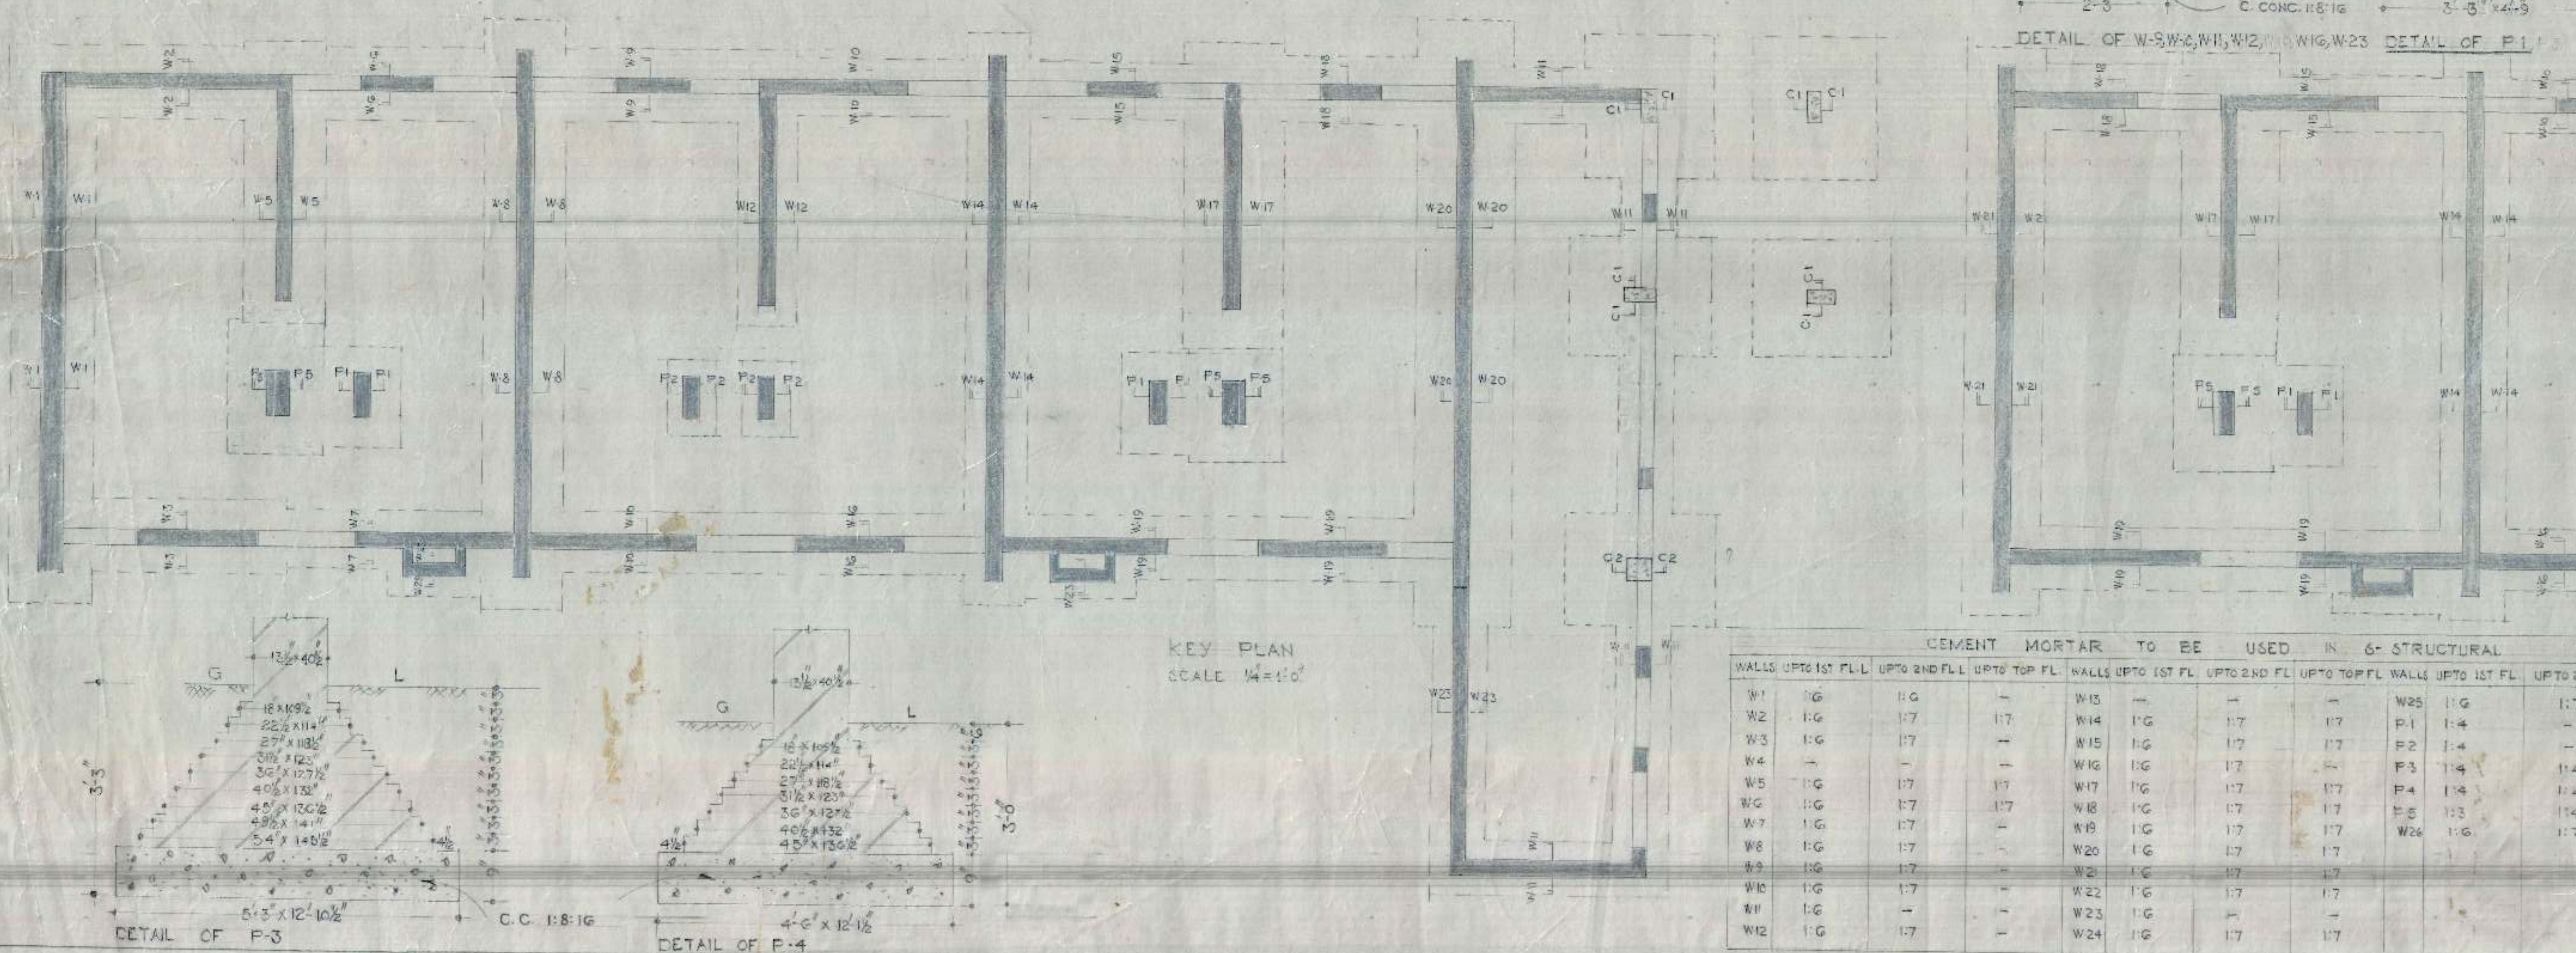

CEMENT MORTAR TO BE USED IN 6" STRUCTURAL											
WALLS	UPTO 1ST FLL	UPTO 2ND FLL	UPTO TOP FL	WALLS	UPTO 1ST FL	UPTO 2ND FL	UPTO TOP FL	WALLS	UPTO 1ST FL	UPTO 2ND FL	UPTO TOP FL
W1	1:6	1:6	—	W15	—	—	—	W25	1:6	1:7	1:7
W2	1:6	1:7	1:7	W14	1:6	1:7	1:7	P1	1:4	—	—
W3	1:6	1:7	—	W15	1:6	1:7	1:7	P2	1:4	—	—
W4	—	—	—	W16	1:6	1:7	—	P3	1:4	1:4	1:4
W5	1:6	1:7	1:7	W17	1:6	1:7	1:7	P4	1:4	1:4	—
W6	1:6	1:7	—	W18	1:6	1:7	1:7	P5	1:3	1:4	1:4
W7	1:6	1:7	—	W19	1:6	1:7	1:7	W26	1:6	1:7	1:7
W8	1:6	1:7	—	W20	1:6	1:7	1:7	—	—	—	—
W9	1:6	1:7	—	W21	1:6	1:7	1:7	—	—	—	—
W10	1:6	1:7	—	W22	1:6	1:7	1:7	—	—	—	—
W11	1:6	—	—	W23	1:6	—	—	—	—	—	—
W12	1:6	1:7	—	W24	1:6	1:7	1:7	—	—	—	—

CHILD

S.No	NOTES
------	-------

1. FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG NO. JOB NO.
2. SUTABLE D.P.C MAY BE PROVIDED AT SITE
3. STRUCTURAL SIZES AS SHOWN IN THIS DRG SHOULD BE DISPUTE OF ANY CONTRINARY SIZES SHOWN IN THE ARCH. DRG.
4. DIMENSIONS ARE TO BE READ & NOT TO BE SCALED OFF.
5. THE SAFE BEARING CAPACITY OF SOIL HAS BE ASSUMED AS 10 T/CM² WHICH SHOULD BE ENSURED AT SITE.
6. THE CURE STRENGTH OF CONIC POURED AT SITE (FIELD STRENGTH) AFTER 28 DAYS SHALL NOT BE LESS THAN 2500 LBS/IN² AND MIX NOT LEANER THAN 1:2:4.
7. JAMBS OF ALL THE WALLS TO BE BUILT IN C.M. 1:4.
8. DISCREPANCIES BETWEEN DETAILS SHOWN IN THIS DRG AND ARCH. DRG IF ANY SHOULD BE GOT CLARIFIED FROM THIS OFFICE BEFORE ADOPTING THIS DESIGN.
9. F.I. SHALL BE FIXED BY THE ENGINEER-IN-CHARGE AS PER SITE CONDITIONS.












OFFICE OF THE SUPERINTENDING ENGINEER	
CHANDIGARH	HOUSING BOARD CHANDIGARH.
<i>dat-24-11-68</i>	
M.I.G. TWO ROOM	DWG No
G.A.	12
ERN BY	
SCALE	
$3/4 = 1'-0"$	
DETAIL OF	JOB No
FOUNDATIONS.	40
<i>18/11/68</i>	
<i>24/11/68</i>	
S.F. 12	S.F. 12

C. MORTAR TO BE USED IN SUPER-STRUCTURE											
WALLS	UP TO 1ST FL	UP TO 2ND FL	UP TO TOP FL	WALLS	UP TO 1ST FL	UP TO 2ND FL	UP TO TOP FL	WALLS	UP TO 1ST FL	UP TO 2ND FL	UP TO TOP
W1	1:6	1:7	1:7	W12	1:6	1:7	-				
W2	1:6	1:7	1:7	W13	1:6	1:7	-				
W3	1:6	1:7	1:7	W14	1:6	1:7	1:7				
W4	1:6	1:7	1:7	W15	1:6	1:7	1:7	P1	1:4	1:4	-
W5	1:6	1:7	1:7	W16	1:6	1:7	1:7	P2	1:3	1:4	-
W6	1:6	1:6	1:7	W17	1:6	1:7	1:7	P3	1:3	-	-
W7	1:6	1:7	1:7	W18	1:6	-	-	P4	1:3	1:4	1:4
W8	1:6	1:7	1:7								
W9	1:6	-	-								
W10	1:6	-	-								
W11	1:6	-	-								

NOTE: USE C.M. 1:7 IN FOUNDATIONS AND PLINTH IN ALL THE WALLS AND PILLARS.

C.H.B

- S.No. NOTES.
- FOR CENTRE LINE DIMENSIONS REFER. ARCH. DRG. NO. 305 NO.
 - SUITABLE D.P.C. MAY BE PROVIDED AT SITE.
 - STRUCTURAL SIZES AS SHOWN IN THIS DRG. SHOULD BE ADOPTED INSTEAD OF ANY CONTRARY SIZES SHOWN IN THE ARCH. DRG.
 - THE SAFE BEARING CAPACITY OF SOIL HAS BEEN ASSUMED AS 1.0 T/C, WHICH SHOULD BE ENSURED AT SITE.
 - THE CUBE STRENGTH OF CONC. POURED AT SITE AFTER 28 DAYS SHALL NOT BE LESS THAN 2500 LB/SQ. INCH (MIN) AND MIX NOT LEANER THAN 1:2:4.
 - JAMBS OF 3'6" x 9'1 1/2" x 9'2 1/2" TO BE BUILT IN C.M. 1:4.
 - DIMENSIONS ARE TO BE READ NOT TO BE SCALED OFF.
 - DISCREPANCIES BETWEEN DETAILS SHOWN IN THIS DRG. AND ARCH. DRG. IF ANY SHOULD BE GOT CLARIFIED FROM THIS OFFICE BEFORE ADOPTING THIS DESIGN.

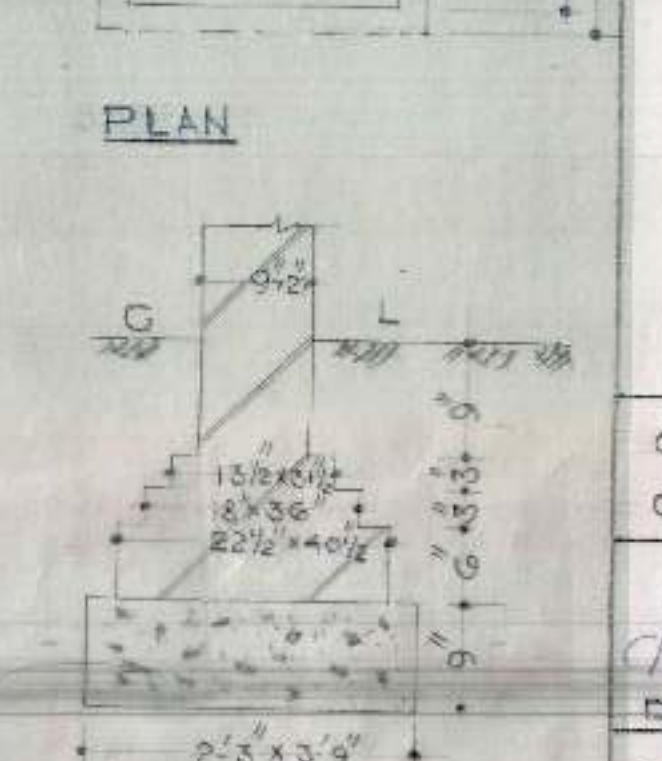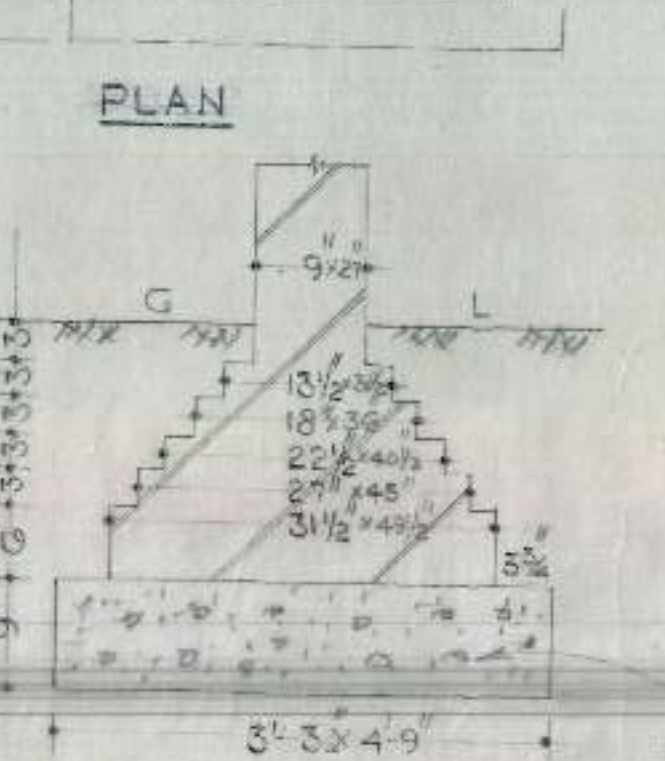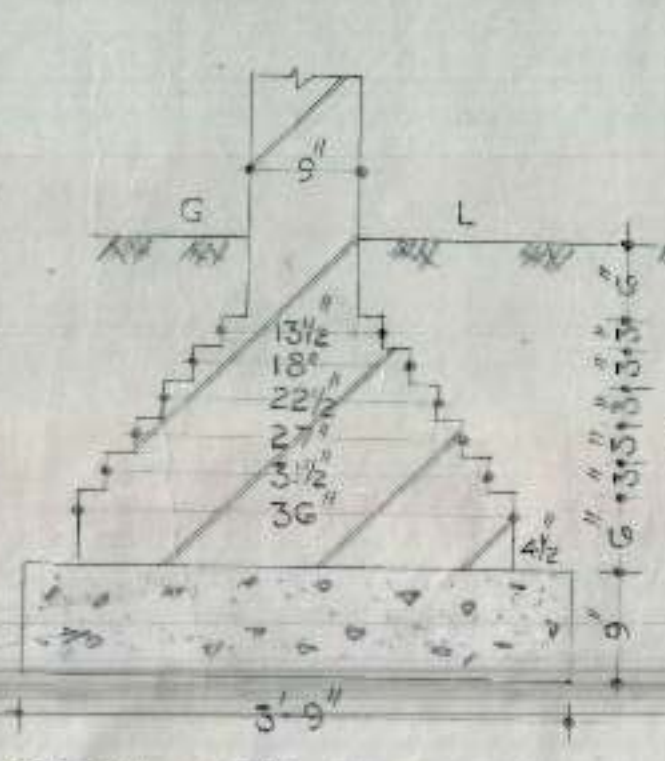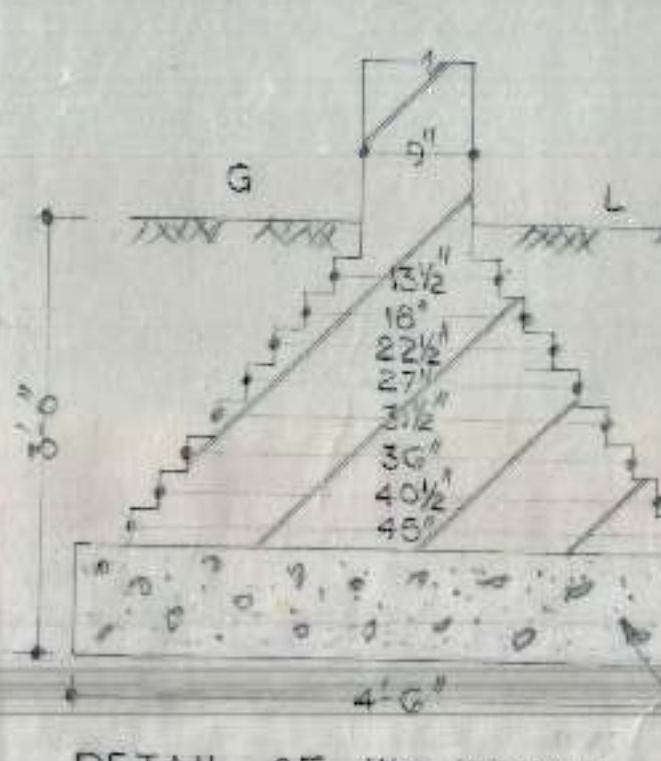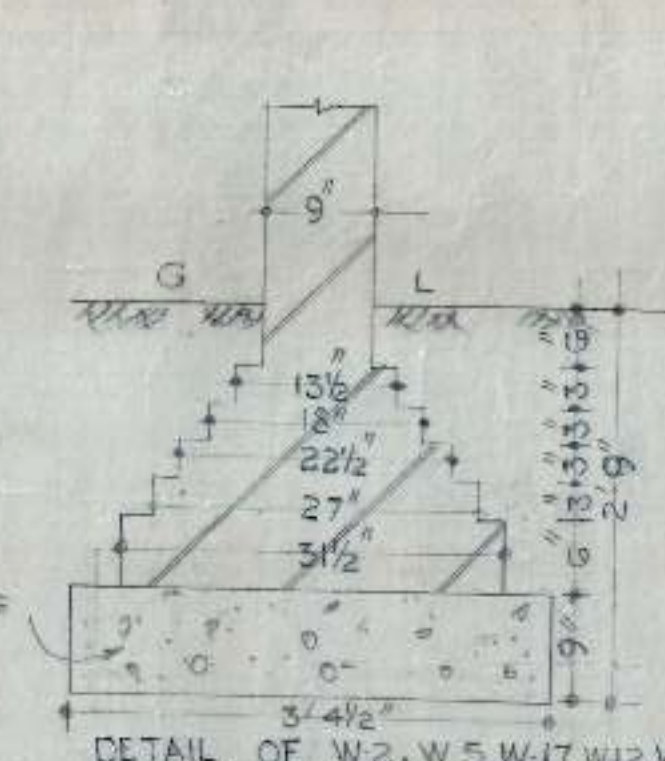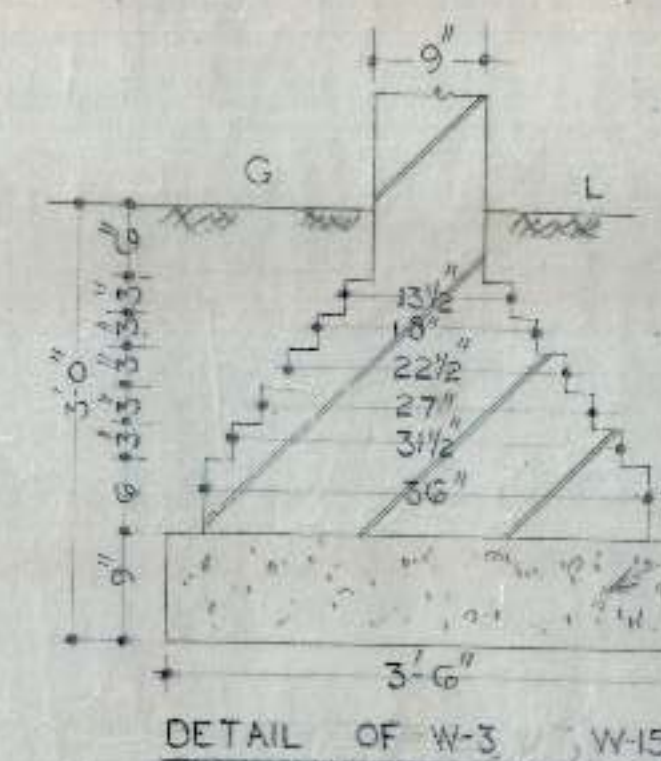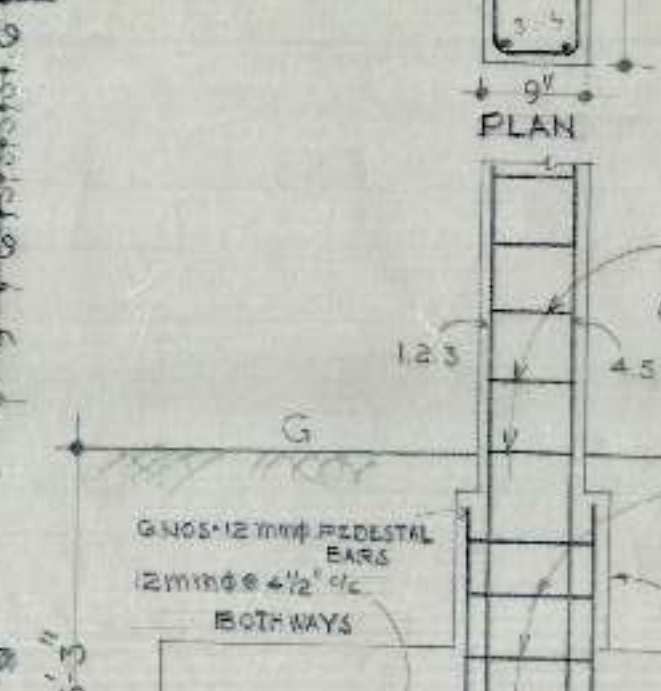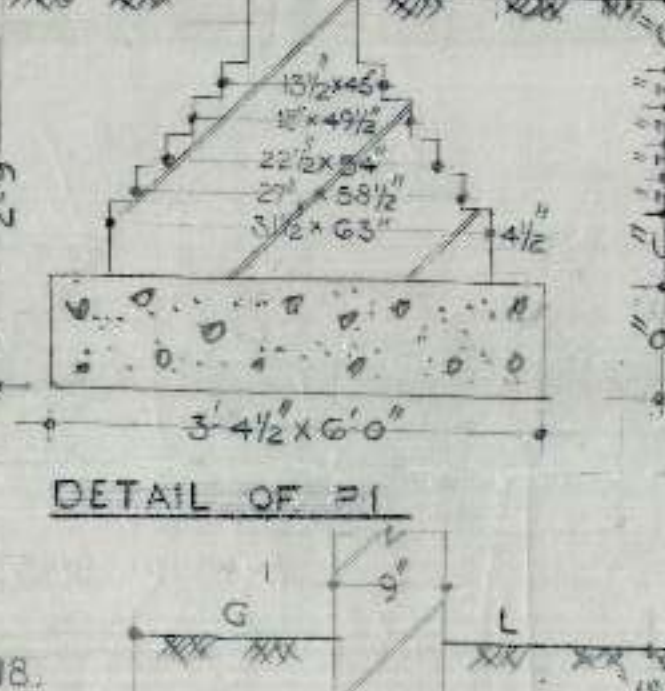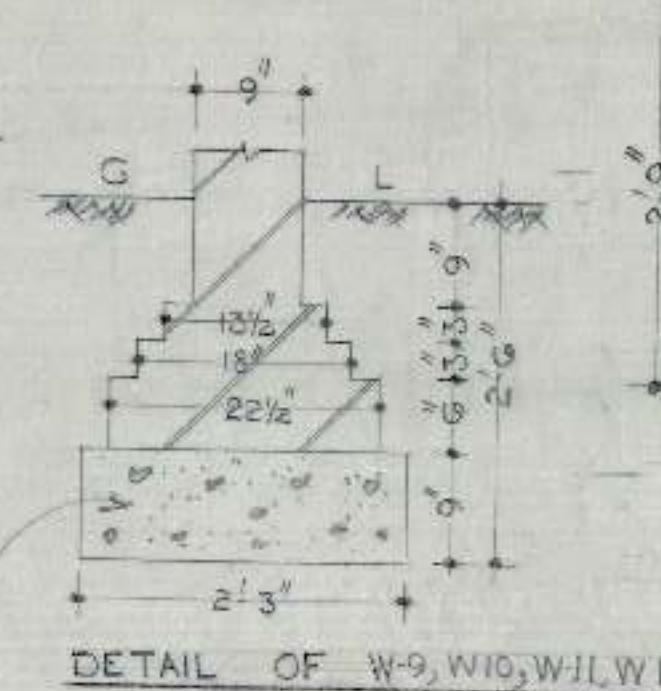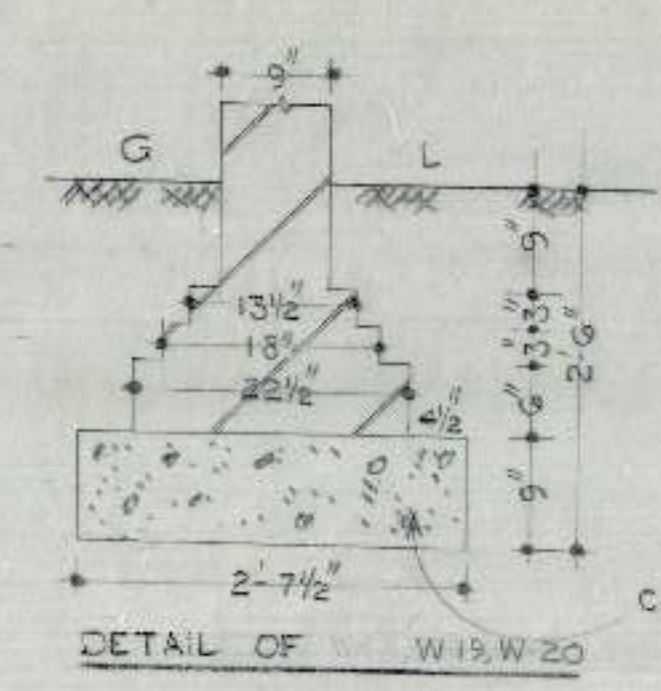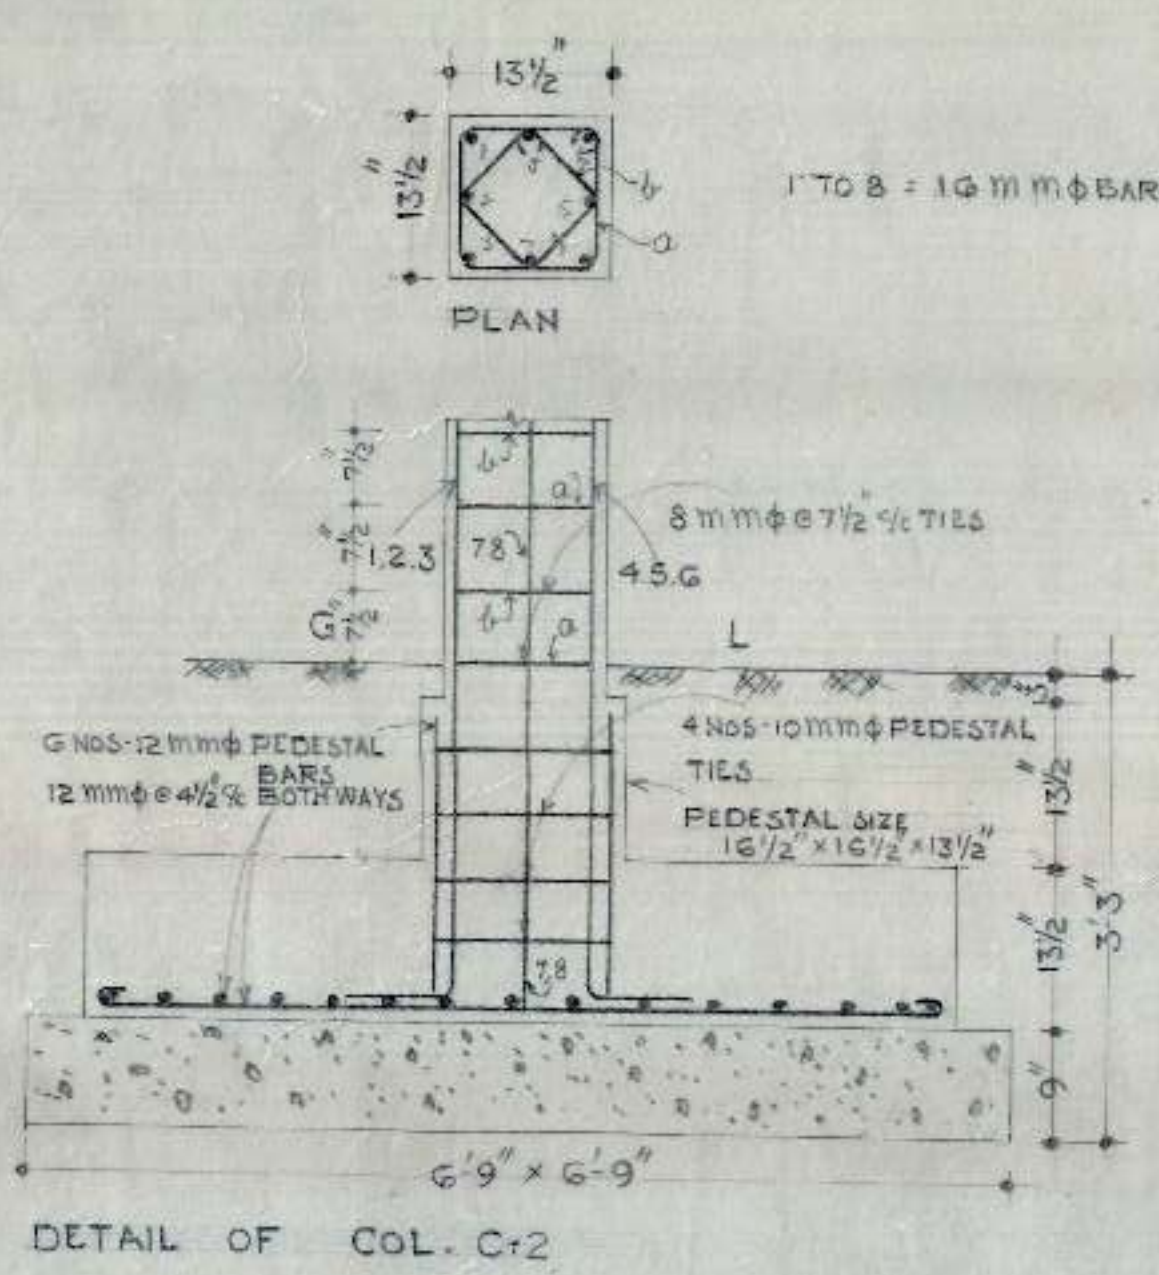

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

M.I.G. TWO ROOM GROUP B. DRG. NO. 305



SCALE 3/4" = 1'-0"

DETAIL OF FOUNDATION


Job no. 40

A.E.D.

CHB

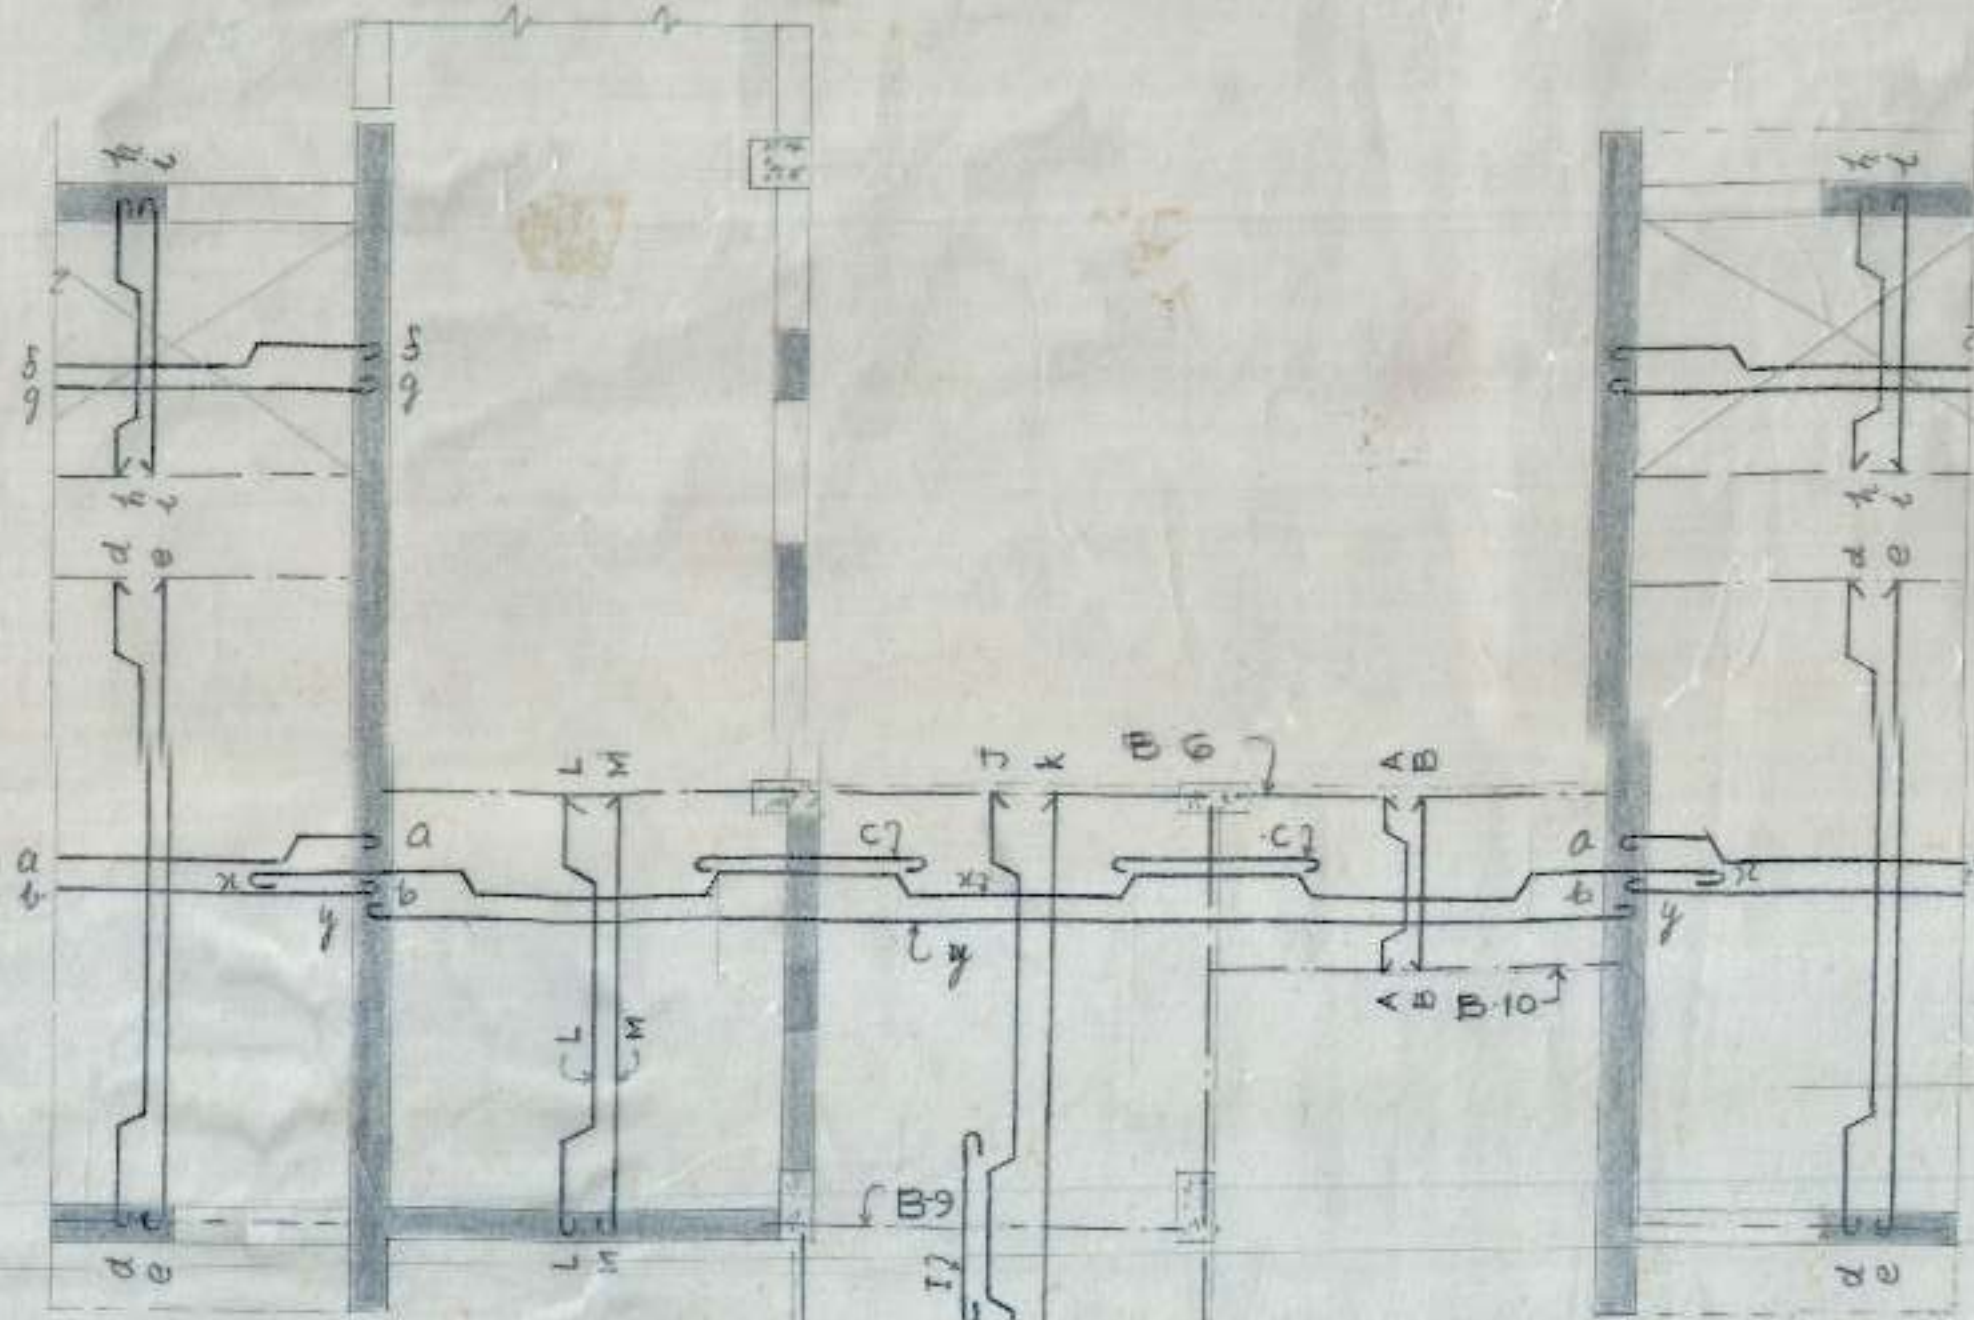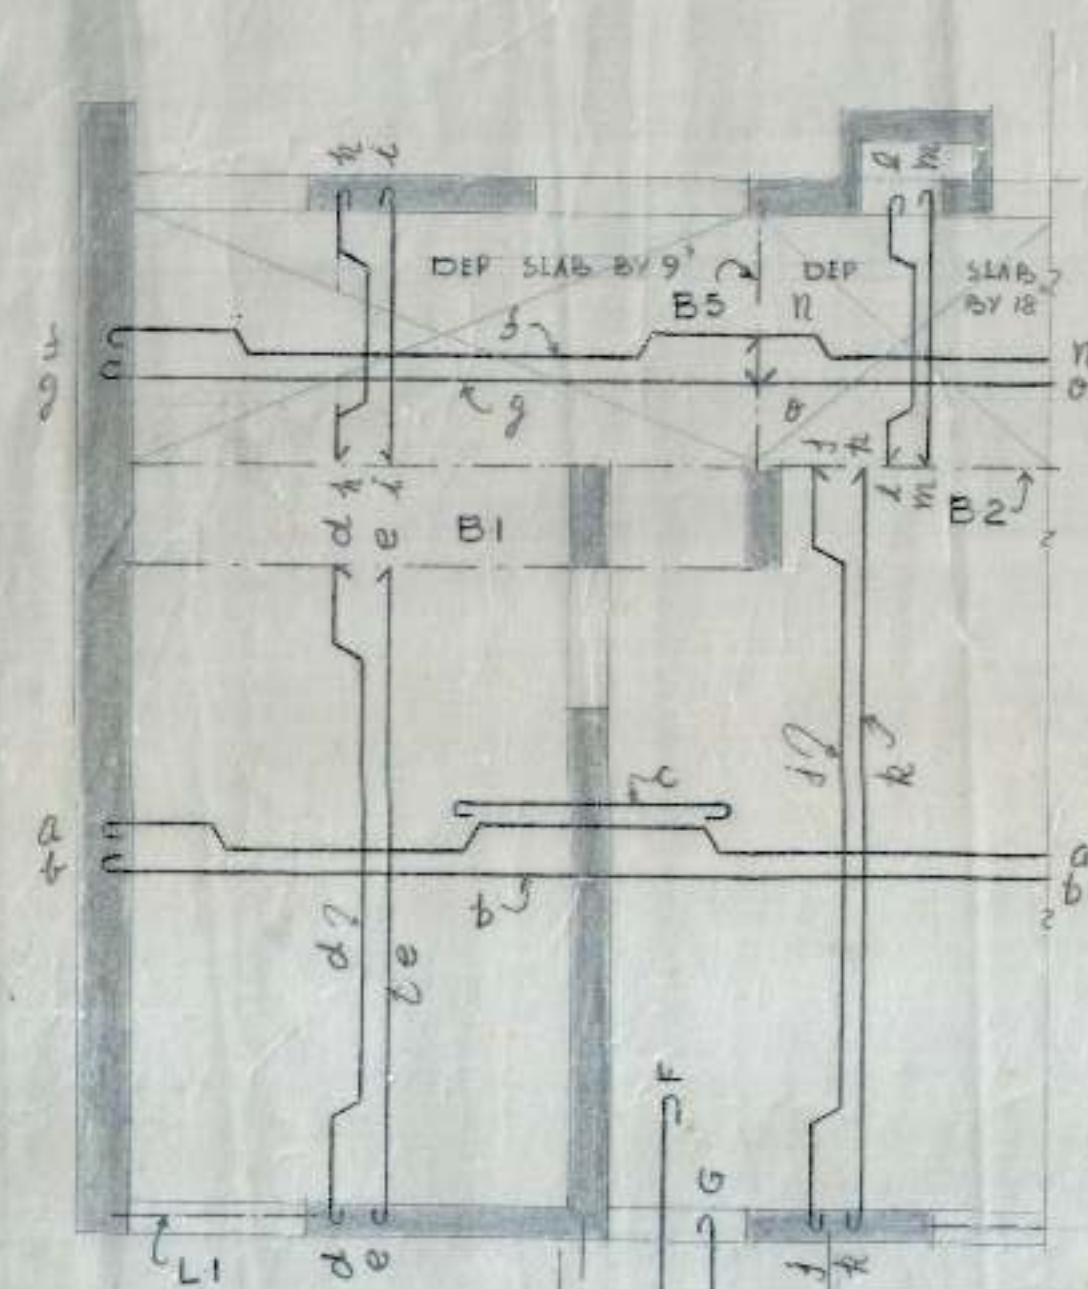


SCHEDULE OF BARS IN SLAB.											
a	10 mm	φ	a	14	%	A	10 mm	φ	a	14	%
b	10 mm	φ	b	14	%	B	8 mm	φ	b	14	%
c	10 mm	φ	c	14	%	C	8 mm	φ	c	14	%
d	10 mm	φ	d	14	%	D	10 mm	φ	d	15	%
e	10 mm	φ	e	14	%	E	8 mm	φ	e	15	%
f	8 mm	φ	f	14	%	F	8 mm	φ	f	14	%
g	8 mm	φ	g	14	%	G	8 mm	φ	g	14	%
h	10 mm	φ	h	12	%	H	10 mm	φ	h	14	%
i	10 mm	φ	i	12	%	I	10 mm	φ	i	14	%
j	10 mm	φ	j	14	%	J	8 mm	φ	j	14	%
k	10 mm	φ	k	14	%	K	8 mm	φ	k	14	%
l	10 mm	φ	l	15	%	L	10 mm	φ	l	14	%
m	10 mm	φ	m	15	%	M	8 mm	φ	m	14	%
n	10 mm	φ	n	15	%	N	10 mm	φ	n	12	%
o	10 mm	φ	o	15	%	O	10 mm	φ	o	12	%
p	12 mm	φ	p	12	%						
q	10 mm	φ	q	12	%						
r	10 mm	φ	r	12	%						
s	10 mm	φ	s	12	%						
t	8 mm	φ	t	14	%						
u	10 mm	φ	u	14	%						
v	8 mm	φ	v	14	%						
w	10 mm	φ	w	14	%						
x	8 mm	φ	x	14	%						
y	8 mm	φ	y	14	%						
z											

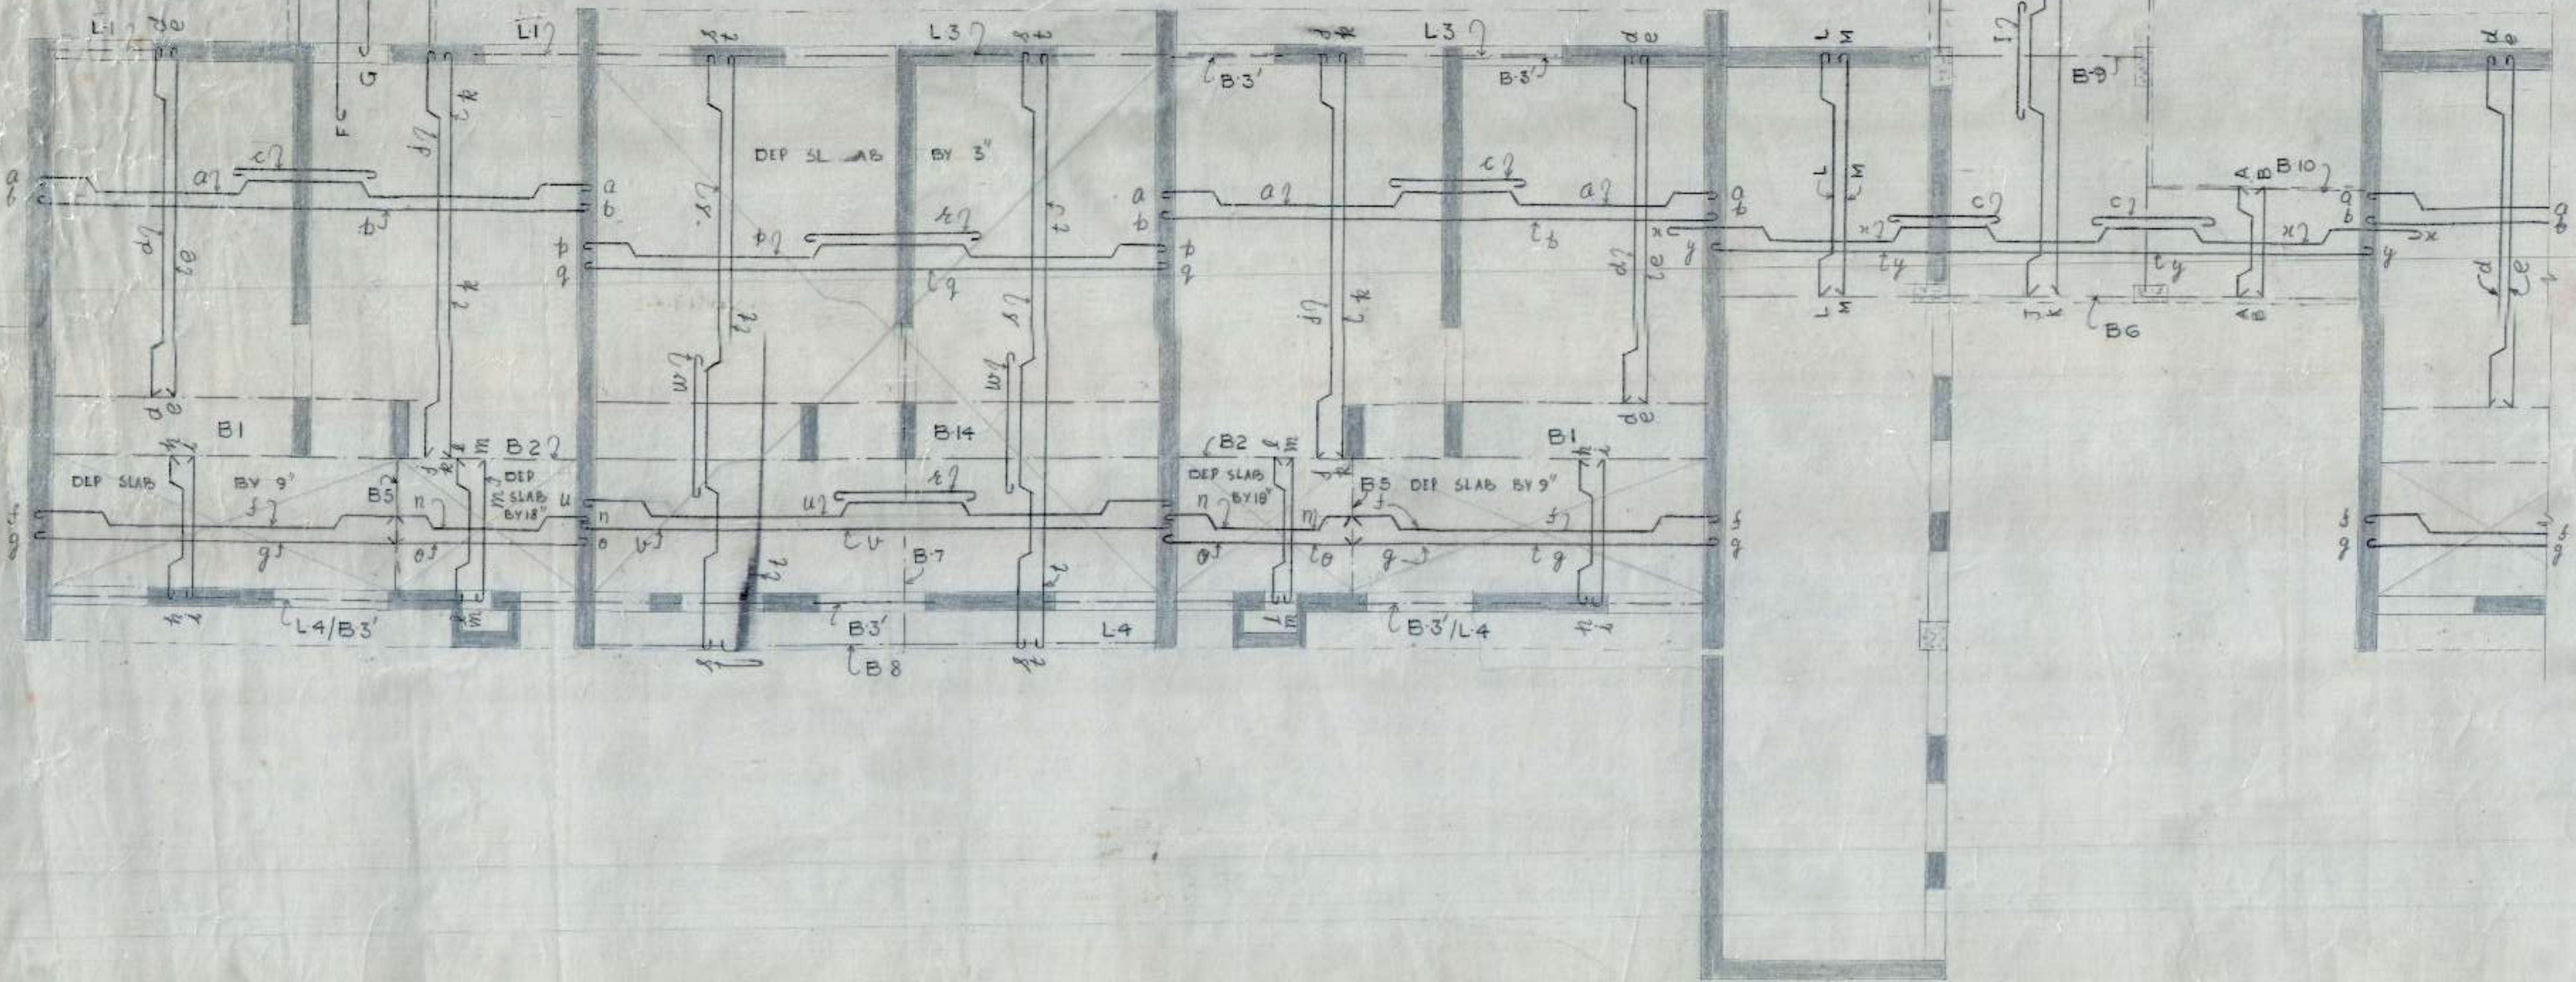


- | S No | NOTES |
|------|---|
| 1 | FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG NO 41 JOB NO. 79. |
| 2 | DIMENSIONS ARE TO BE READ NOT TO BE SCALED OFF. |
| 3 | CLEAR COVERS FOR BEAMS TO BE 1" & FOR SLAB TO BE 1/2" |
| 4 | STRUCTURAL SIZES SHOWN IN THIS DRG SHOULD BE ADOPTED INSPITE OF ANY CONTRARY SIZES AS SHOWN IN THE ARCH. DRG. |
| 5 | THE CUBE STRENGTH OF CONC IN SITU AFTER 28 DAYS SHALL NOT BE LESS THAN 2500 LBS/IN ² AND CONC. MIX NOT LEANER THAN 1:2:4. |
| 6 | SUITABLE LINTELS MAY BE PROVIDED OVER OPENINGS SUCH AS DOORS & WINDOWS. |
| 7 | LAPS IN REINFORCEMENT SHALL BE IN ACCORDANCE WITH LATEST 1:3:1 SPECIFICATIONS. |
| 8 | ANCHORAGE IN REINFORCEMENT SHALL BE 40 TIMES THE DIAMETER WHEREVER REQD. |
| 9 | DISCREPANCIES BETWEEN DETAILS SHOWN IN THIS DRG AND ARCH. DRGS IF ANY SHOULD BE GOT CLARIFIED FROM THIS OFFICE BEFORE ADOPTING THIS DESIGN. |

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH		
DRN BY <i>Ashwadeh</i>	M.I.G TWO ROOM	DRG NO 2
SCALE 1/4" = 1'-0"	DETAIL OF REINFORCEMENT IN SLAB AT G.F	JOB NO 40
A.E.D. <i>Ashwadeh</i>	E.E.I. <i>MM</i>	SEHS


CELB

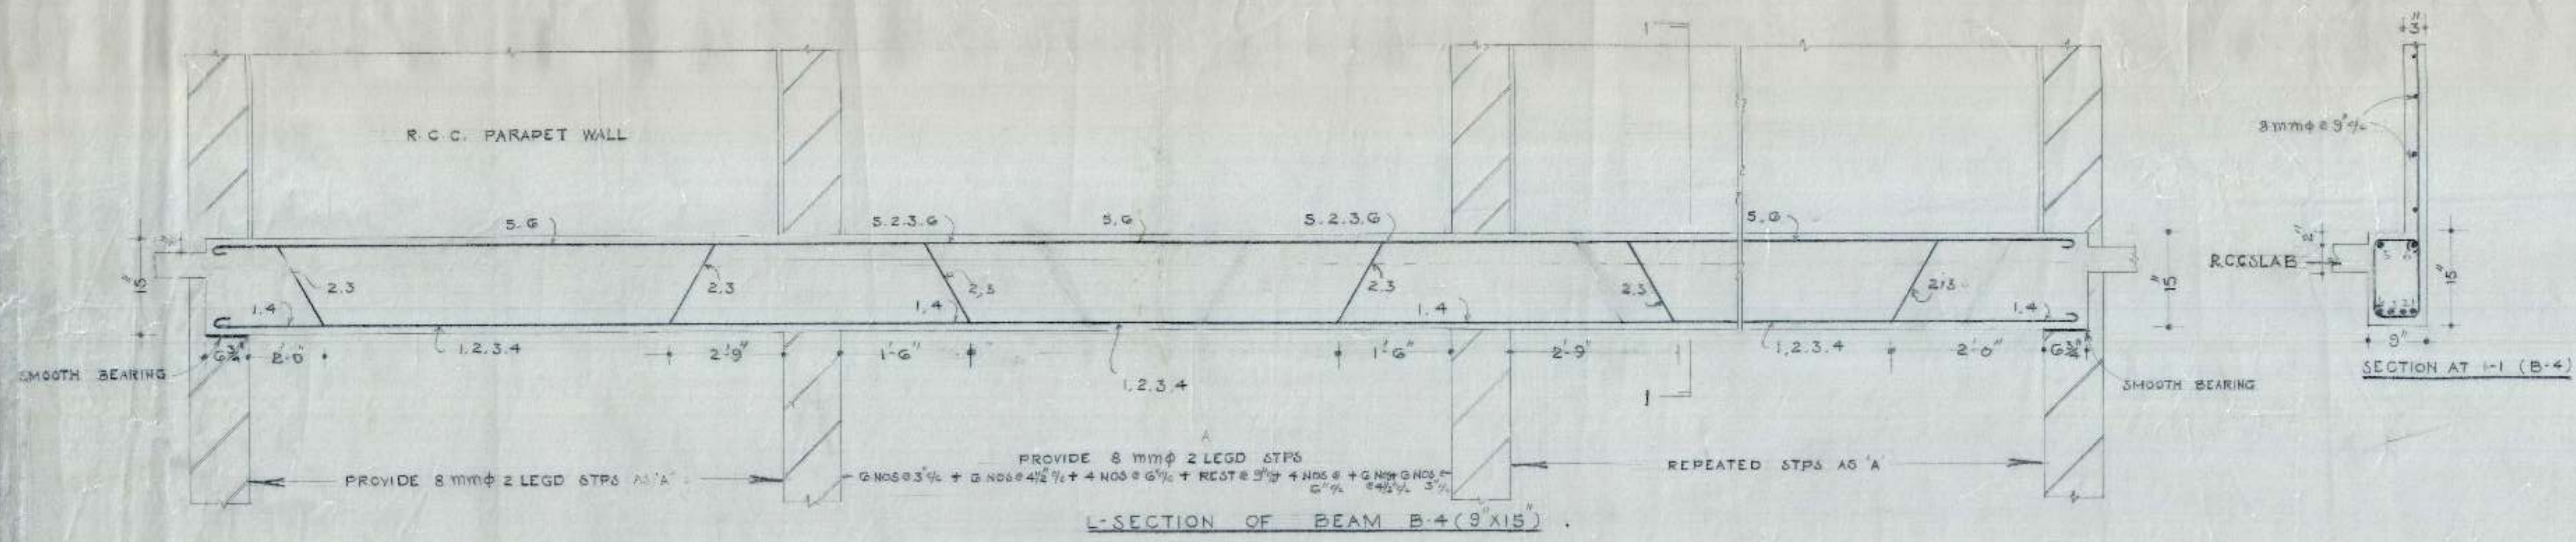


SCHEDULE OF BARS IN B-4	
1, 2, 3, 4	10 mm ϕ
5, 6	12 mm ϕ

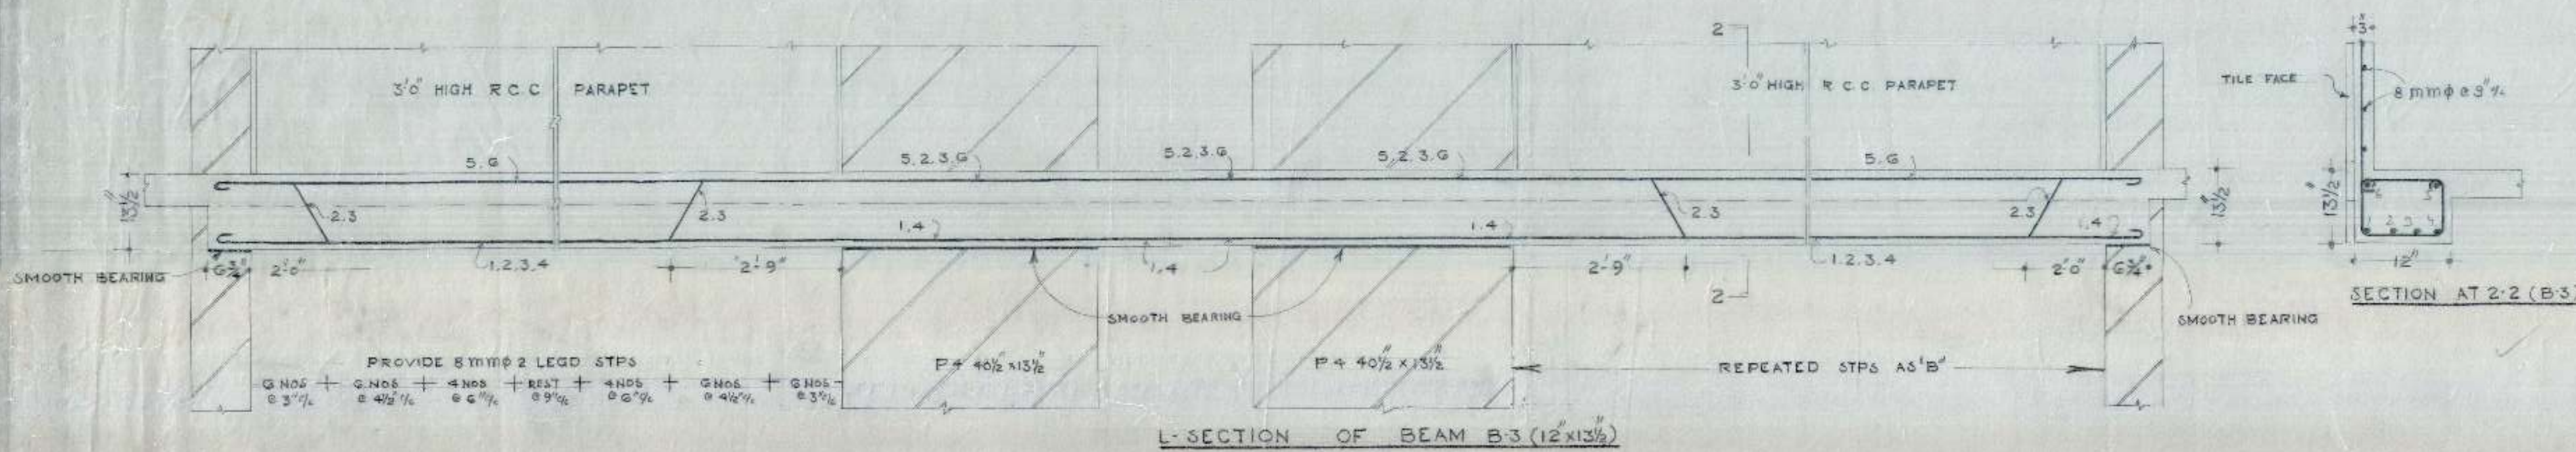

SCHEDULE OF BARS IN B-3	
1, 2, 3, 4	10 mm ϕ
5, 6	12 mm ϕ

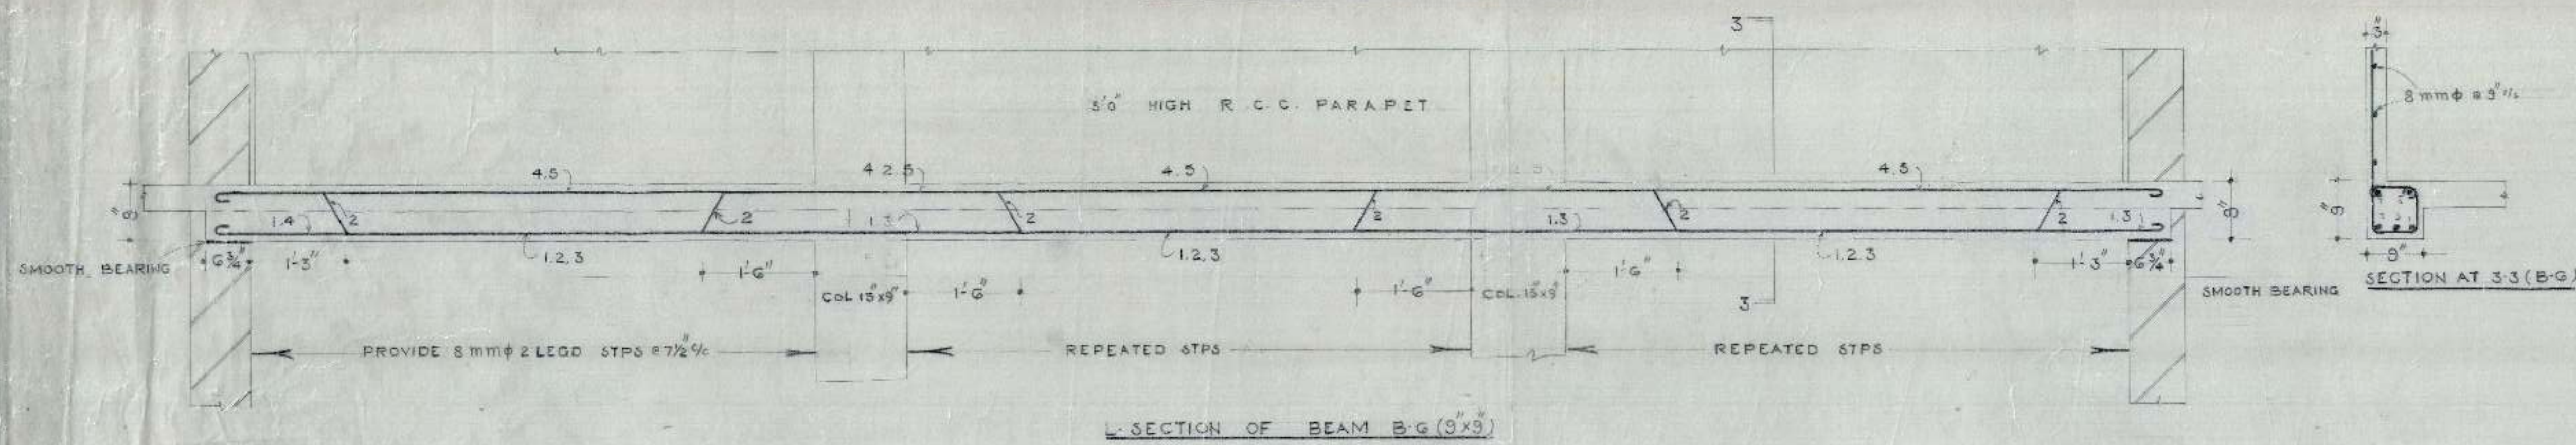


SCHEDULE OF BARS IN B-6	
1, 3	10 mm ϕ
4, 5, 2	12 mm ϕ

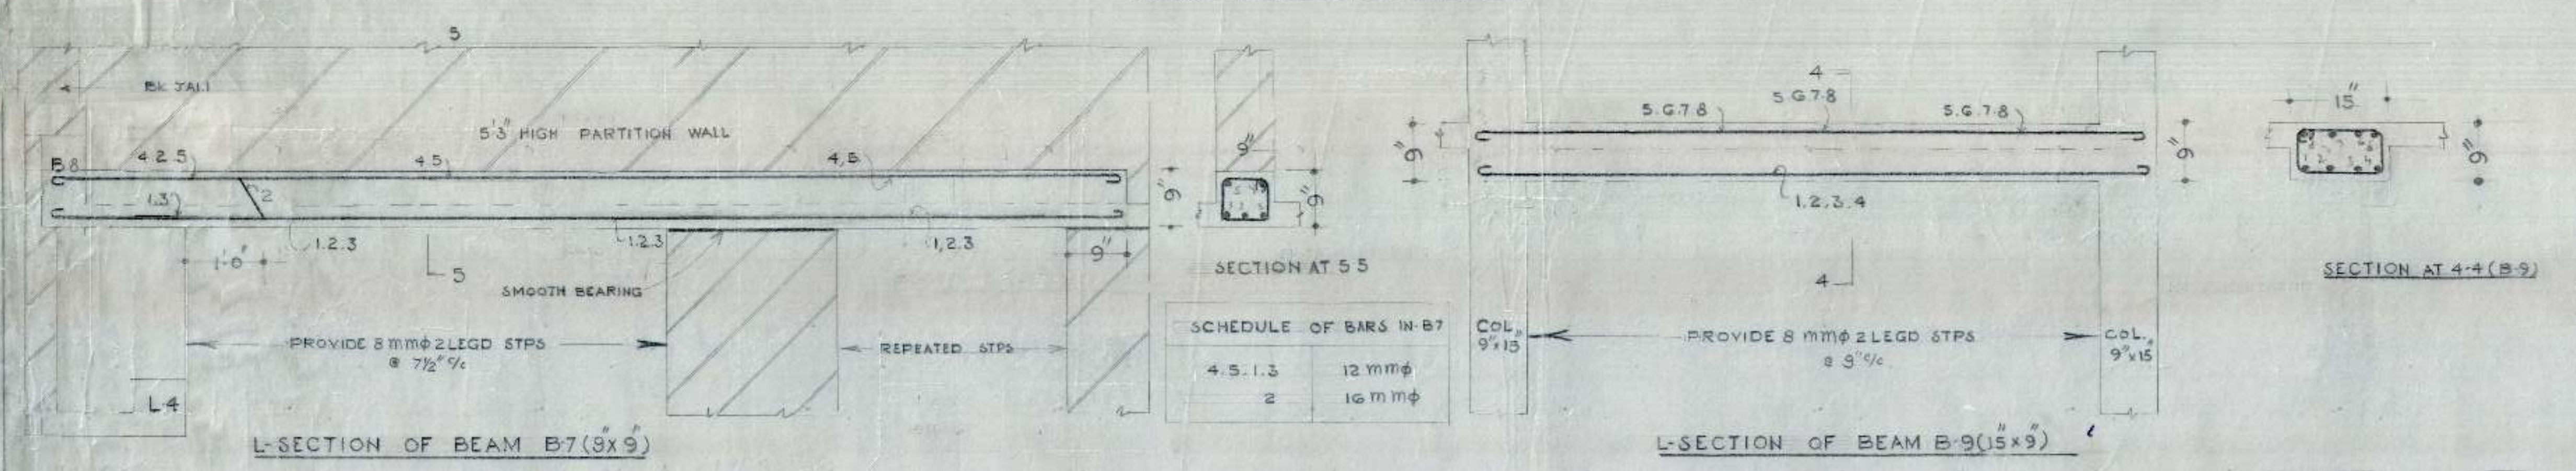

SCHEDULE OF BARS IN B-7	
4, 5, 1, 3	12 mm ϕ
2	10 mm ϕ

SCHEDULE OF BARS IN B-9	
1 TO 8	10 mm ϕ

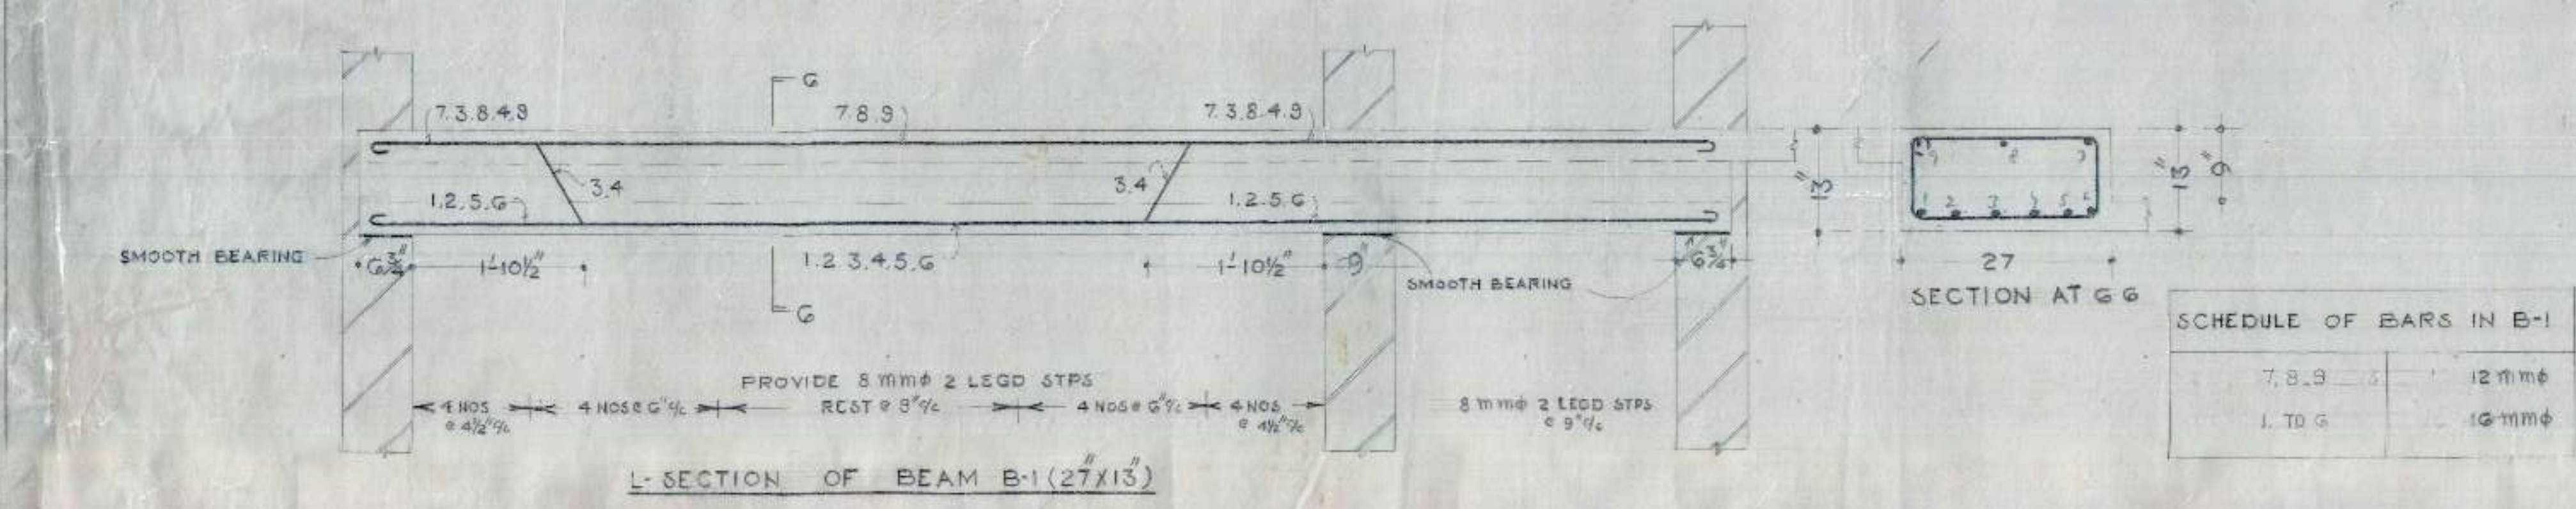


SCHEDULE OF BARS IN B-1	
7, 8, 9	12 mm ϕ
1 TO 6	10 mm ϕ

- NOTES
- FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG. NO. 41 JOB NO. 79
 - FOR OTHER NOTES & REFERENCES REFER STR. DRG. NO. 2 JOB NO. 40

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH			
DRN BY	M.I.G TWO ROOM	DRG NO.	3
SCALE	DETAIL OF REINFORCEMENT IN BEAMS AT G.F.L.	JOB NO.	40
A.E.D.	E.E-1	S.E.N.B.	


CHB

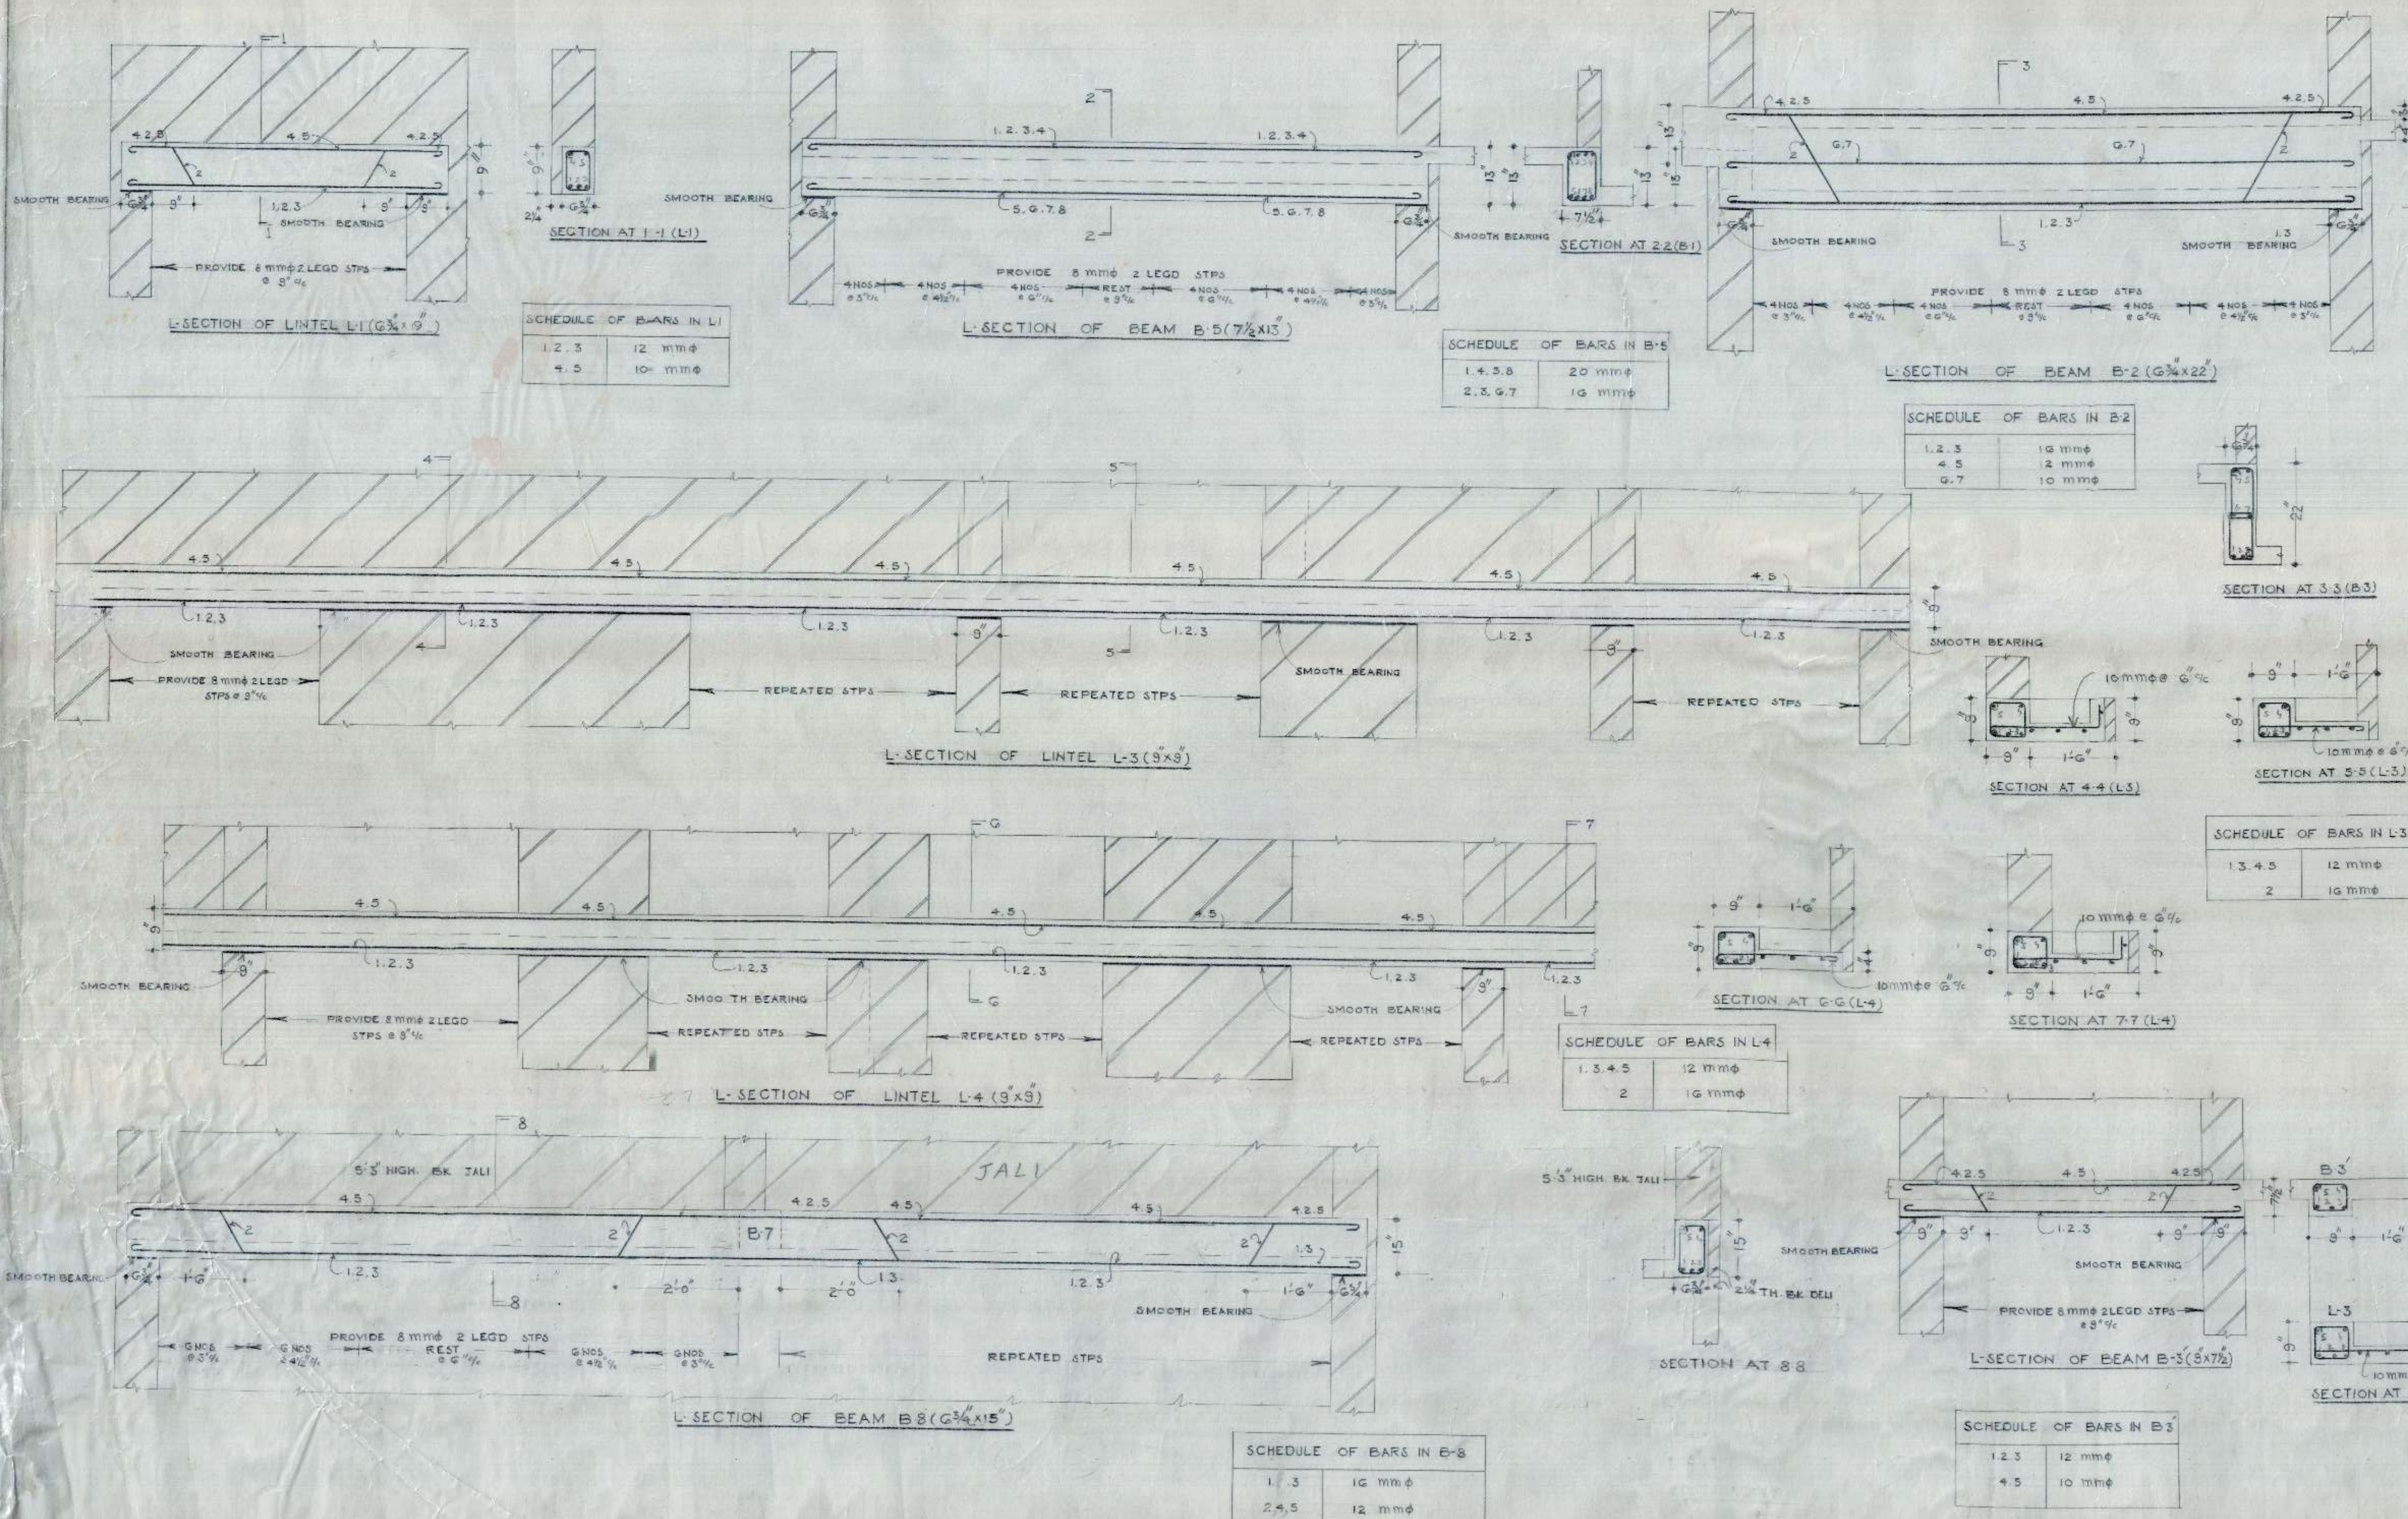

5. NO. NOTES
1. FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG NO 41 JOB NO. 79
 2. FOR OTHER NOTES & REFERENCES REFER ST. DRG NO 2 JOB NO. 40

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH		
DESIGNED BY <i>Atul K. Dhillon</i>	M.I.G. TWO ROOM	DRG. NO. 4
SCALE 3/4" = 1'-0"	DETAIL OF REINFORCEMENT IN LINTELS AND BEAMS AT G-FLOOR	JOB NO. 40
CHECKED BY <i>14/10/85</i>	DATE 15/10/85	SERIES


CHB

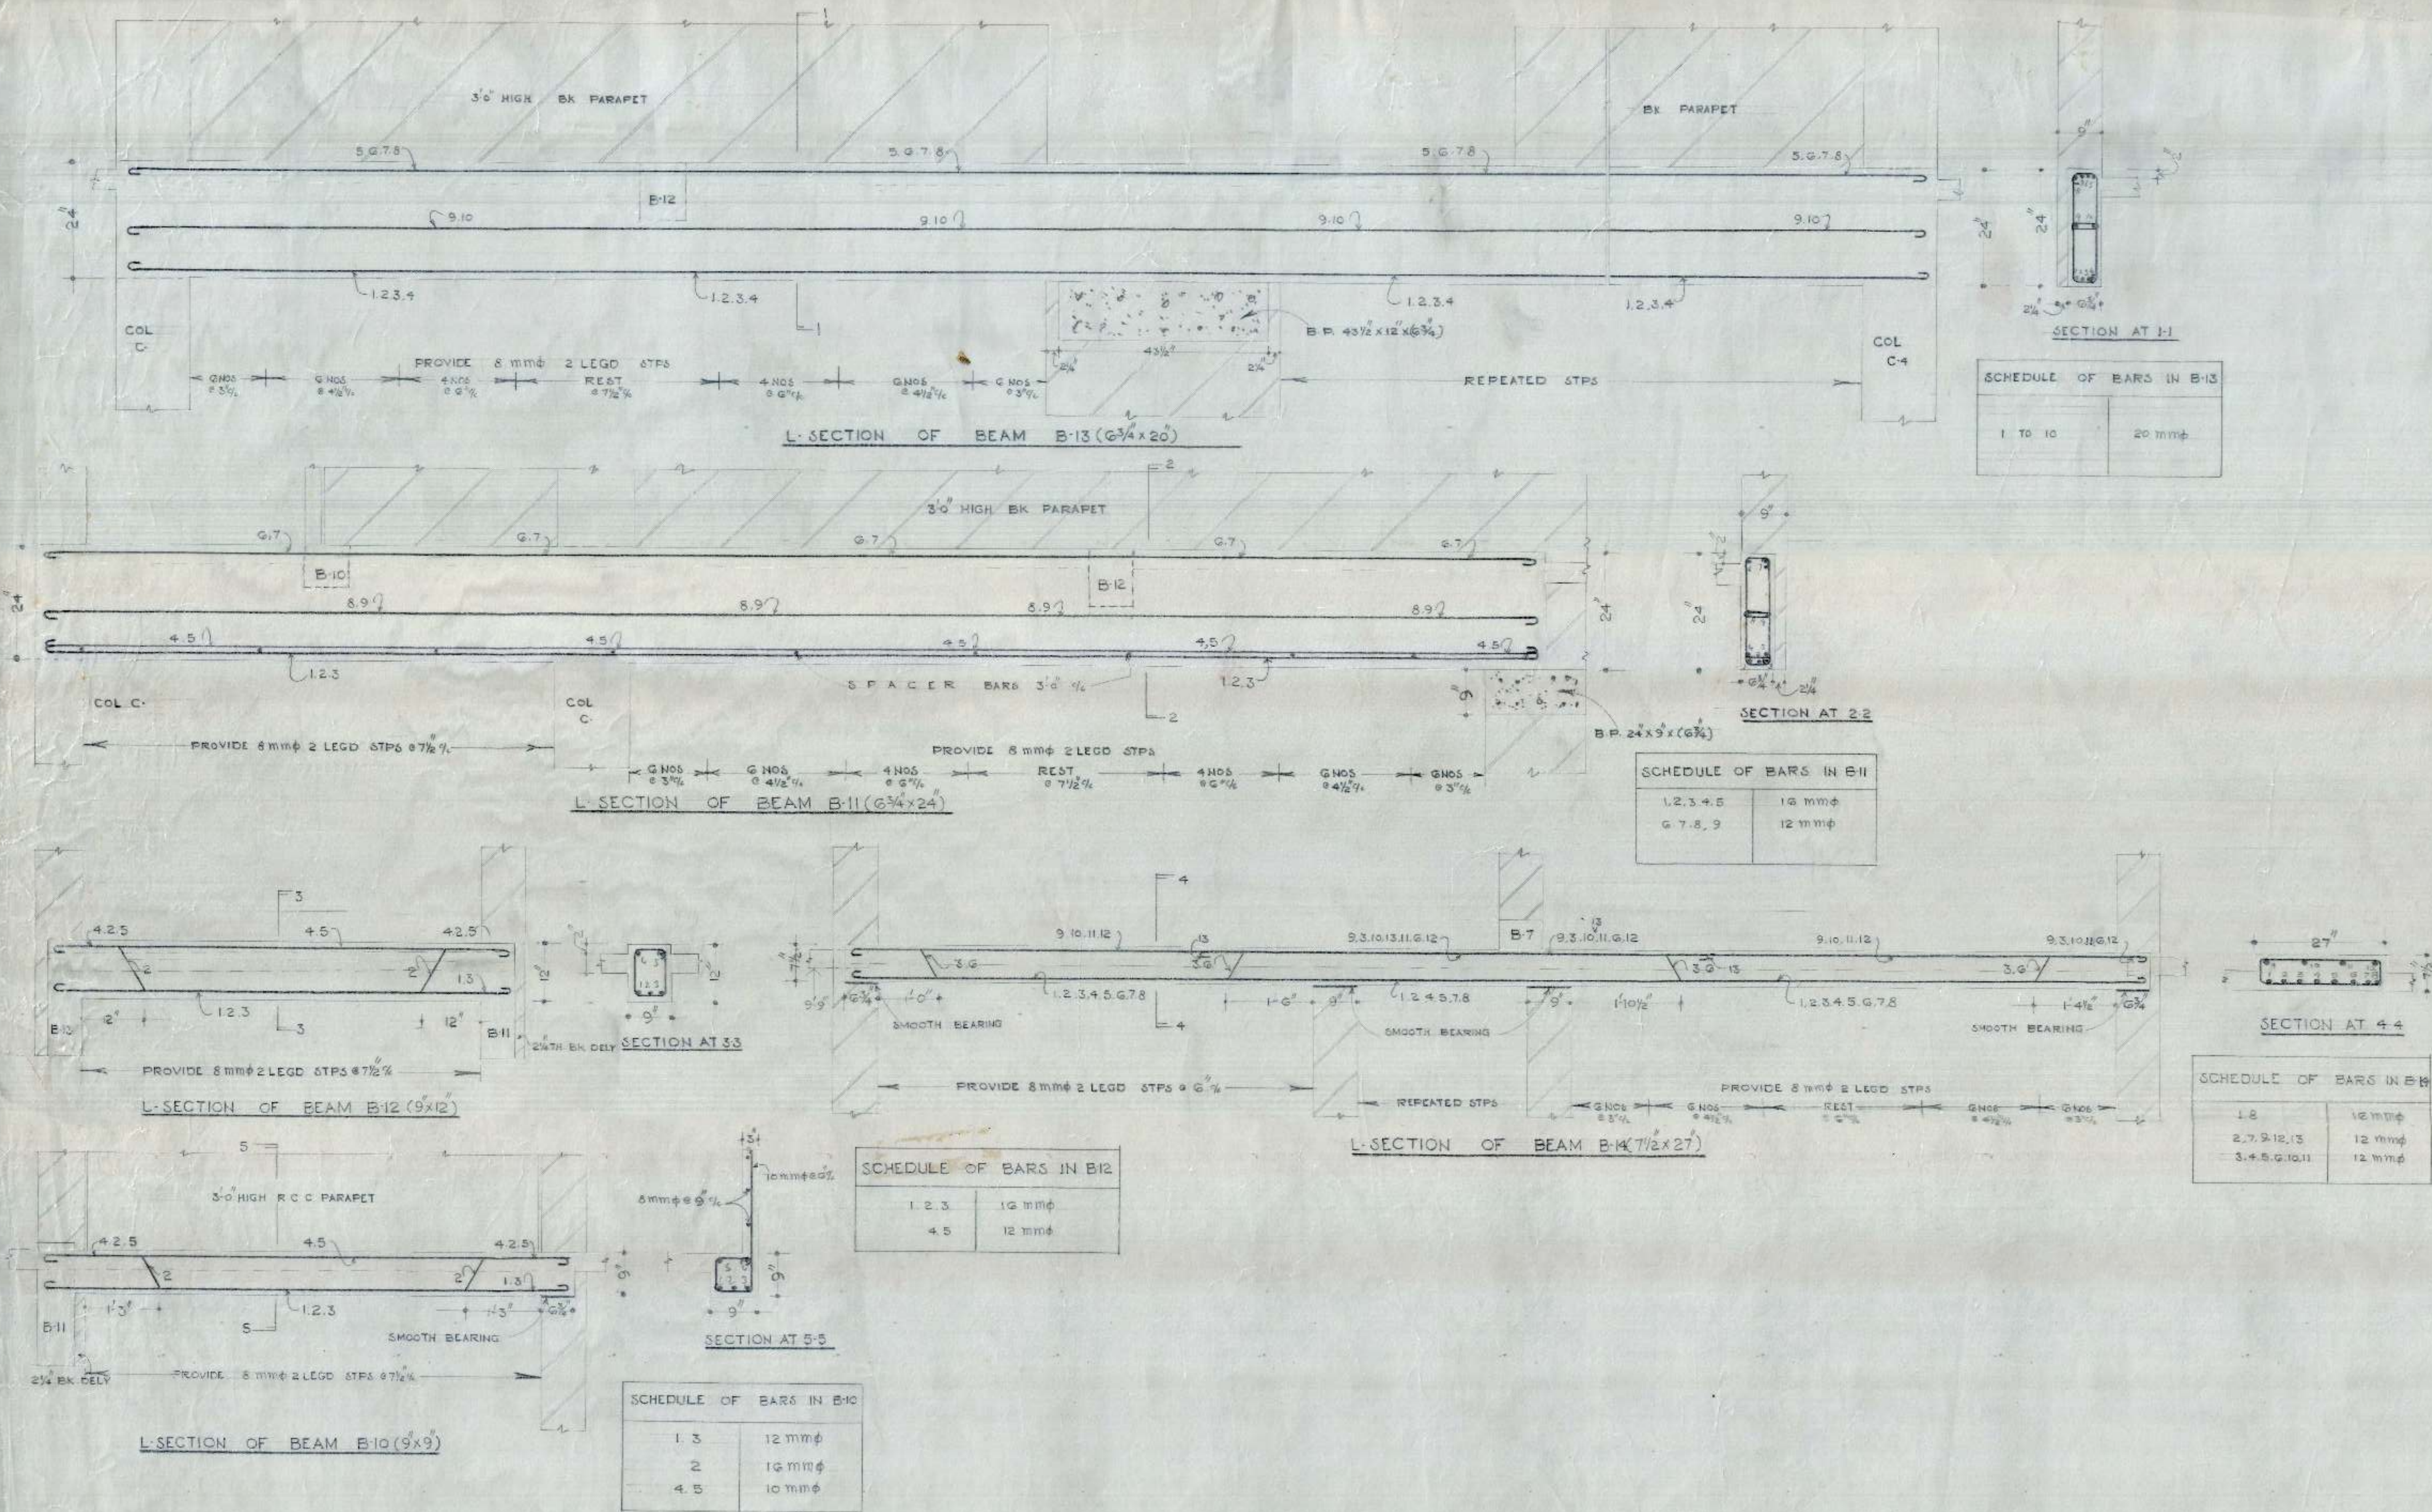

- S.No. NOTES
- FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG NO. 41 JOB NO. 79
 - FOR OTHER NOTES & REFERENCES REFER ST. DRG NO. 2 JOB NO. 40

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

DRN BY	MIG TWO ROOM	DRG NO
		5
SCALE	DETAIL OF REINFORCEMENT IN BEAMS AT G.F.	JOB NO
		40
A.E.D.	15/11/85	SEHE

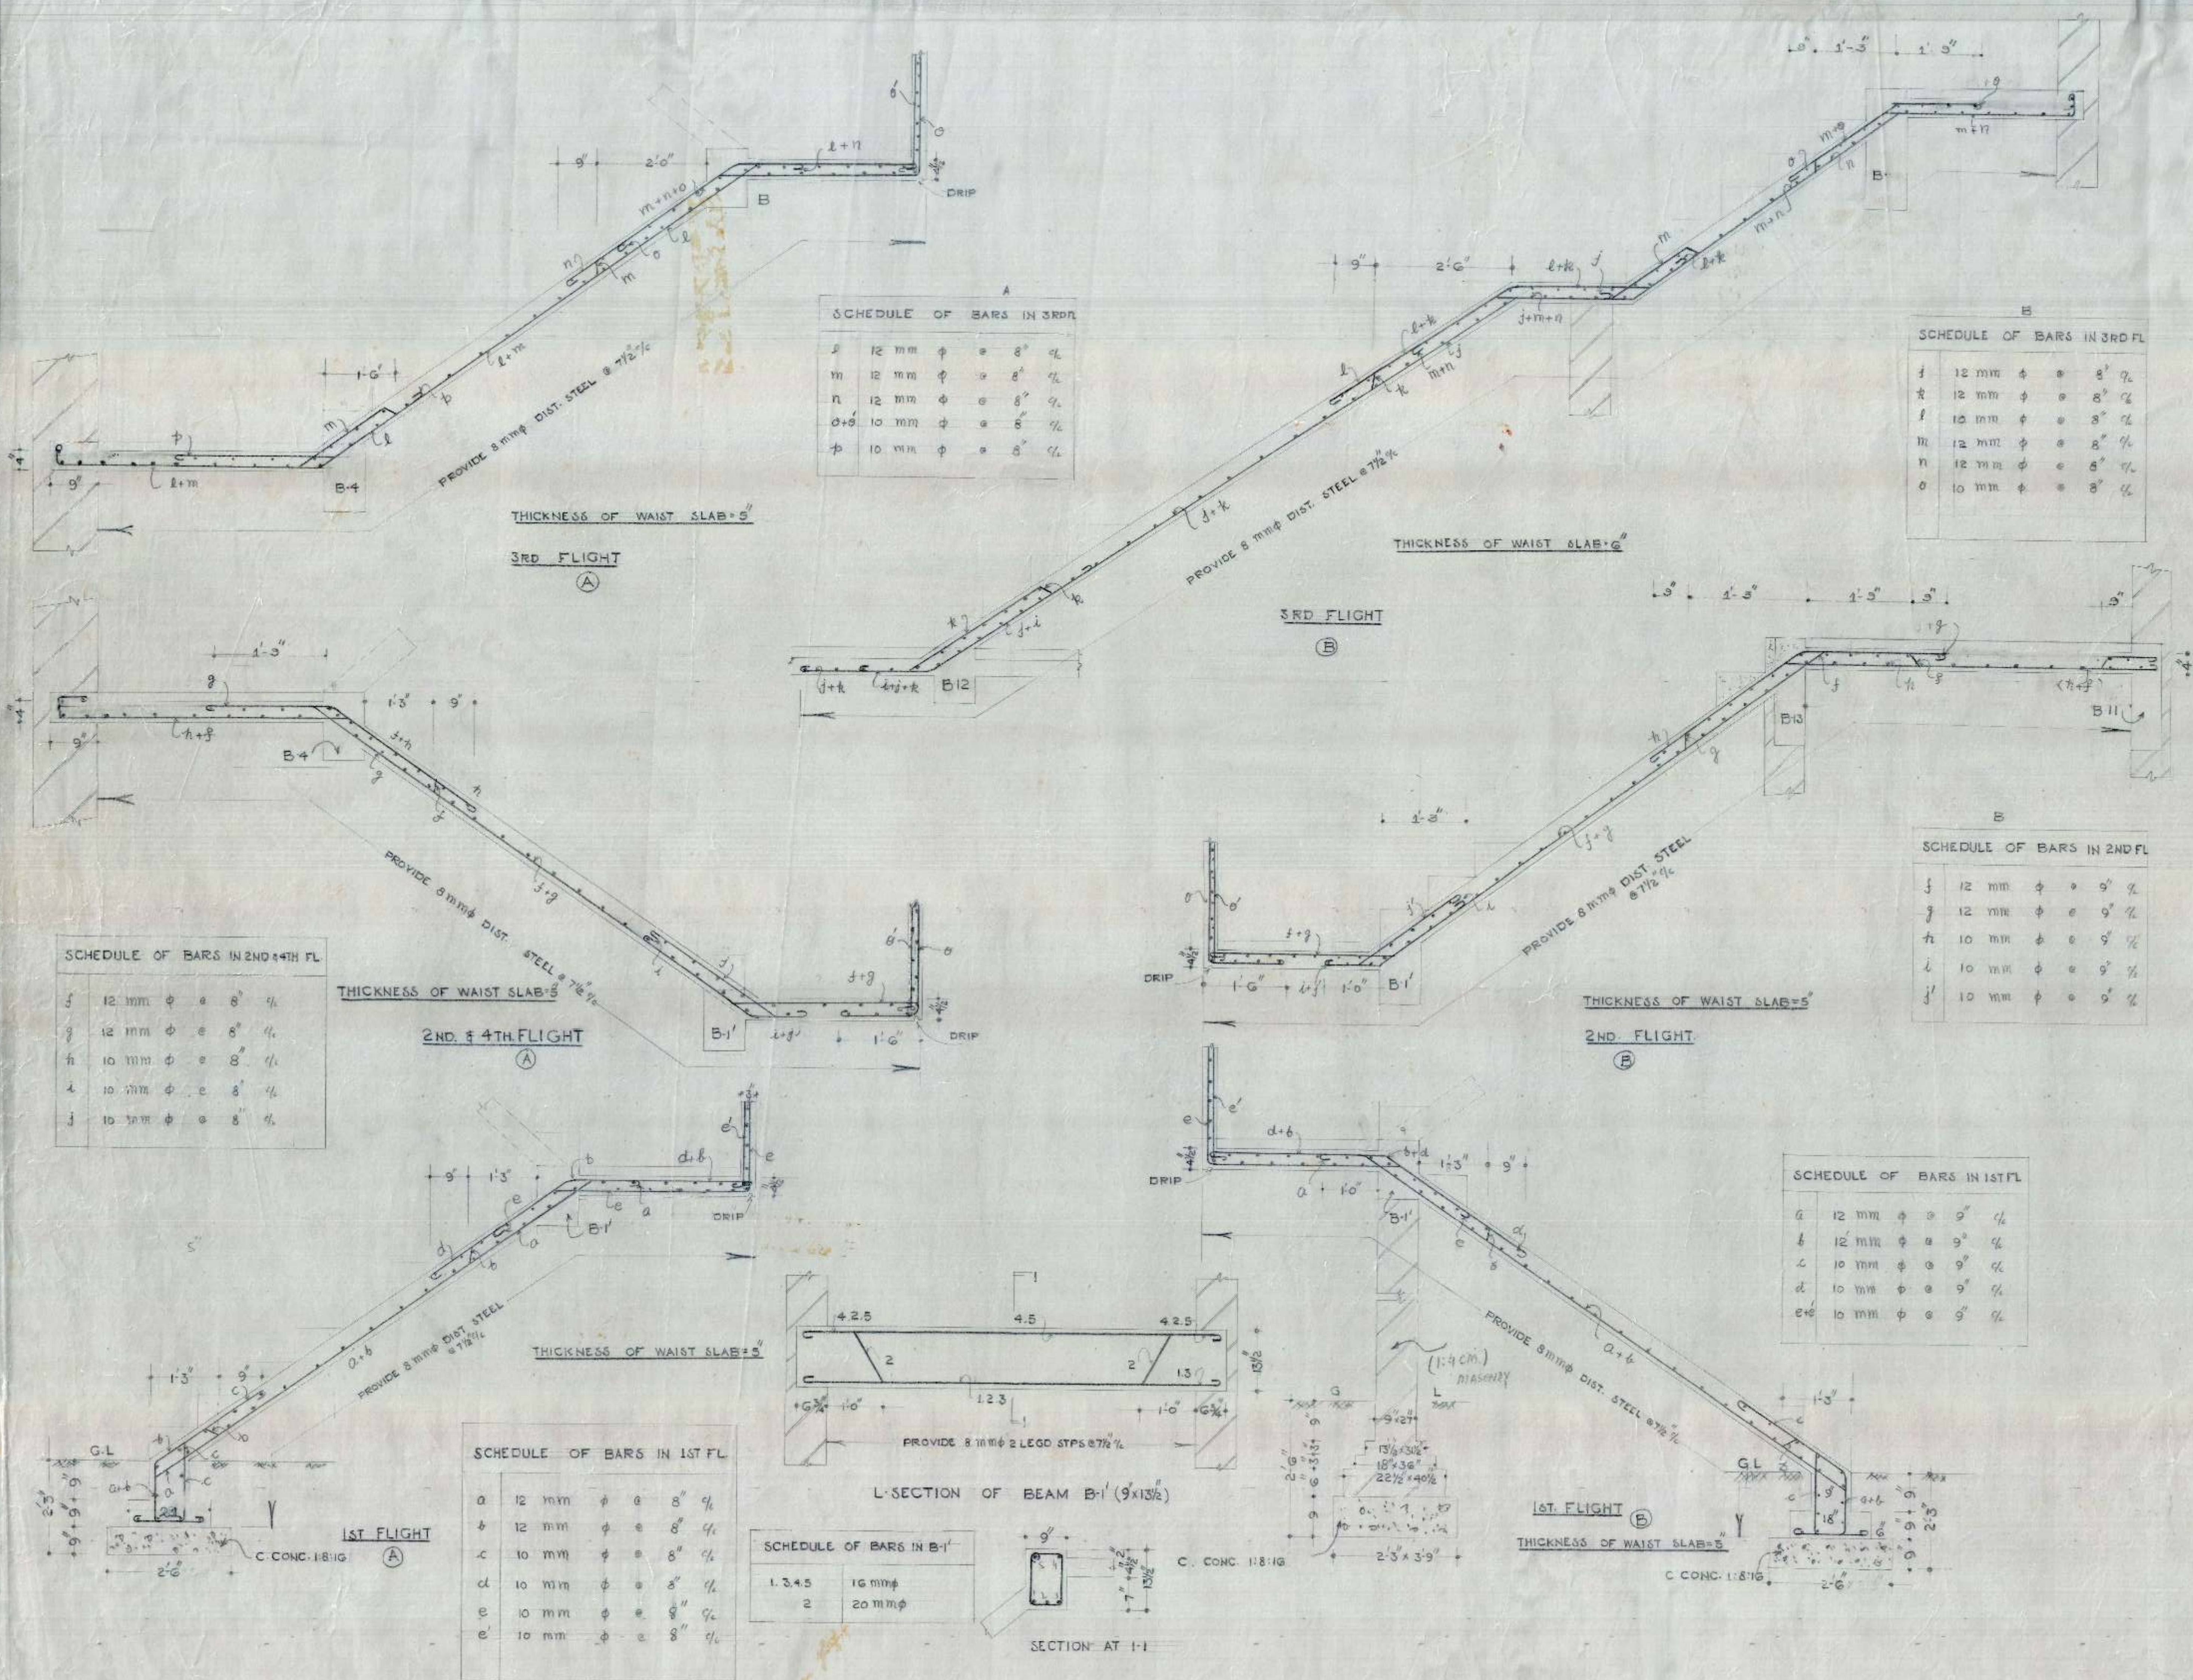

S.No.

1. F.








2. FOR

REF.

S/45-D

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH		
SCALE	M.I.G TWO ROOM	DRG NO 6
SCALE	DETAIL OF REINFORCEMENT IN STAIR WAIST SLAB	JOB NO 40
DATE 22/11/95 A.E.D	DATE 22/11/95 E.C.I	DATE 22/11/95 S.E.N.B

CH

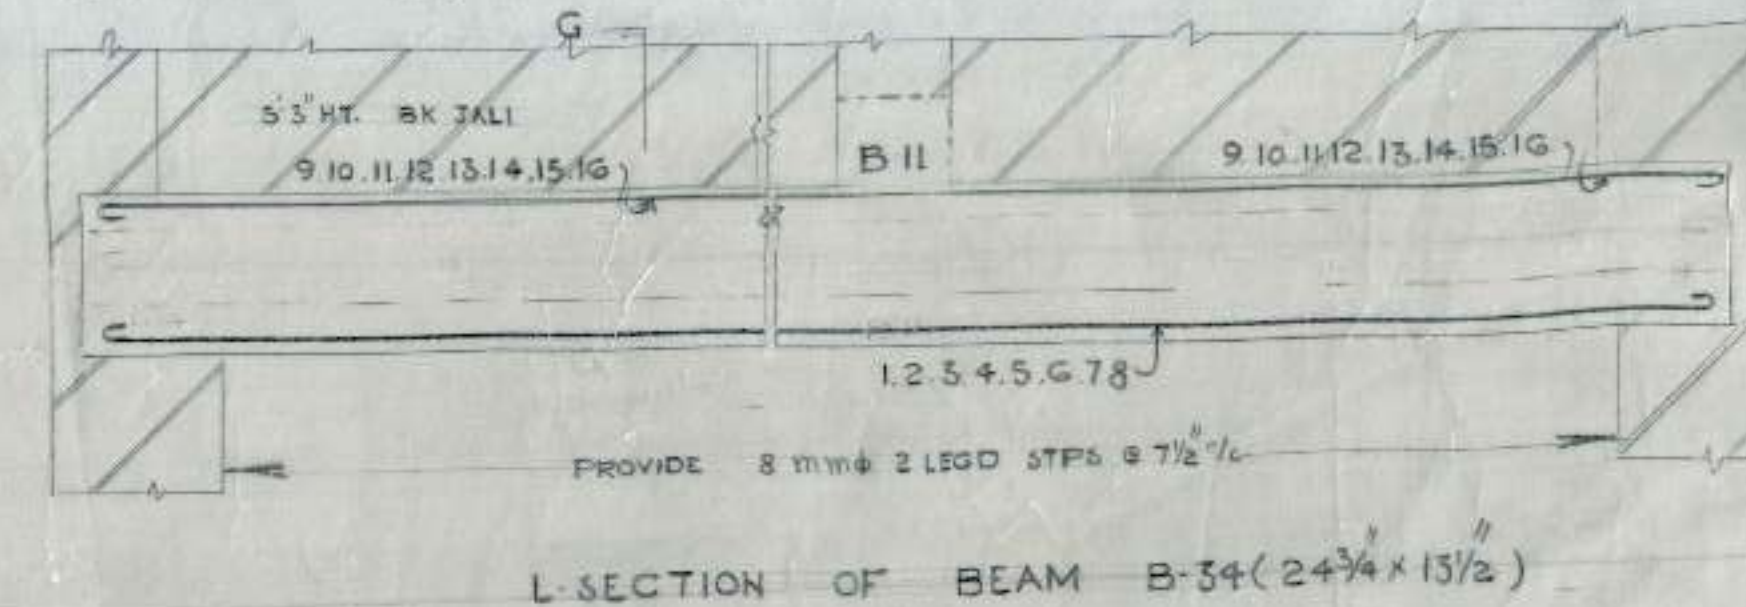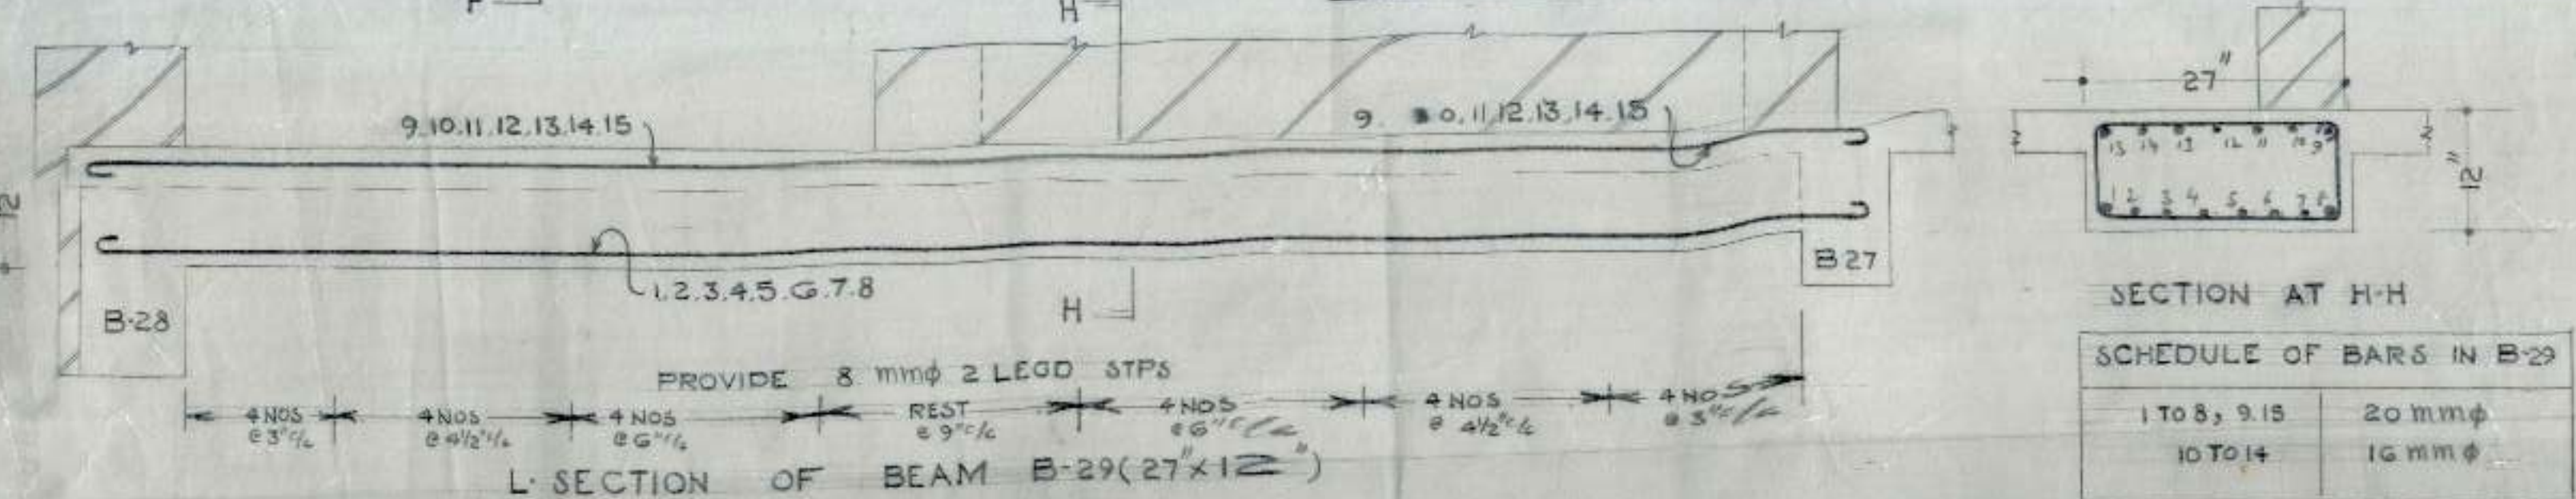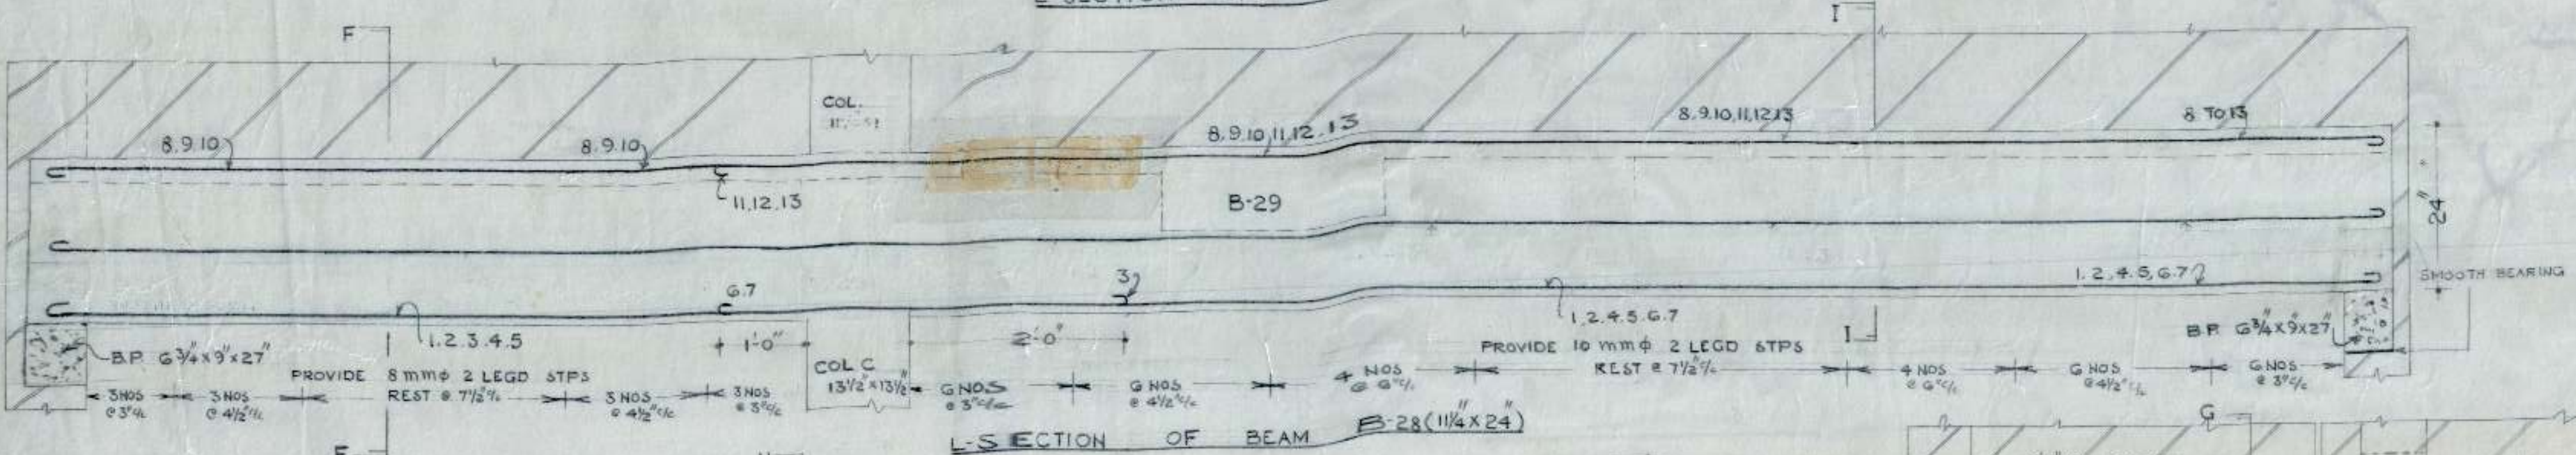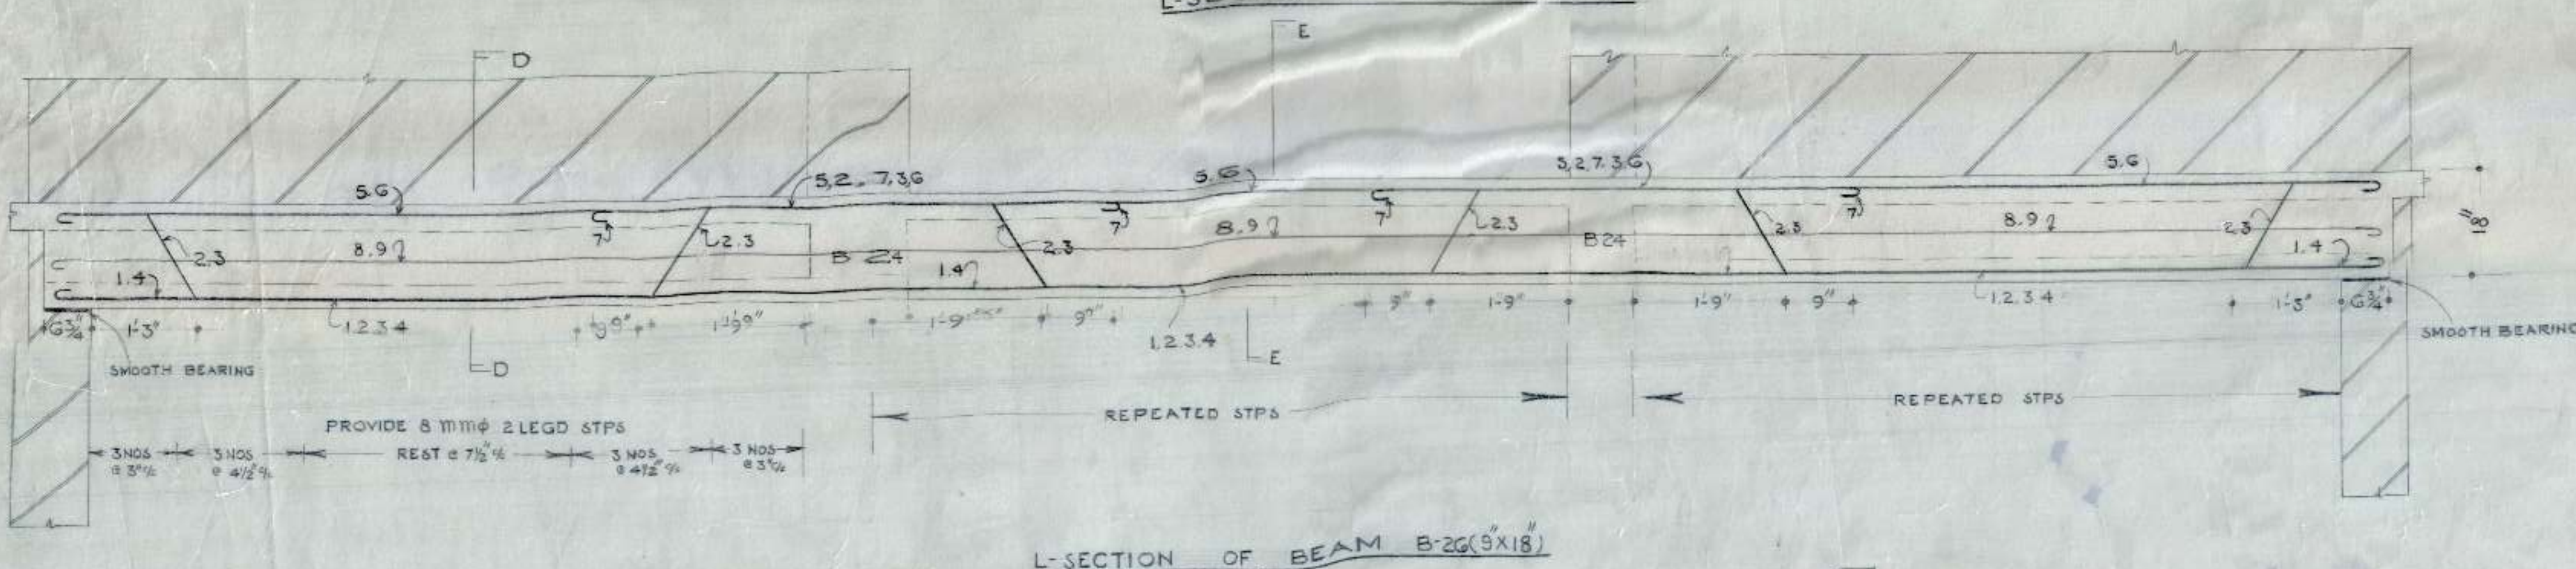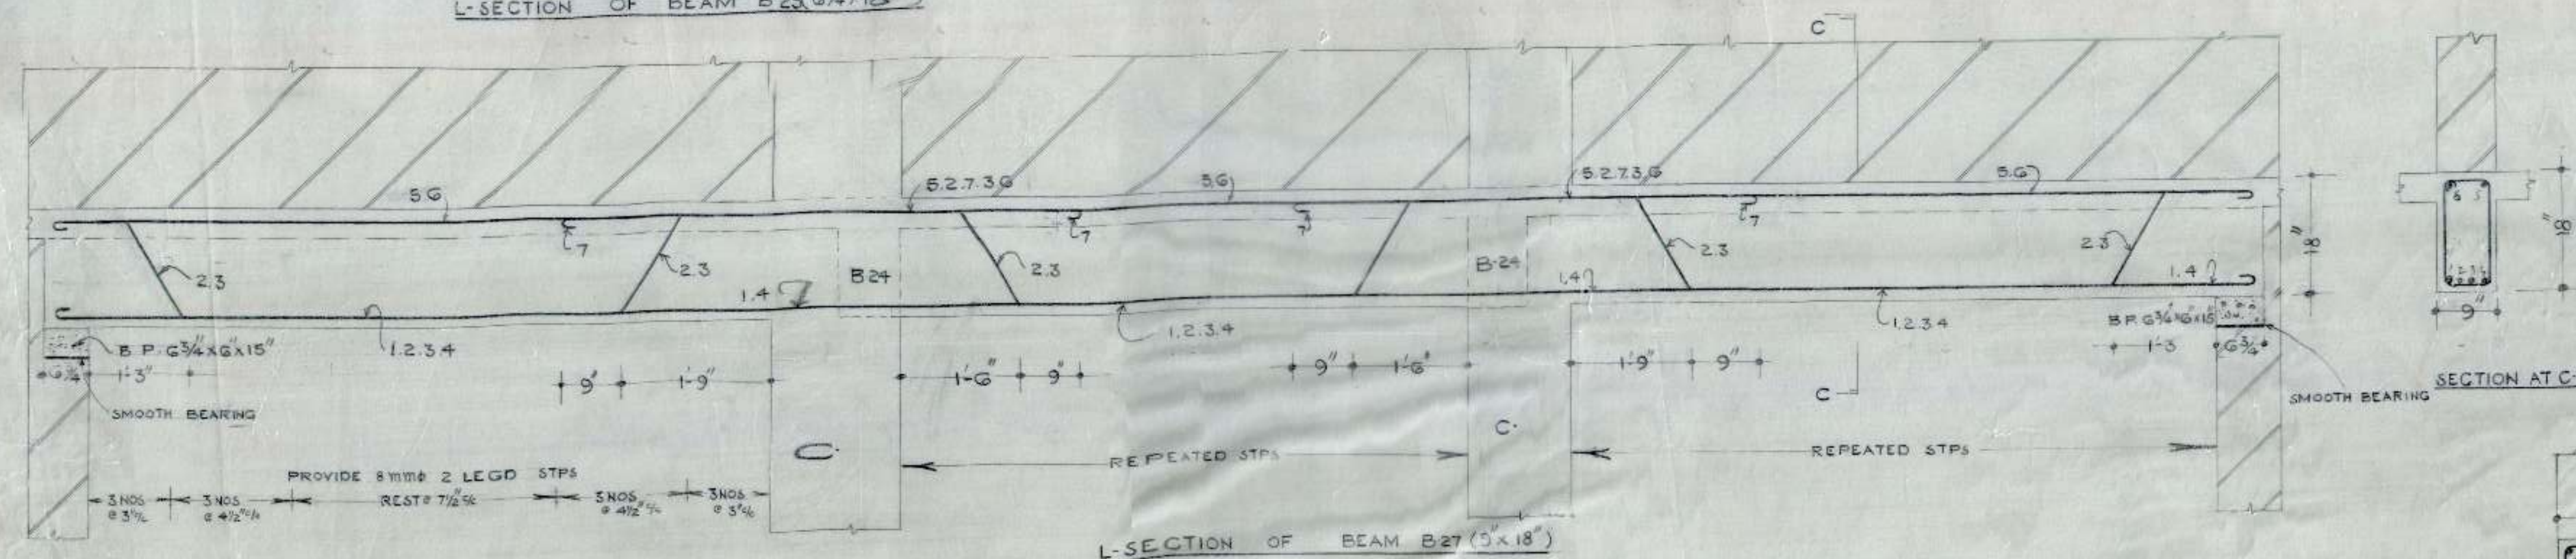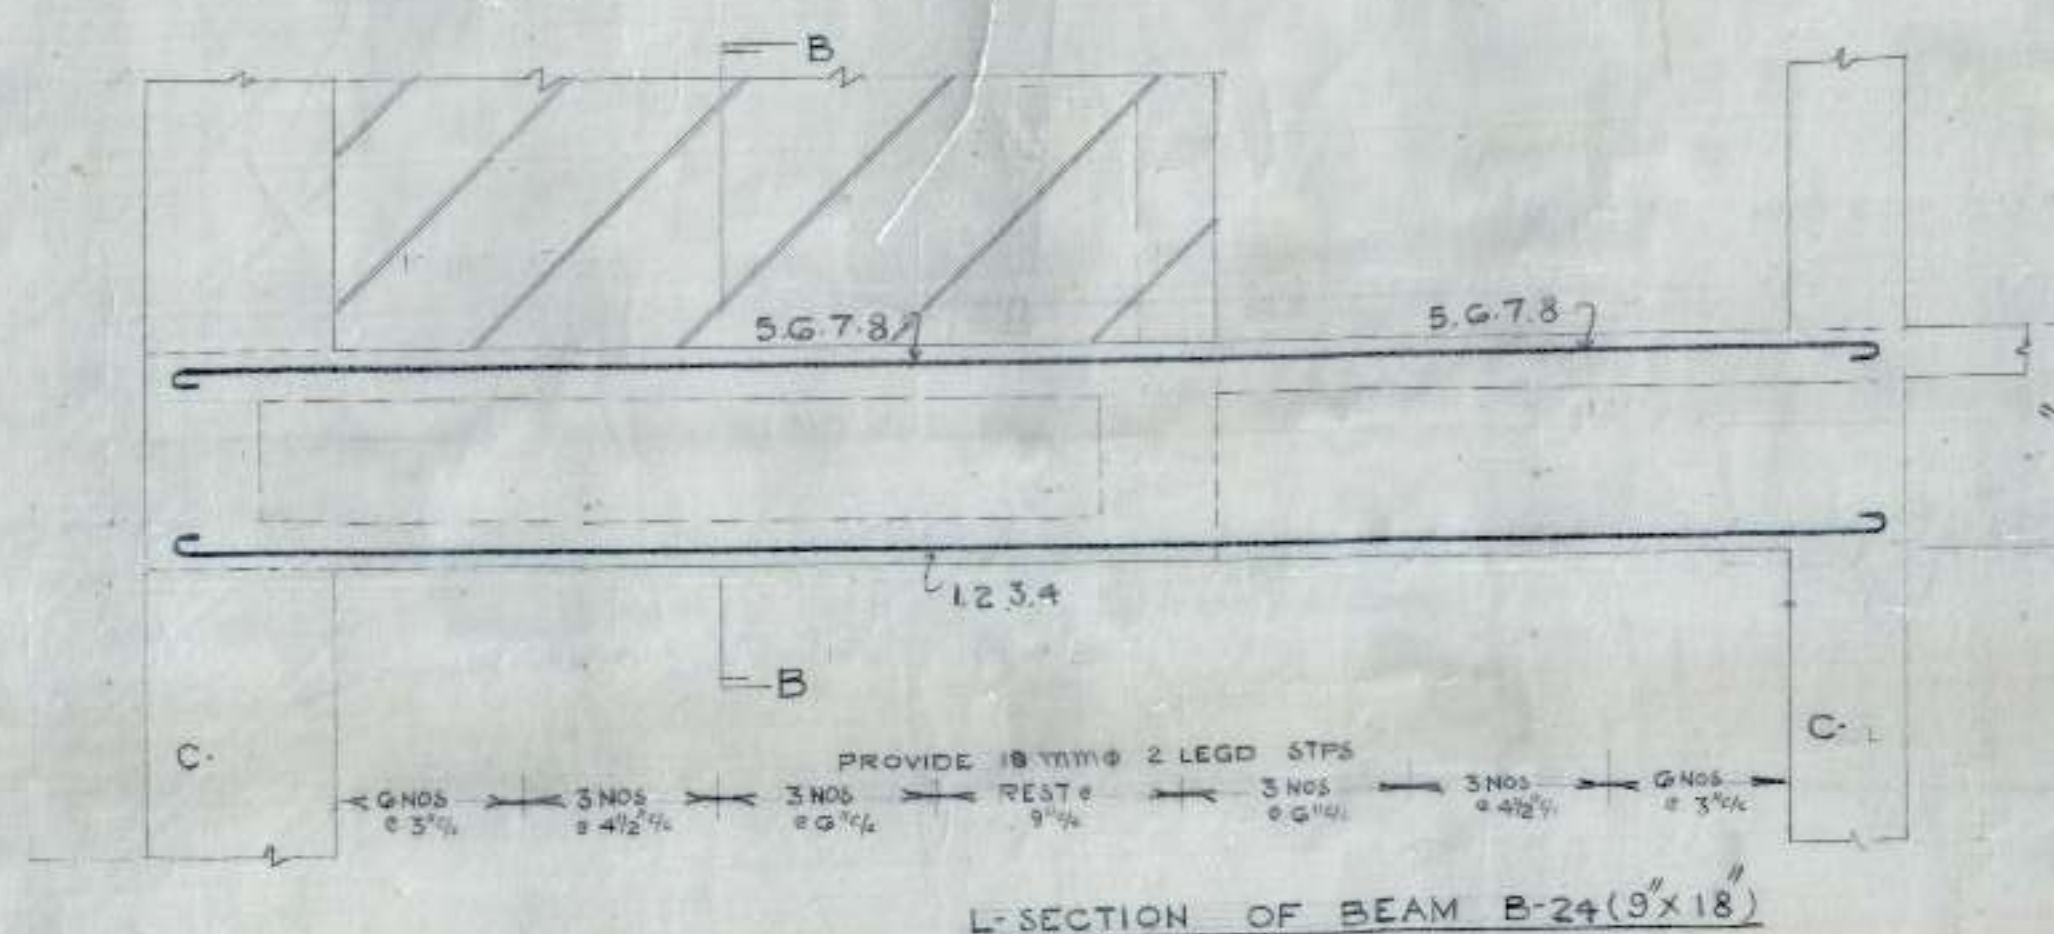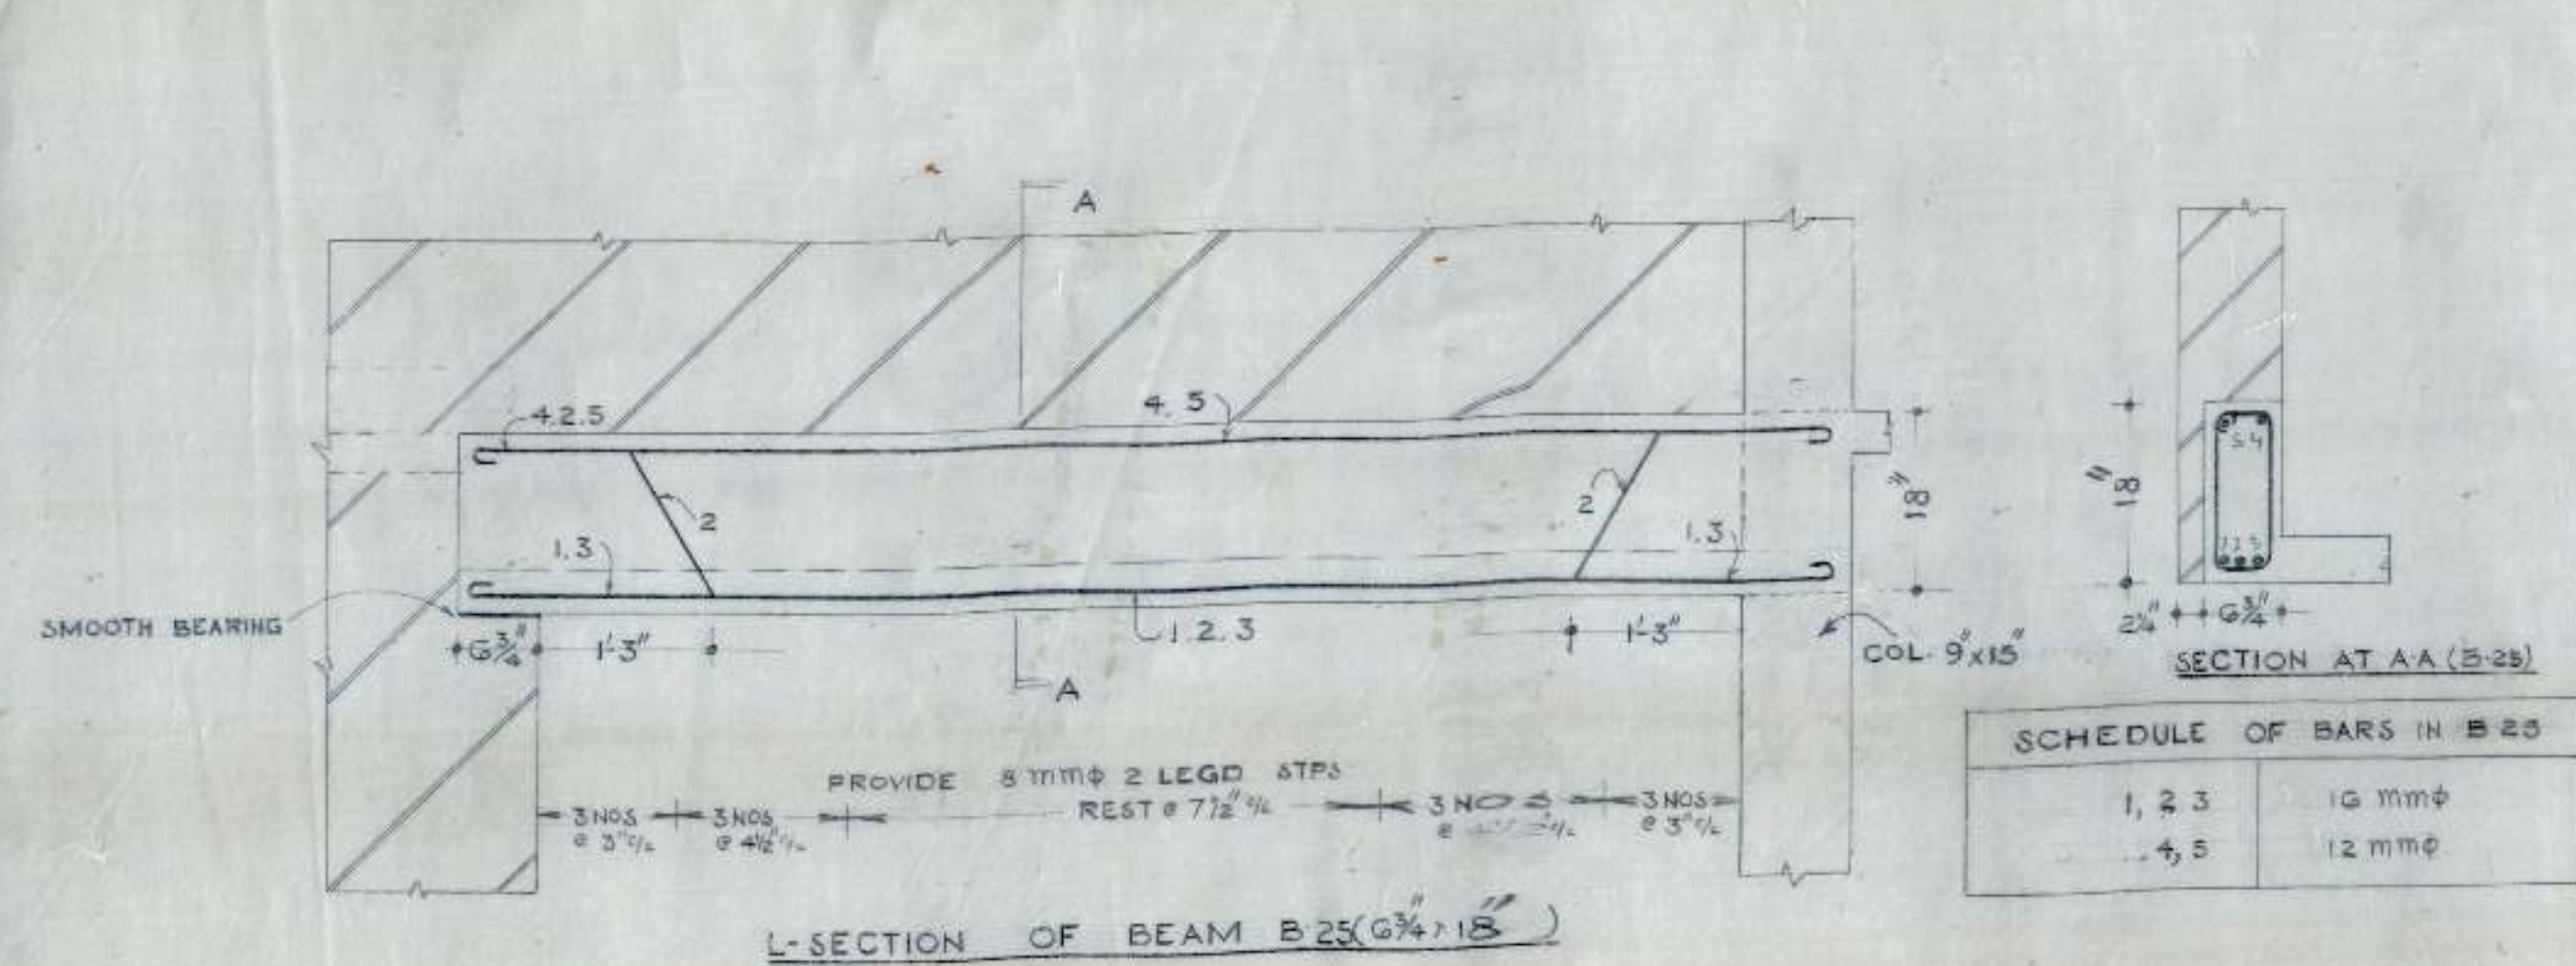

SCHEDULE OF BARS IN B-28

3	10 mmφ
1, 2, 4 TO 13	20 mmφ

SCHEDULE OF BARS IN B-28

3	10 mmφ
1, 2, 4 TO 13	20 mmφ

SCHEDULE OF BARS IN B-34



1 TO 16	20 mmφ
---------	--------

NOTES

- FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG. NO. JOB NO.
- FOR OTHER NOTES & REFERENCES REFER STR. DRG. NO. JOB NO.



OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH		
DRN BY SCALE 3/4" = 1'-0"	M.I.G TWO ROOM DETAIL OF REINFORCEMENT IN BEAMS & LINTELS AT F. FLOOR	DRG. NO. 7 JOB NO. 43 S.E. NO.

CHB

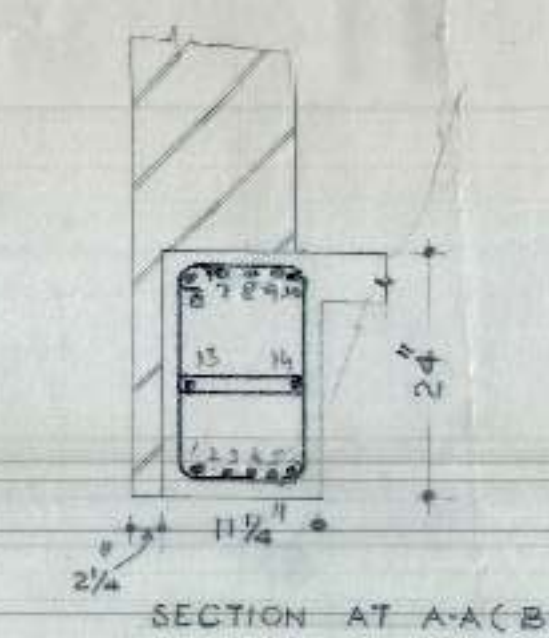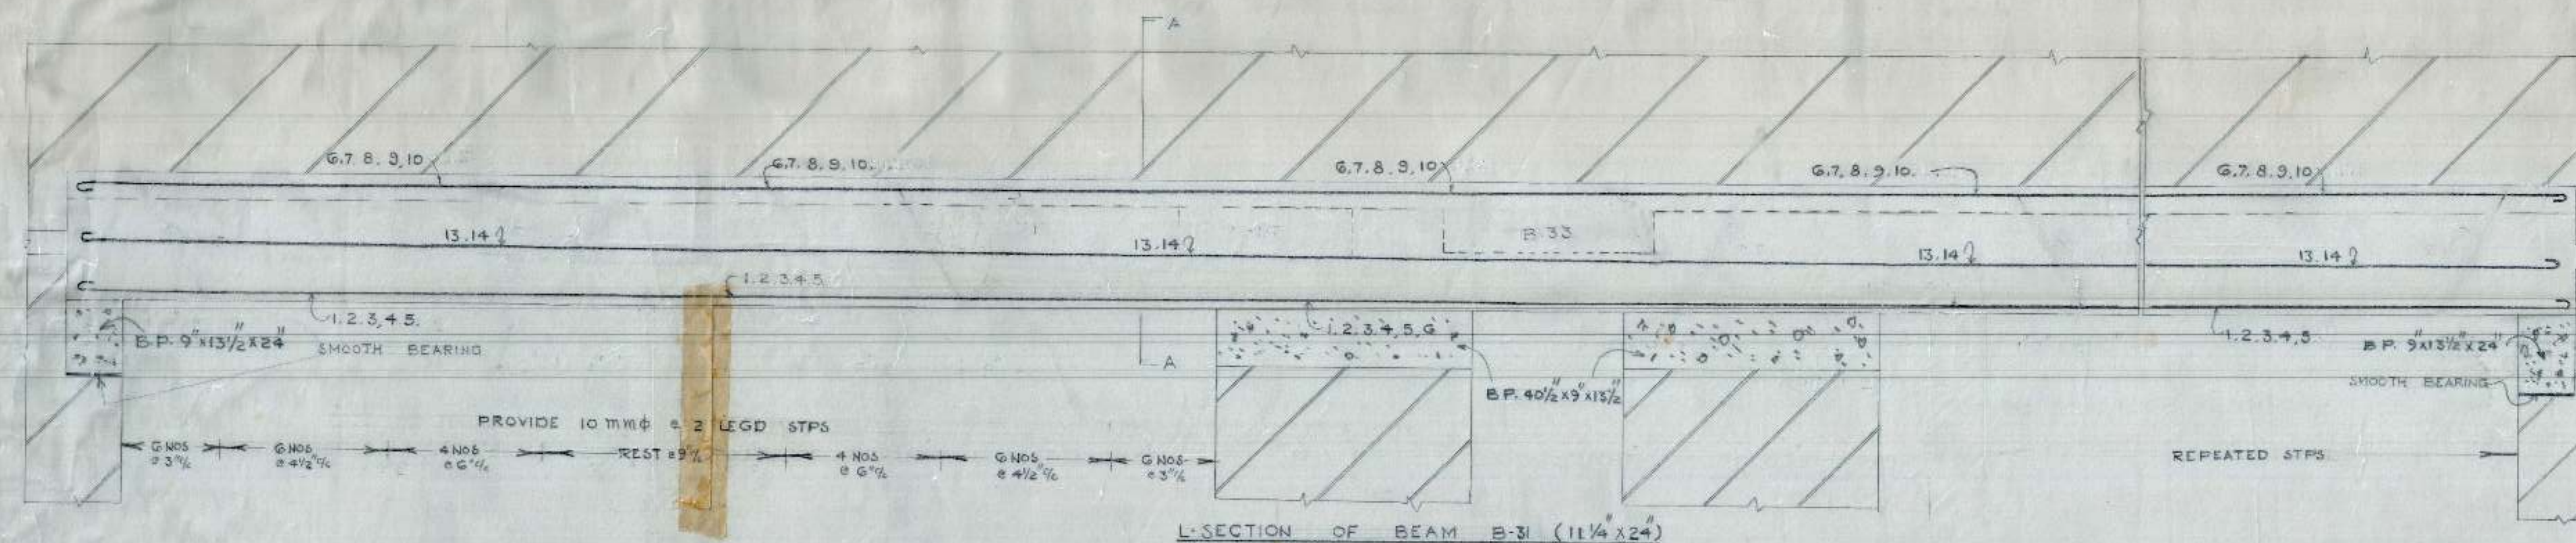



SCHEDULE OF BARS IN B-31

1, 2, 3, 4, 5	10 mmφ
6, 7, 8, 9, 10	20 mmφ

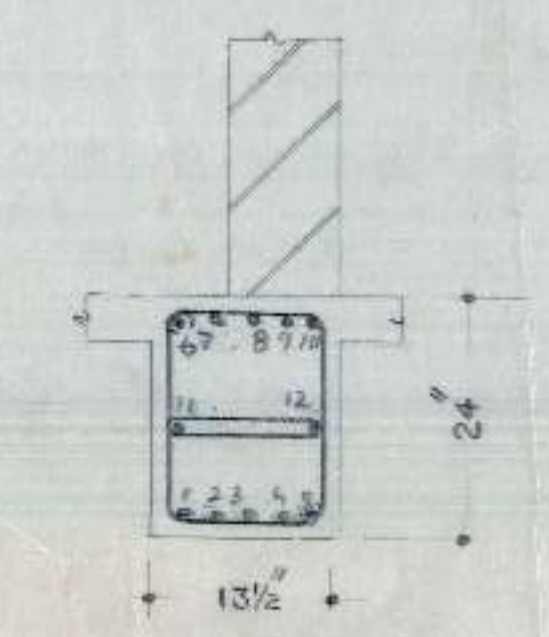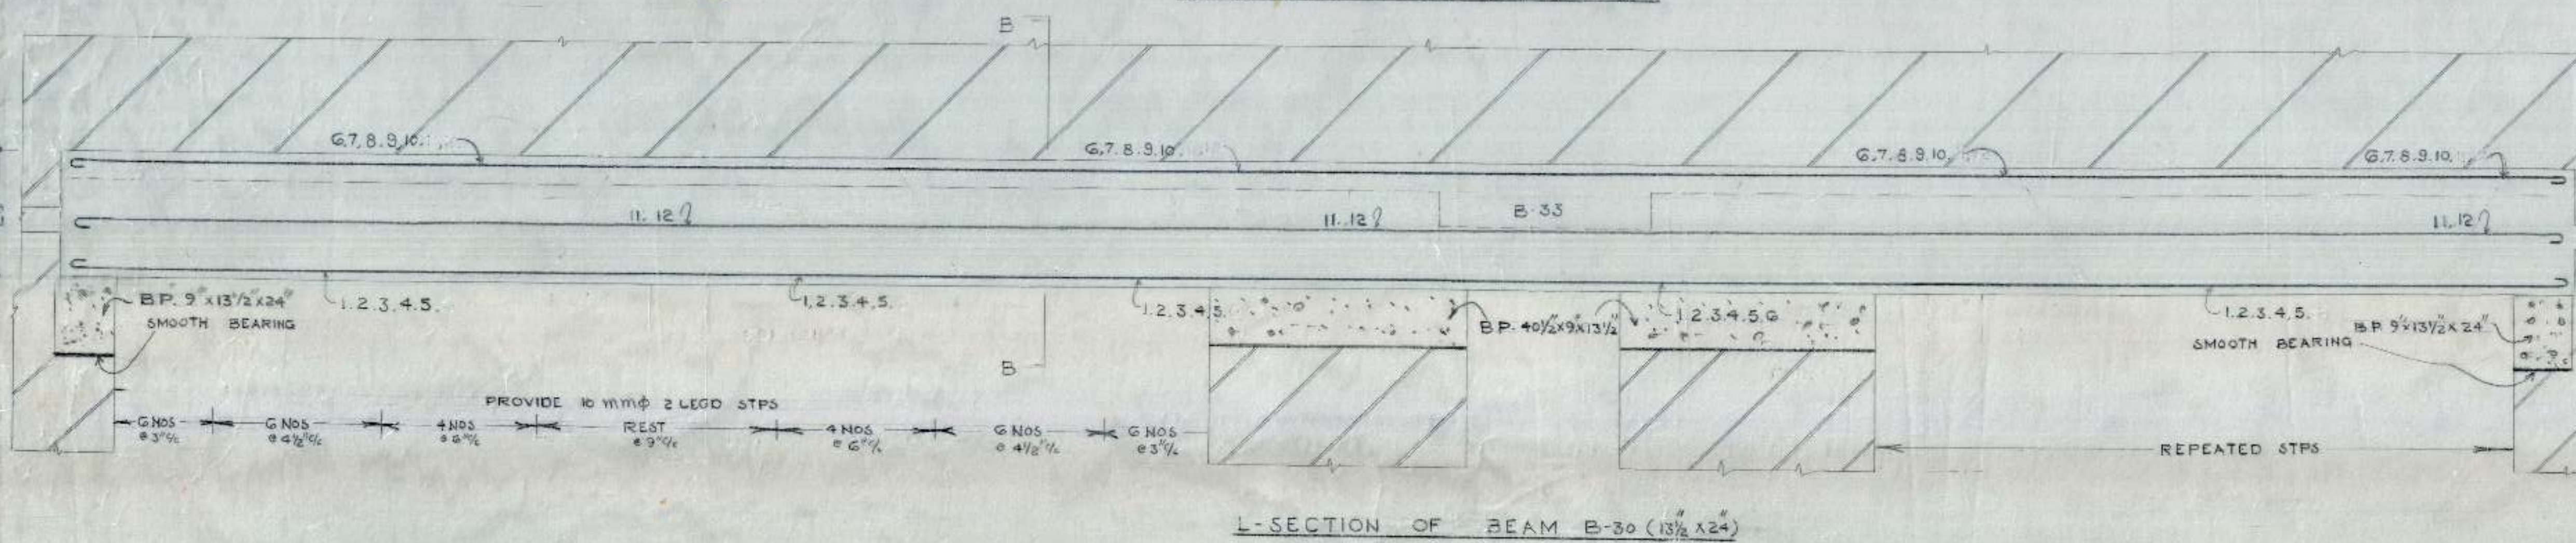



SCHEDULE OF BARS IN B-30

1, 2, 3, 4, 5	20 mmφ
6, 7, 8, 9, 10	10 mmφ

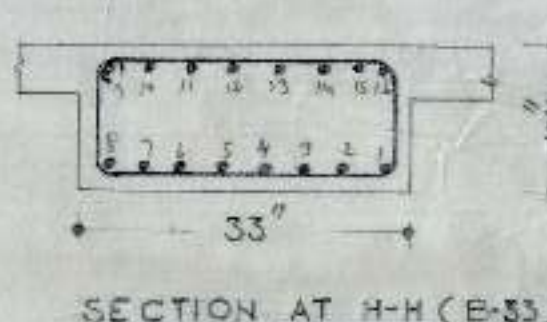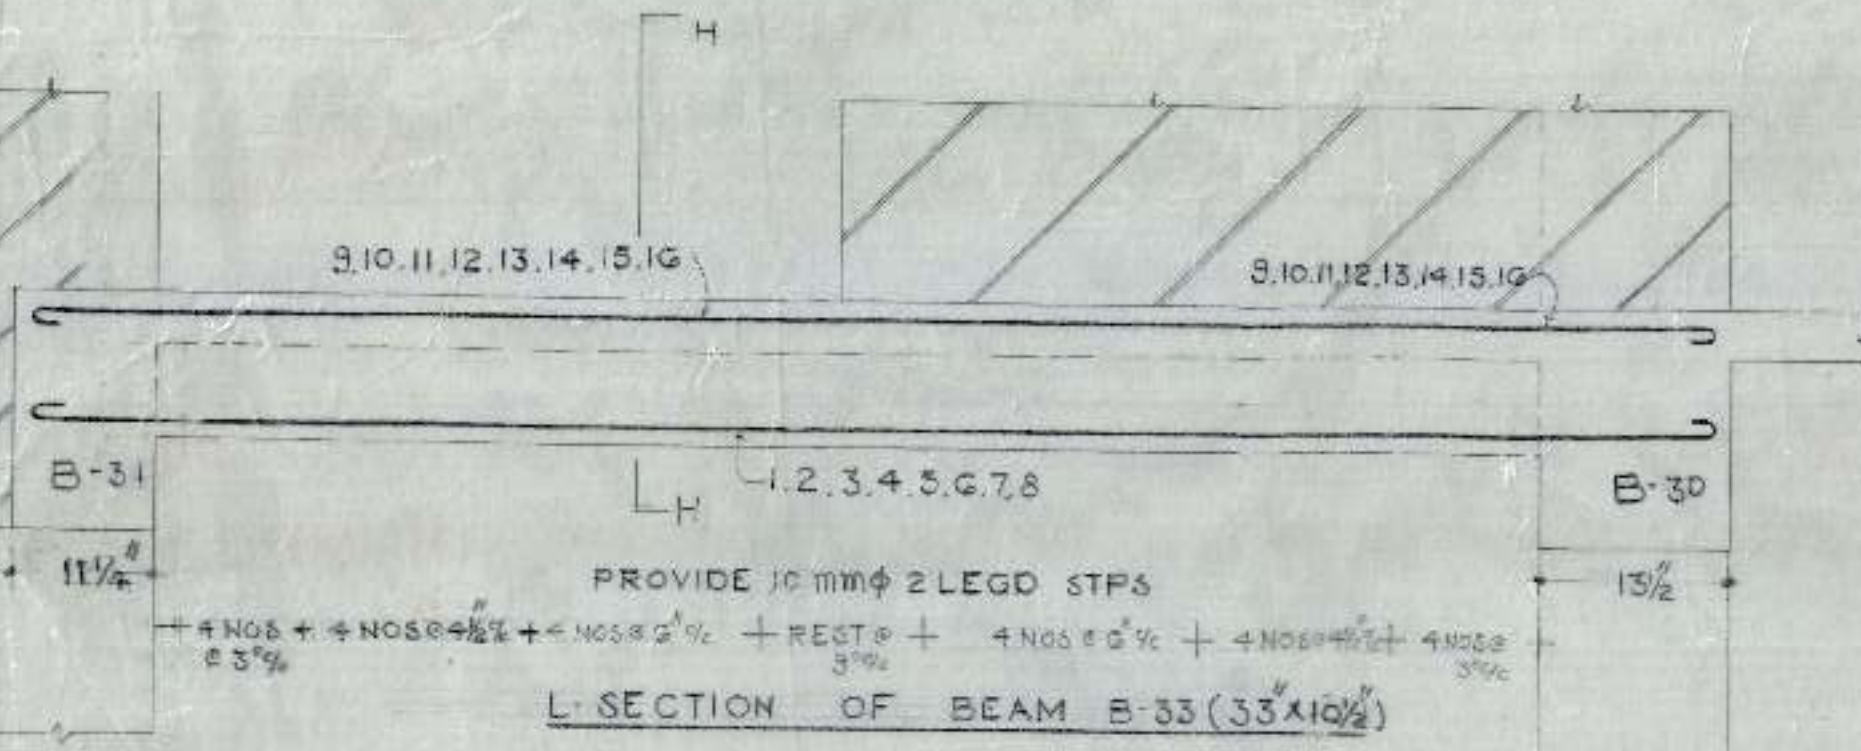



SCHEDULE OF BARS IN B-33

1, 2, 3, 4, 5, 6, 7, 8	20 mmφ
9, 10, 11, 12, 13, 14, 15, 16	10 mmφ

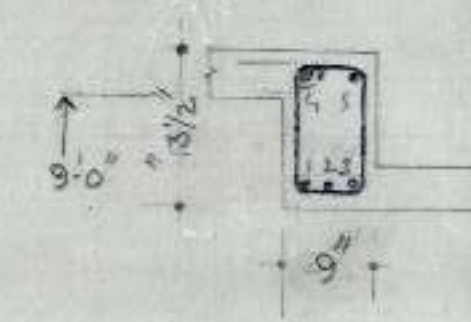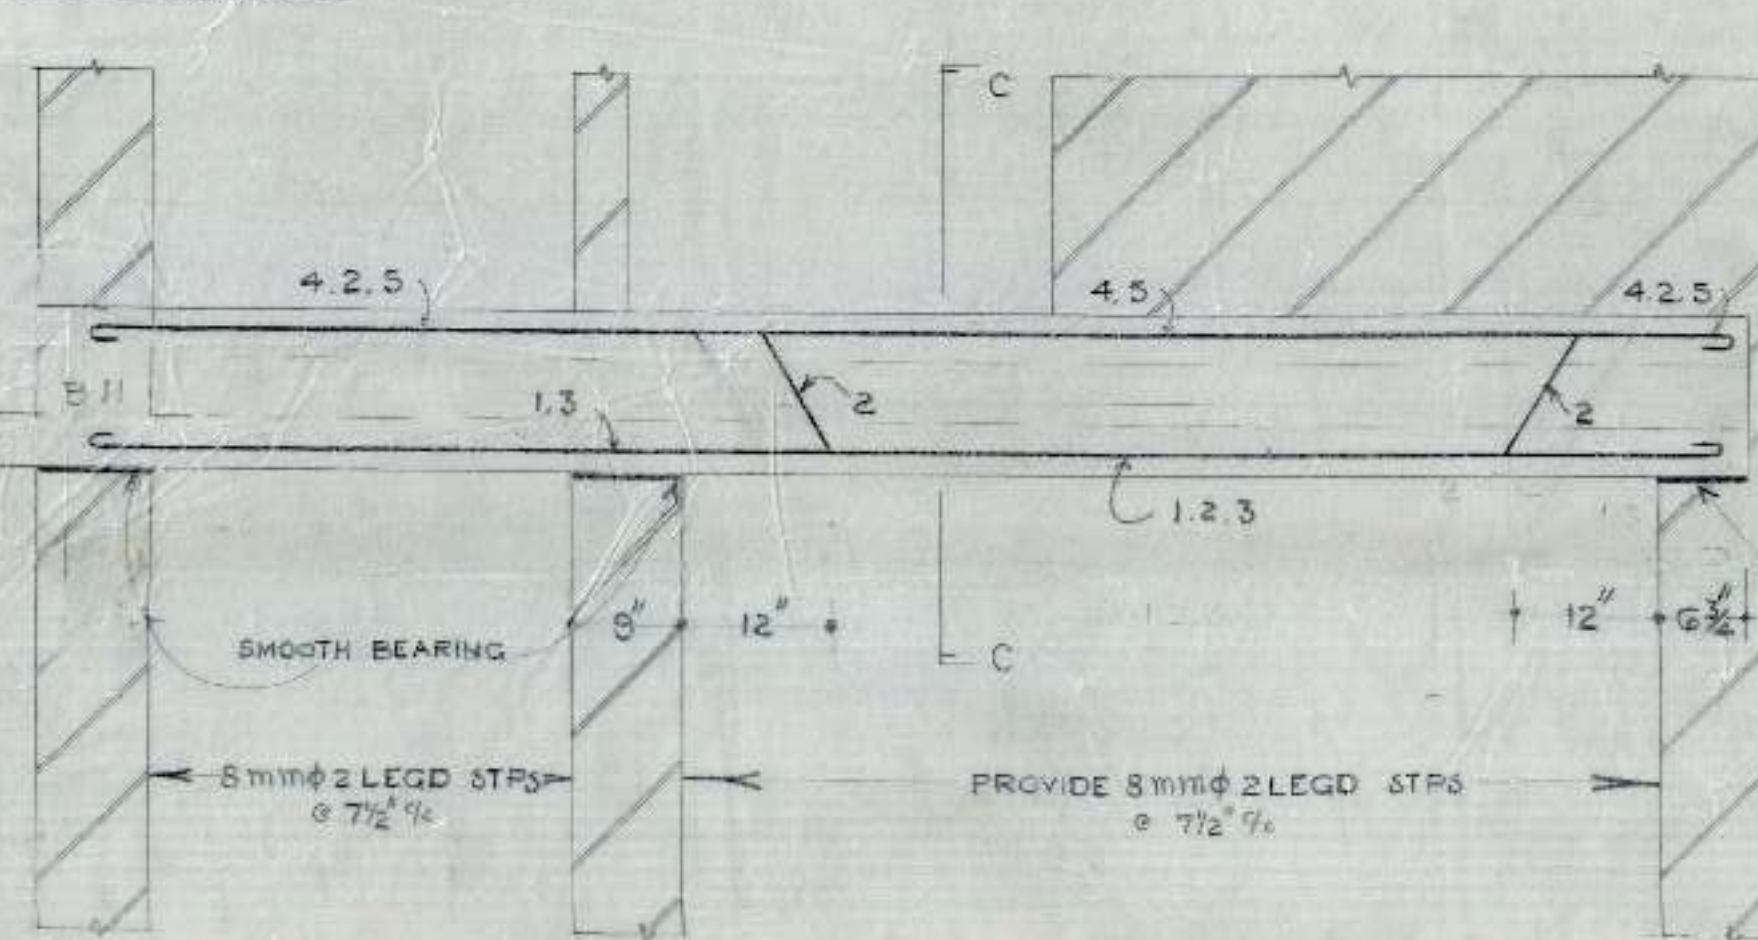



SCHEDULE OF BARS IN B-12

1, 3	20 mmφ
2, 4, 5	10 mmφ

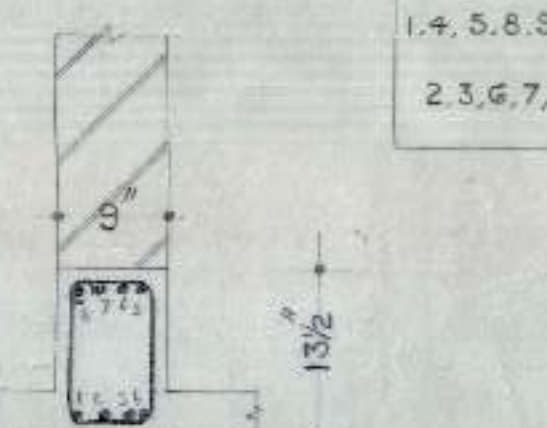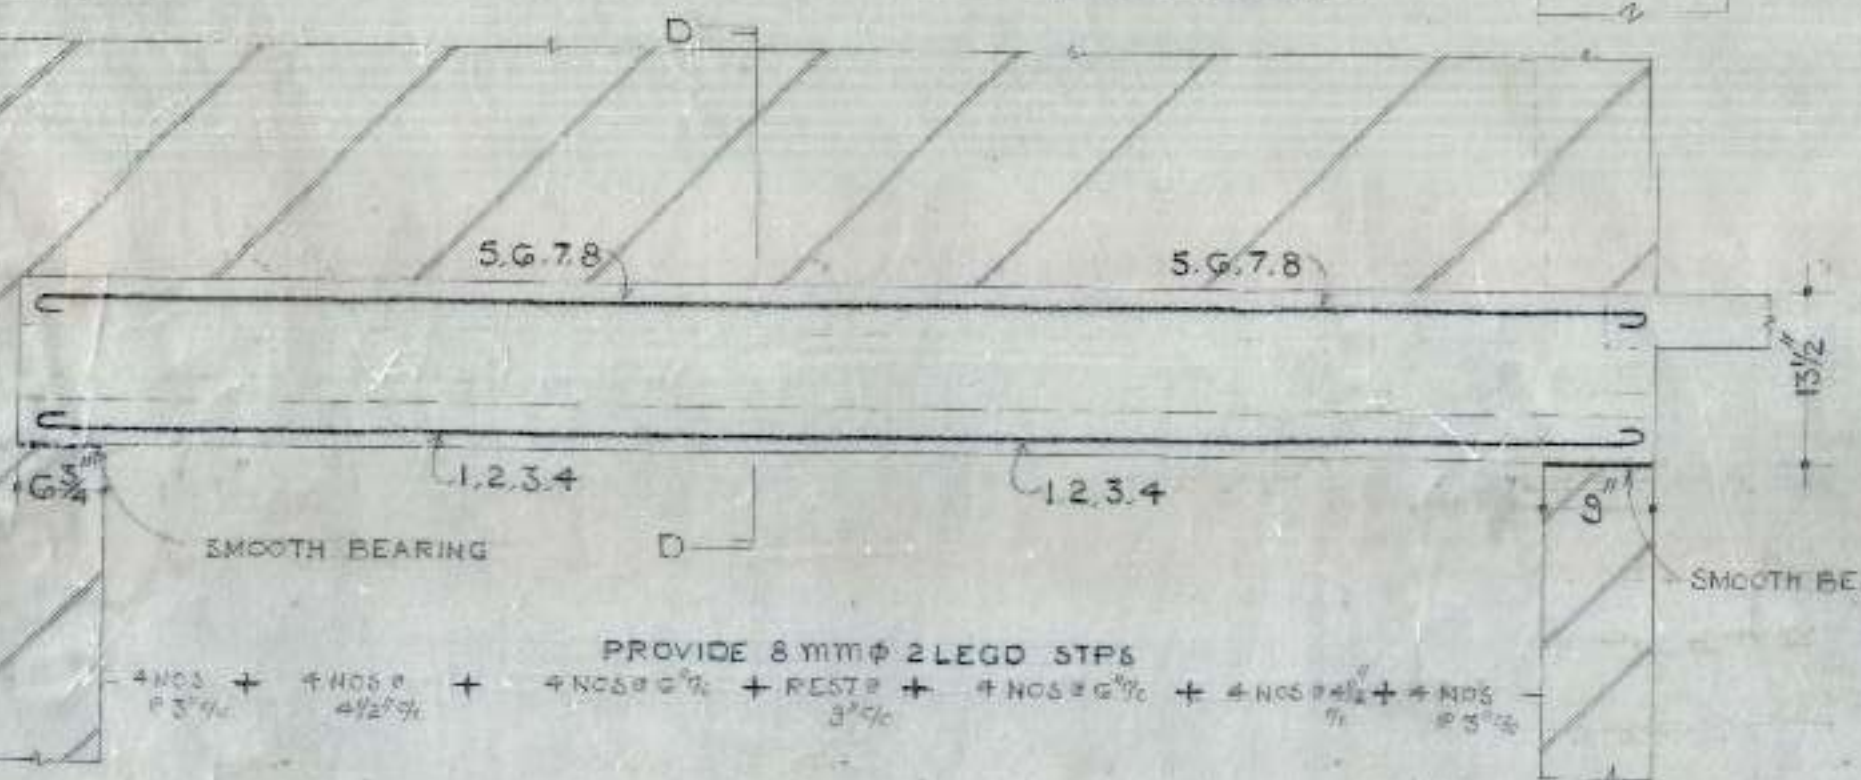



SCHEDULE OF BARS IN B-32

1, 2, 3, 4	20 mmφ
5, 6, 7, 8	20 mmφ

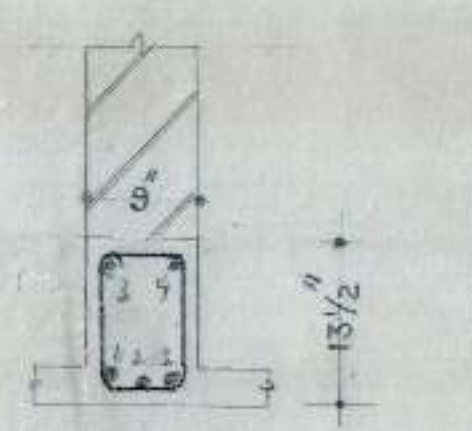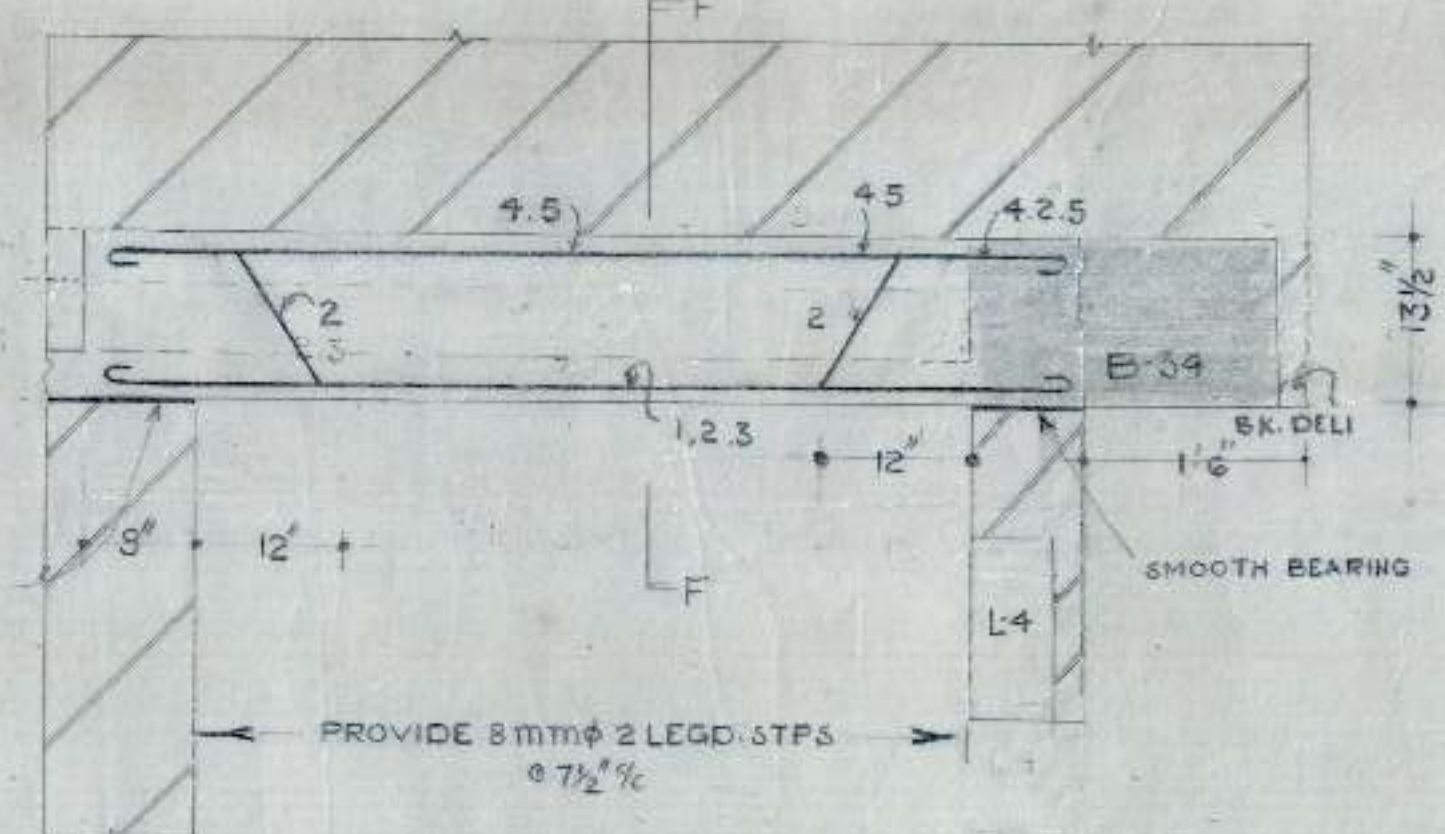

SCHEDULE OF BARS IN B-11

1, 2, 3	10 mmφ
4, 5	12 mmφ

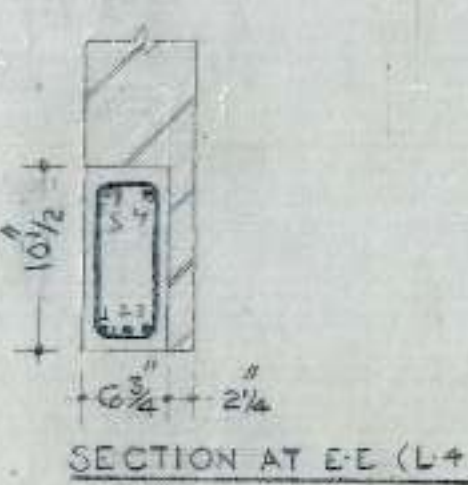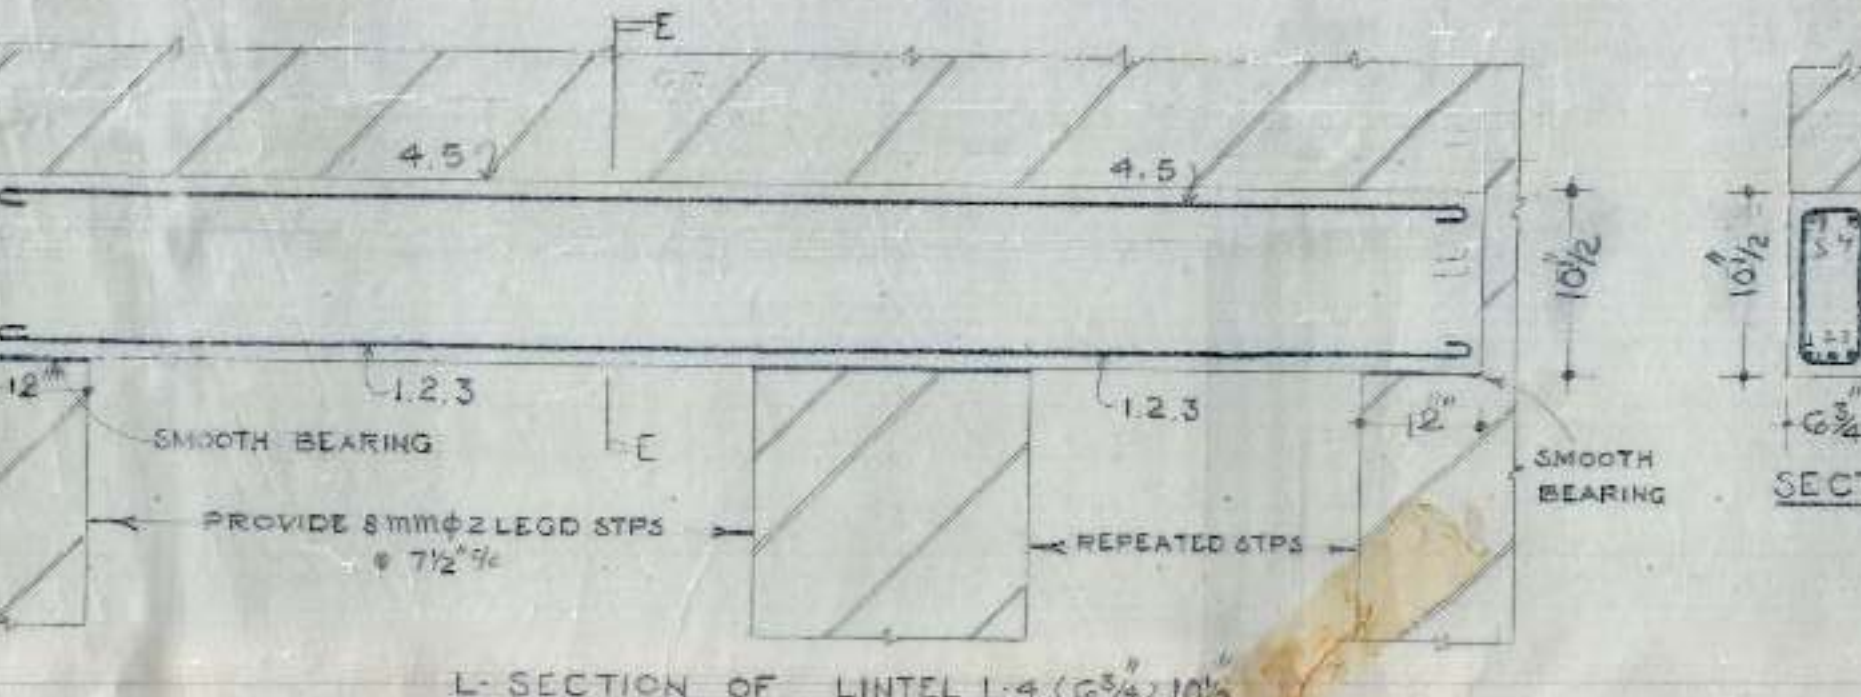

SCHEDULE OF BARS IN L-4


1, 2, 3	12 mmφ
4, 5	12 mmφ

- NOTES
1. FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG NO. JOB NO.
 2. FOR OTHER NOTES & REFERENCES REFER STR. DRG NO. JOB NO.


OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

DATE: 12/12/83
DRN BY: [Signature]
SCALE: 3/4" = 1'-0"
DETAIL OF REINFORCEMENT IN BEAMS & LINTEL F.F.L.

DRG NO. 8
JOB NO. 40
S.E.B.

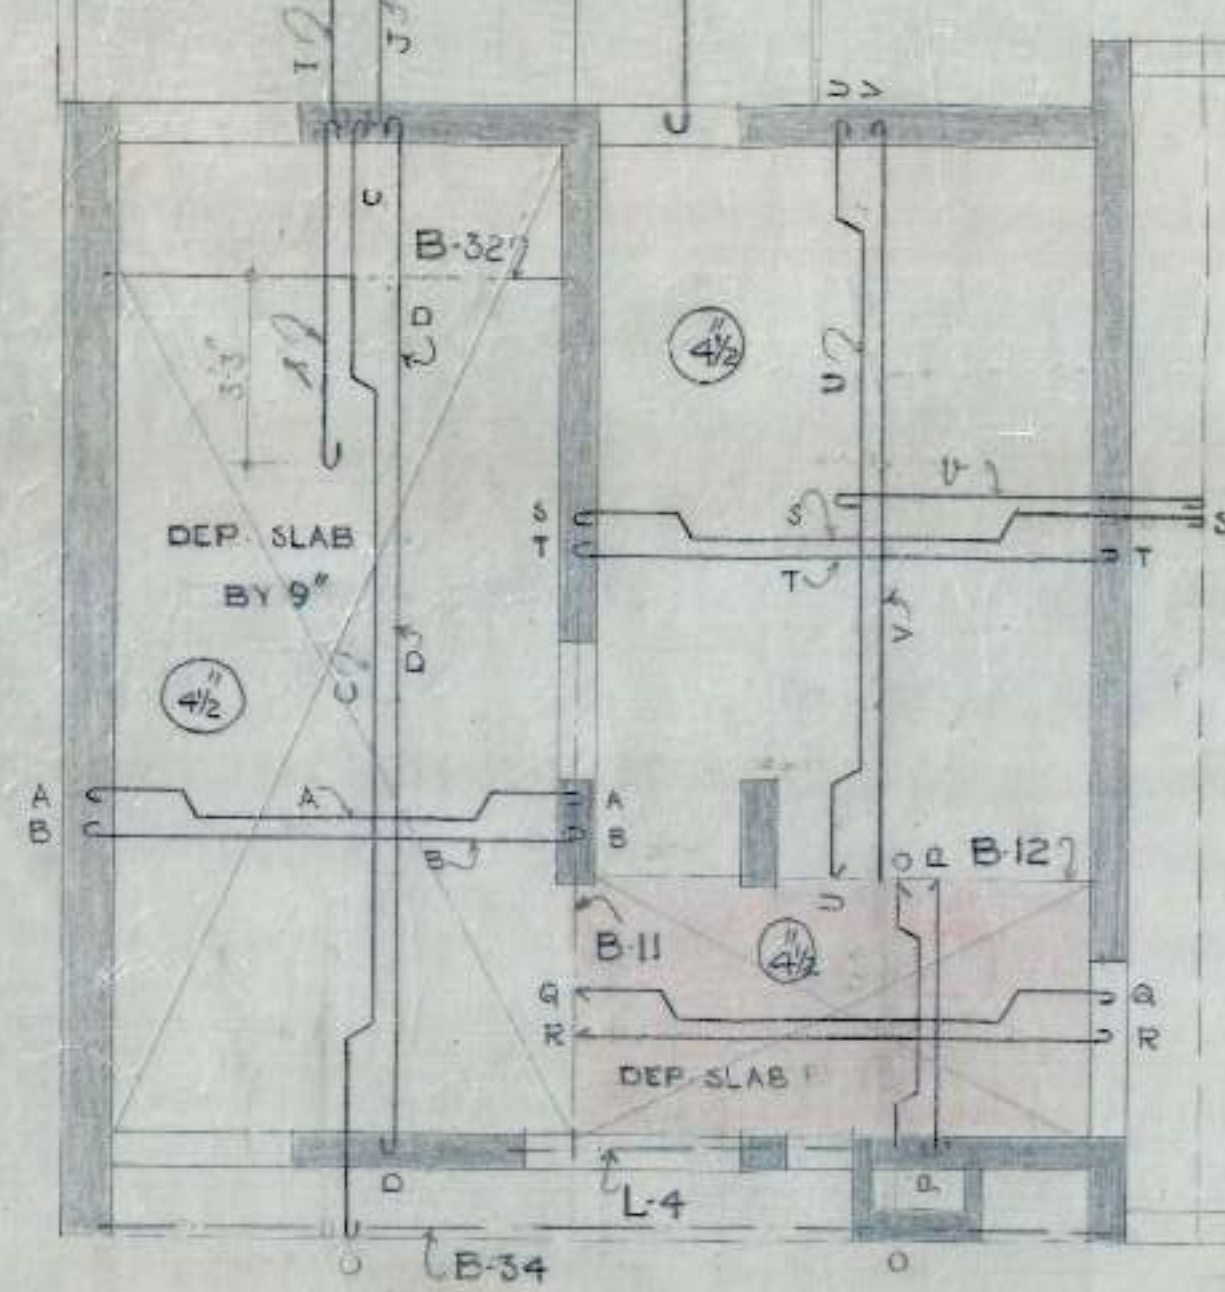

SCHEDULE OF BARS IN SLAB																				
A	12	mm	φ	8	12 ¹¹	%	F	12	mm	φ	8	12 ¹¹	%	g	10	mm	φ	8	14 ¹¹	%
B	10	mm	φ	8	12 ¹¹	%	G	10	mm	φ	8	15 ¹¹	%	f	12	mm	φ	8	14 ¹¹	%
C	10	mm	φ	8	14 ¹¹	%	R	8	mm	φ	8	15 ¹¹	%	g	10	mm	φ	8	14 ¹¹	%
D	8	mm	φ	8	14 ¹¹	%	S	12	mm	φ	8	14 ¹¹	%	h	12	mm	φ	8	14 ¹¹	%
E	8	mm	φ	8	10 ¹¹	%	T	10	mm	φ	8	14 ¹¹	%	i	10	mm	φ	8	14 ¹¹	%
F	8	mm	φ	8	16 ¹¹	%	U	10	mm	φ	8	14 ¹¹	%	j	8	mm	φ	8	14 ¹¹	%
G	10	mm	φ	8	12 ¹¹	%	V	10	mm	φ	8	14 ¹¹	%	k	8	mm	φ	8	16 ¹¹	%
H	10	mm	φ	8	12 ¹¹	%	W	12	mm	φ	8	10 ¹¹	%	l	8	mm	φ	8	16 ¹¹	%
I	10	mm	φ	8	16 ¹¹	%	X	12	mm	φ	8	10 ¹¹	%	m	12	mm	φ	8	14 ¹¹	%
J	8	mm	φ	8	16 ¹¹	%	Y	10	mm	φ	8	10 ¹¹	%	n	10	mm	φ	8	14 ¹¹	%
K	10	mm	φ	8	16 ¹¹	%	Z	8	mm	φ	8	16 ¹¹	%	o	12	mm	φ	8	14 ¹¹	%
L	12	mm	φ	8	14 ¹¹	%	a	12	mm	φ	8	NET 9/16		p	12	mm	φ	8	14 ¹¹	%
M	10	mm	φ	8	14 ¹¹	%	b	10	mm	φ	8	14 ¹¹	%	q	10	mm	φ	8	14 ¹¹	%
N	10	mm	φ	8	7 ¹¹	%	c	10	mm	φ	8	14 ¹¹	%	r	10	mm	φ	8	14 ¹¹	%
O	12	mm	φ	8	12 ¹¹	%	d	10	mm	φ	8	14 ¹¹	%	s	12	mm	φ	8	3/2 ¹¹	%
P	10	mm	φ	8	7 ¹¹	%	u	8	mm	φ	8	14 ¹¹	%	t	8	mm	φ	8	14 ¹¹	%

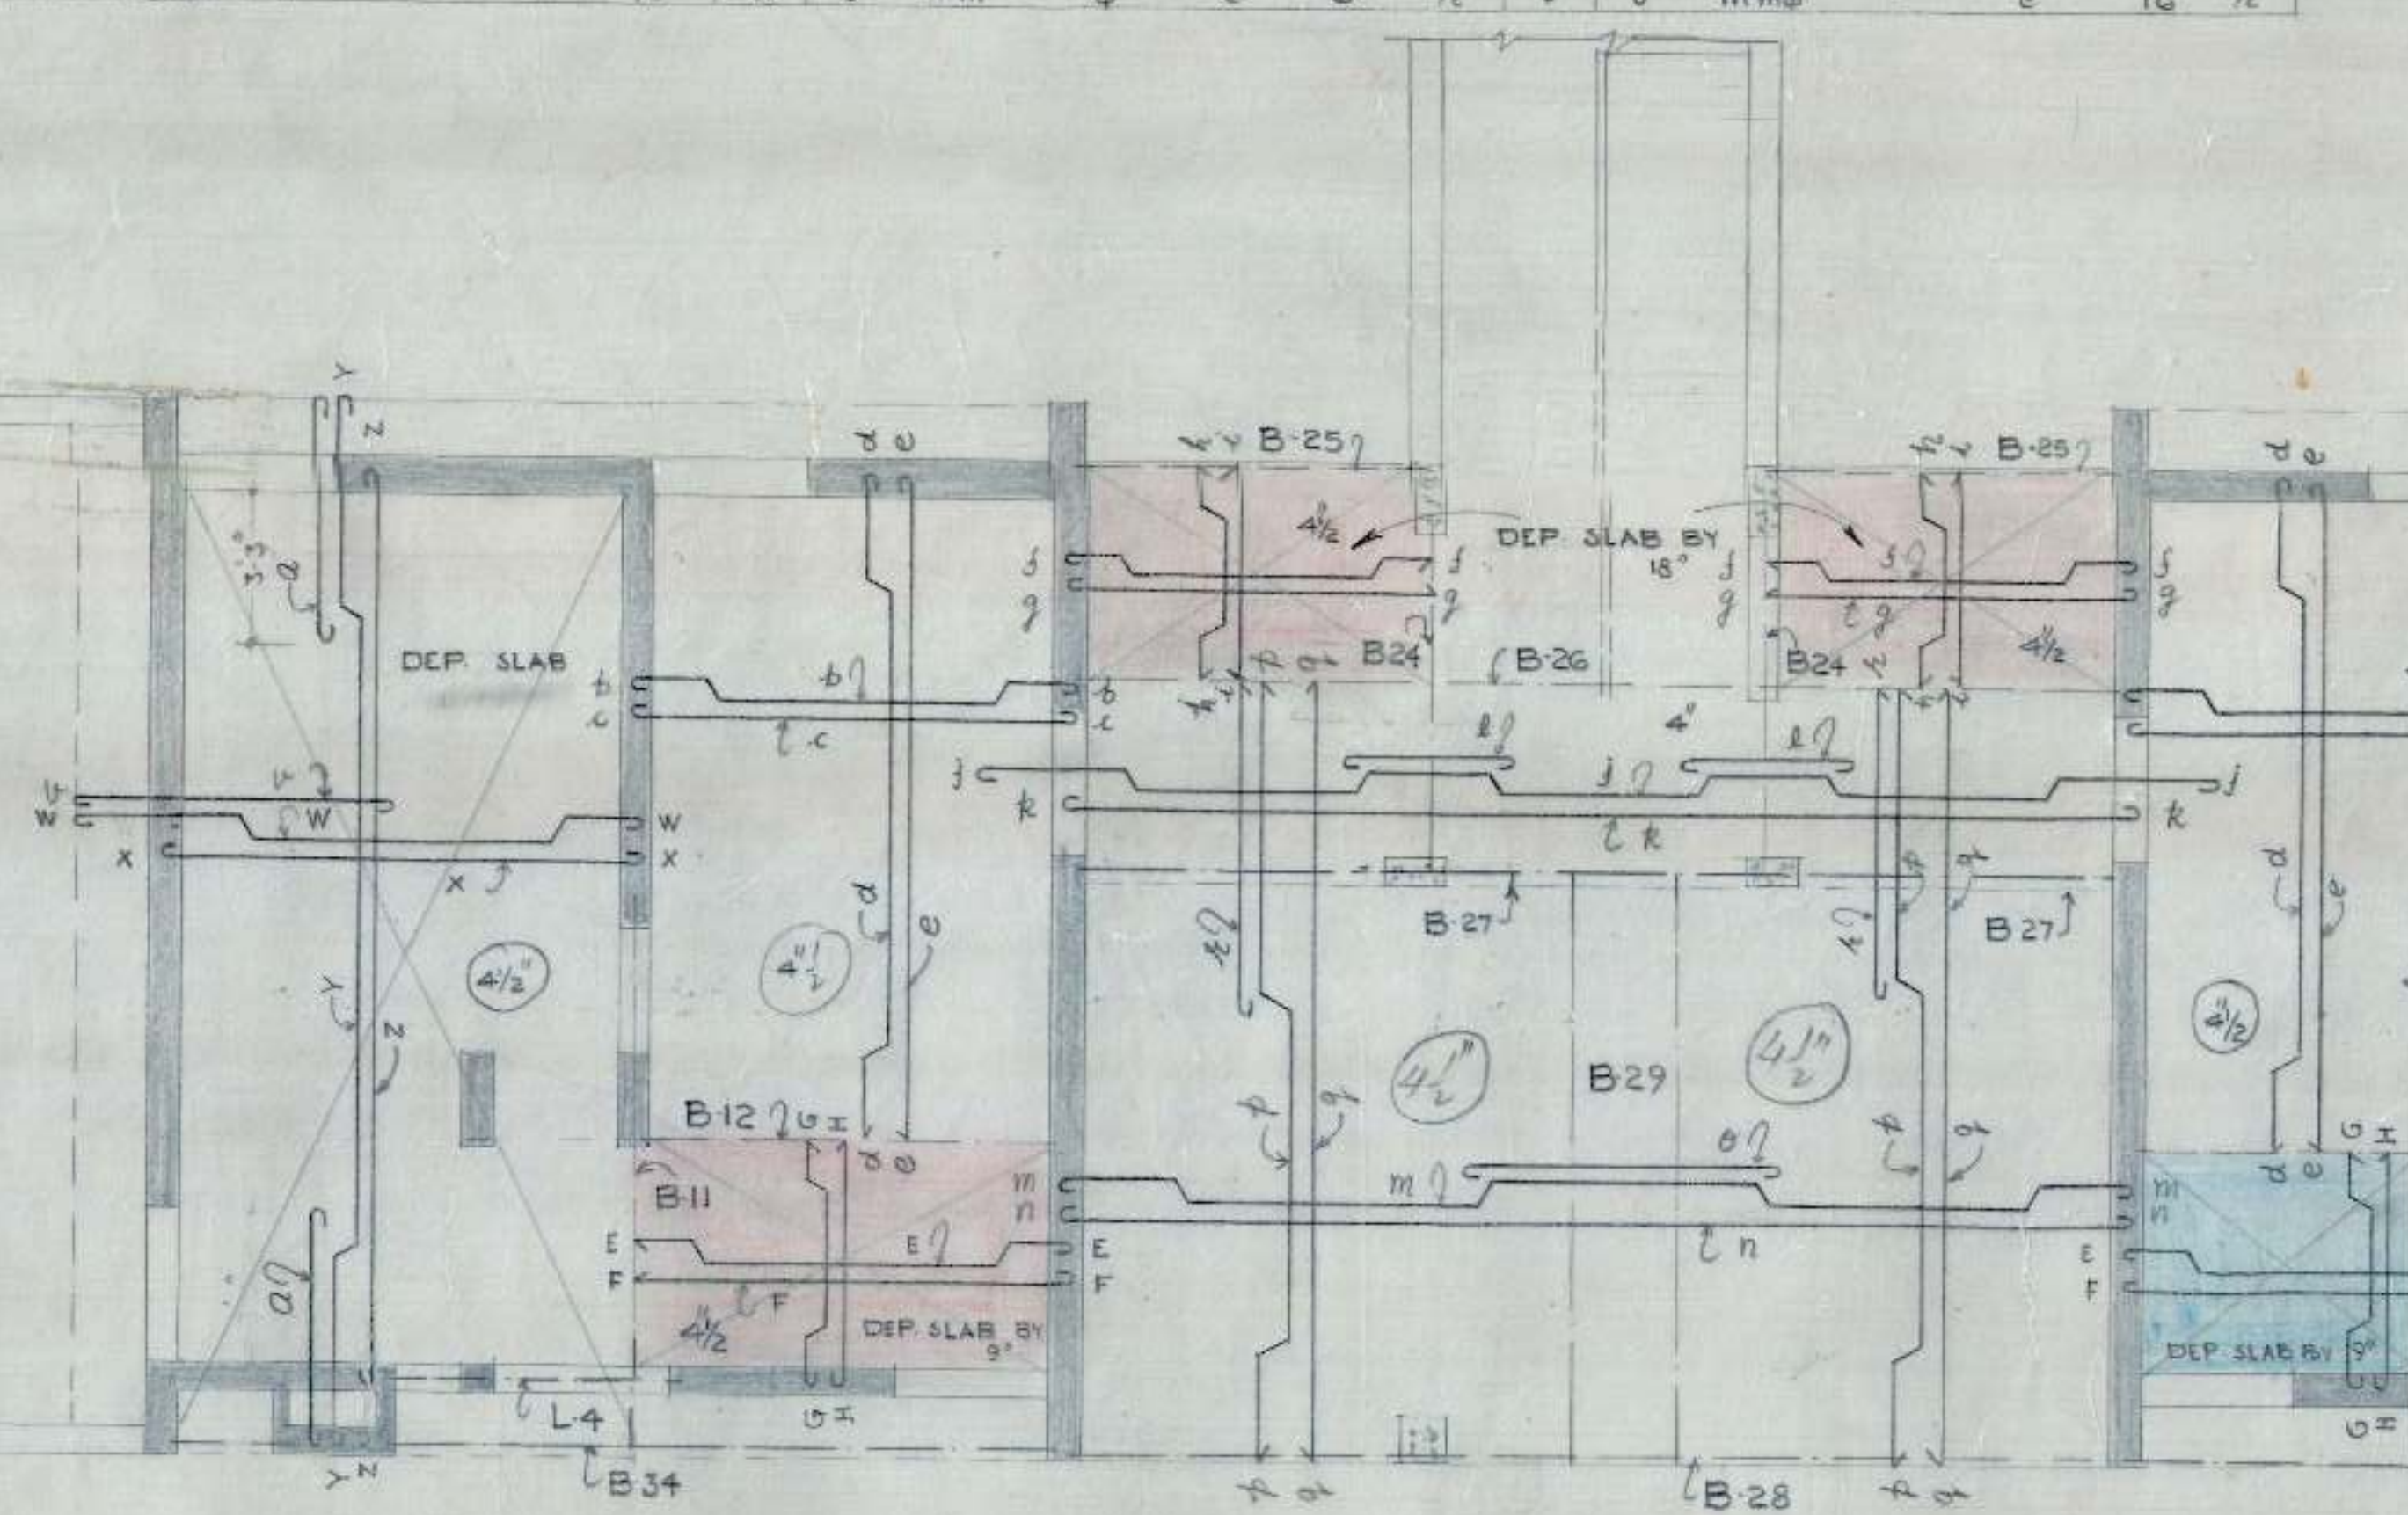

SCALE $1/4" = 1'-0"$

THICKNESS OF SLAB = $4\frac{1}{2}$ "

CHILD

S No	NOTES
------	-------

- | | | | | | |
|----|-------|--------|-------|--------------|--------|
| 1. | FOR | CENTRE | LINE | DIMENSIONS | REFER |
| | ARCH. | DRG | NO | JOB | NO |
| 2. | FOR | OTHER | NOTES | & REFERENCES | |
| | REFER | STR | DRG | NO. | JOB NO |

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

DRN BY

M.I.G TWO ROOM

DRG No.
9

SCALE
 $\frac{3}{4}'' = 1'-0''$

DETAIL OF
REINFORCEMENT IN
SLAB AT F.F.


JOB No
40

1519
AED


E.E.)

S.E.H.B


CHUB

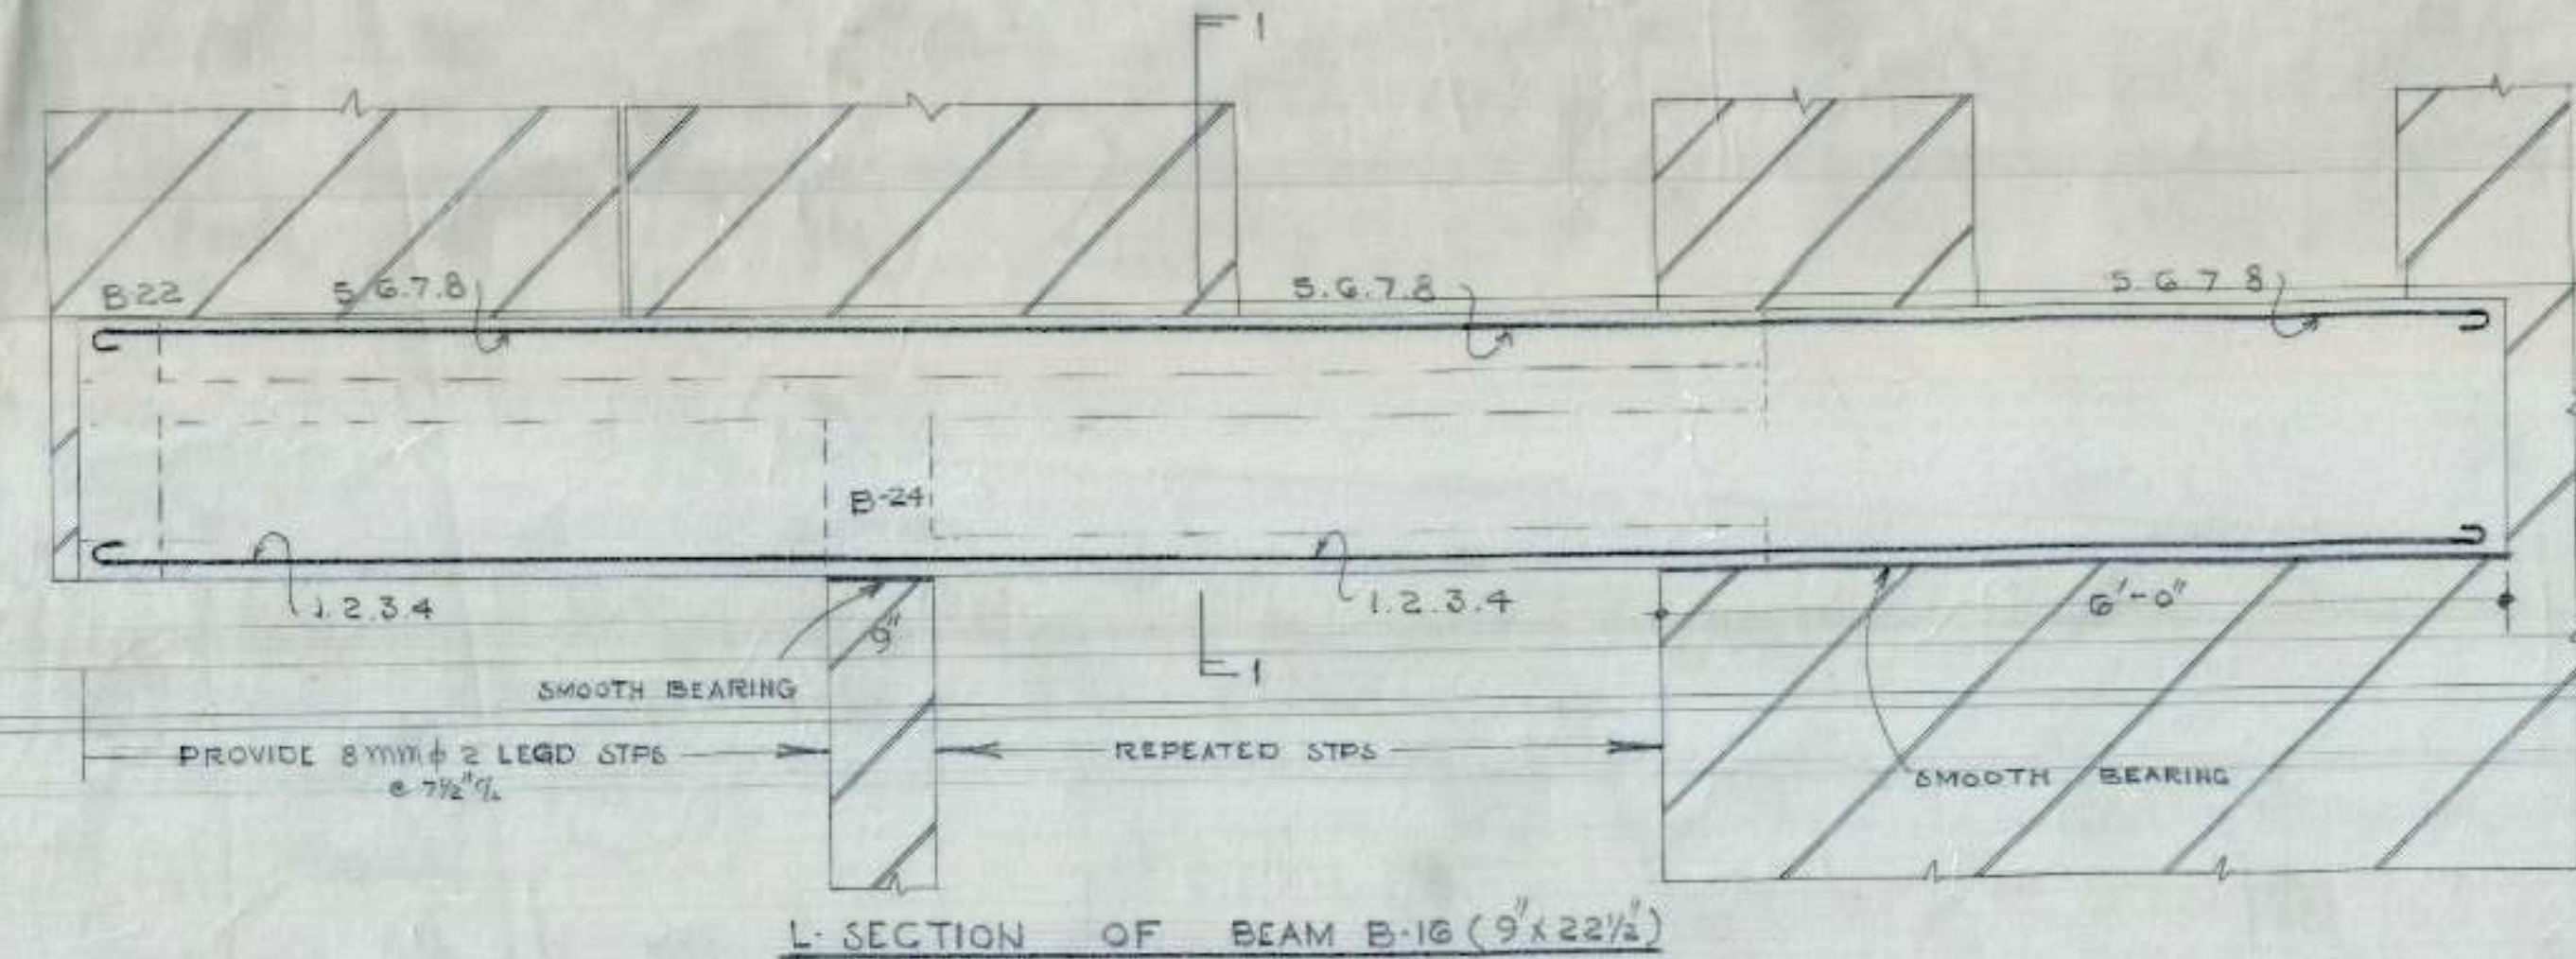


SCHEDULE OF BARS IN B-16	
1 TO 8	20 mmφ

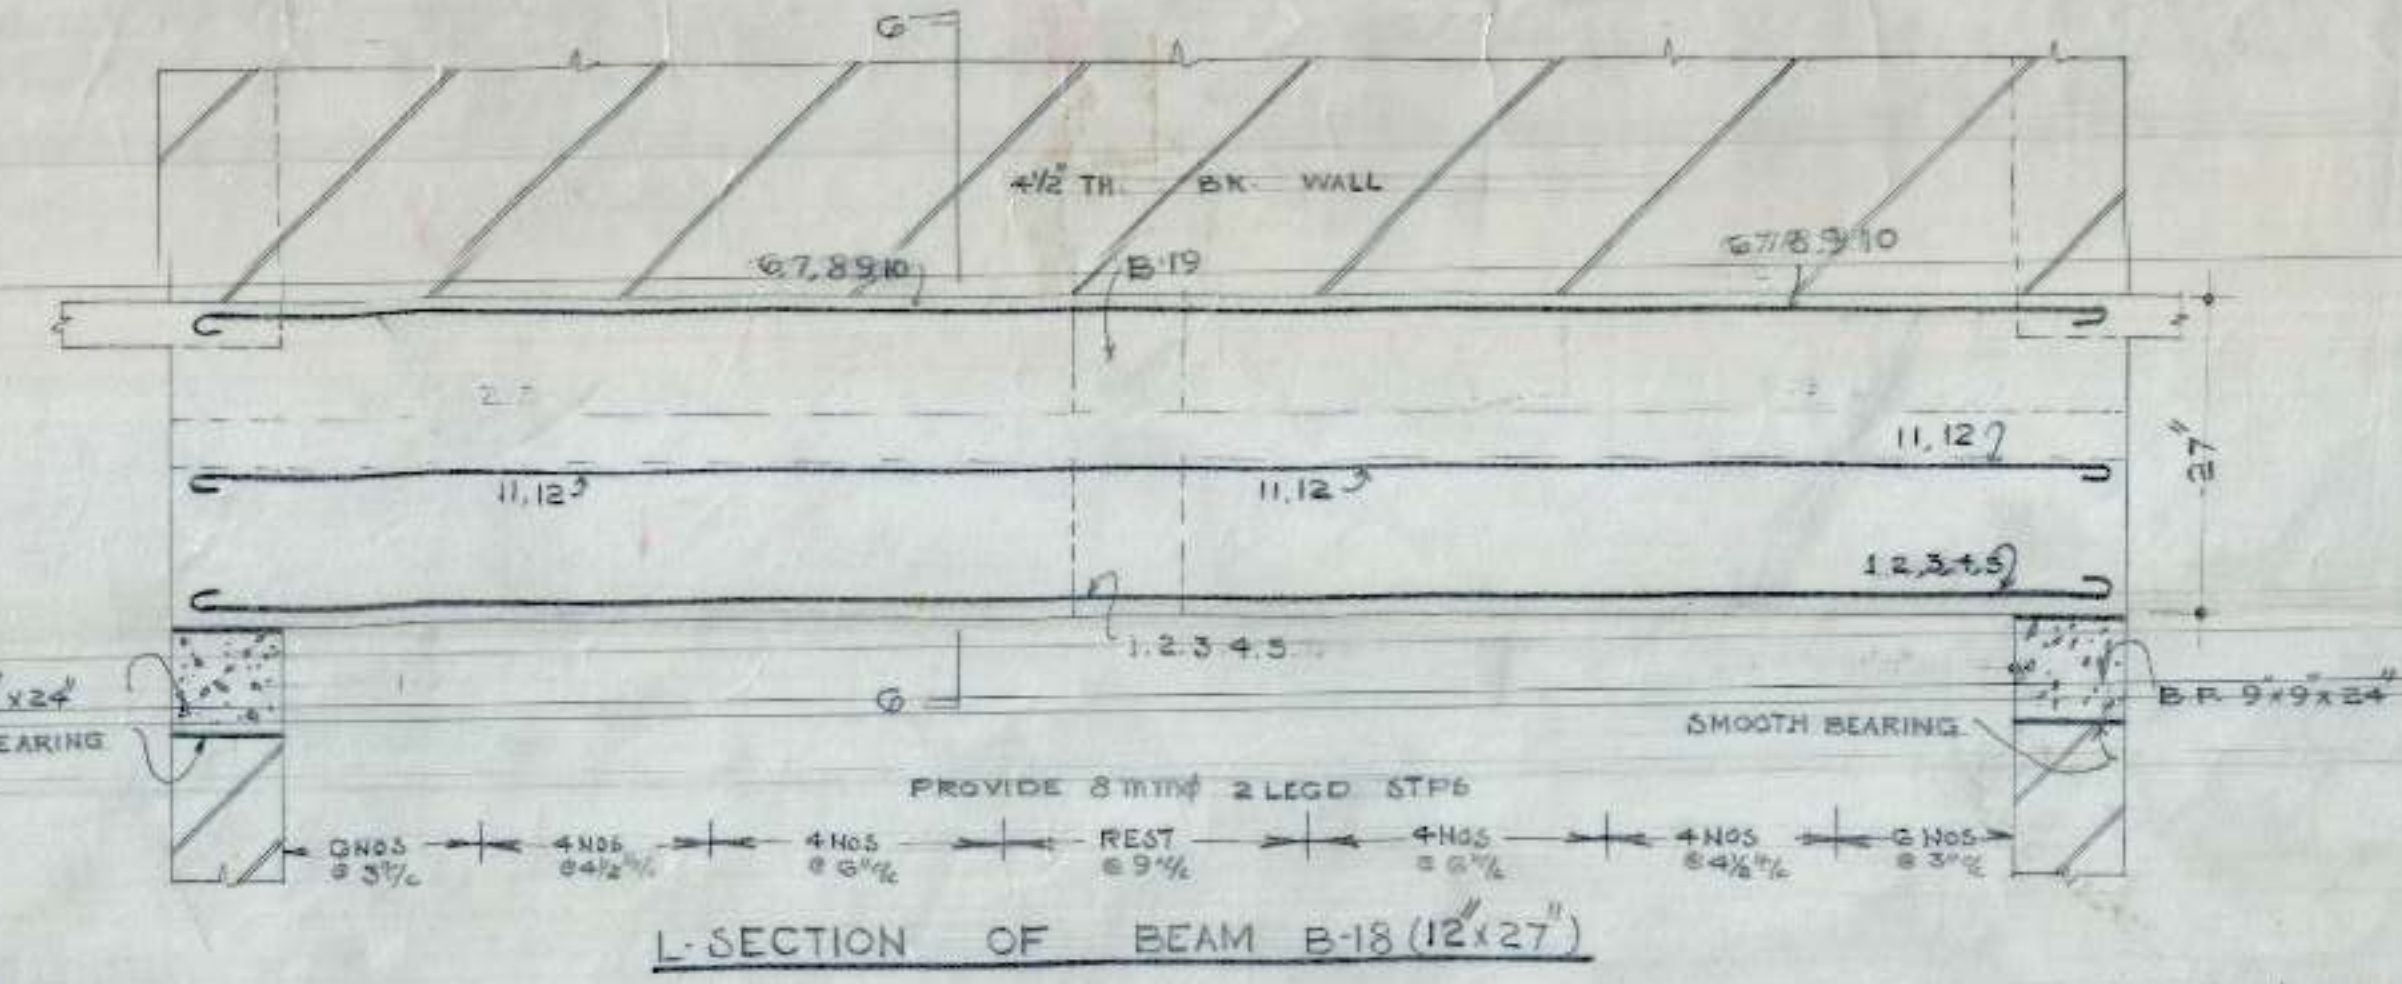


SCHEDULE OF BARS IN B-18	
1 TO 10	20 mmφ
11, 12	16 mmφ

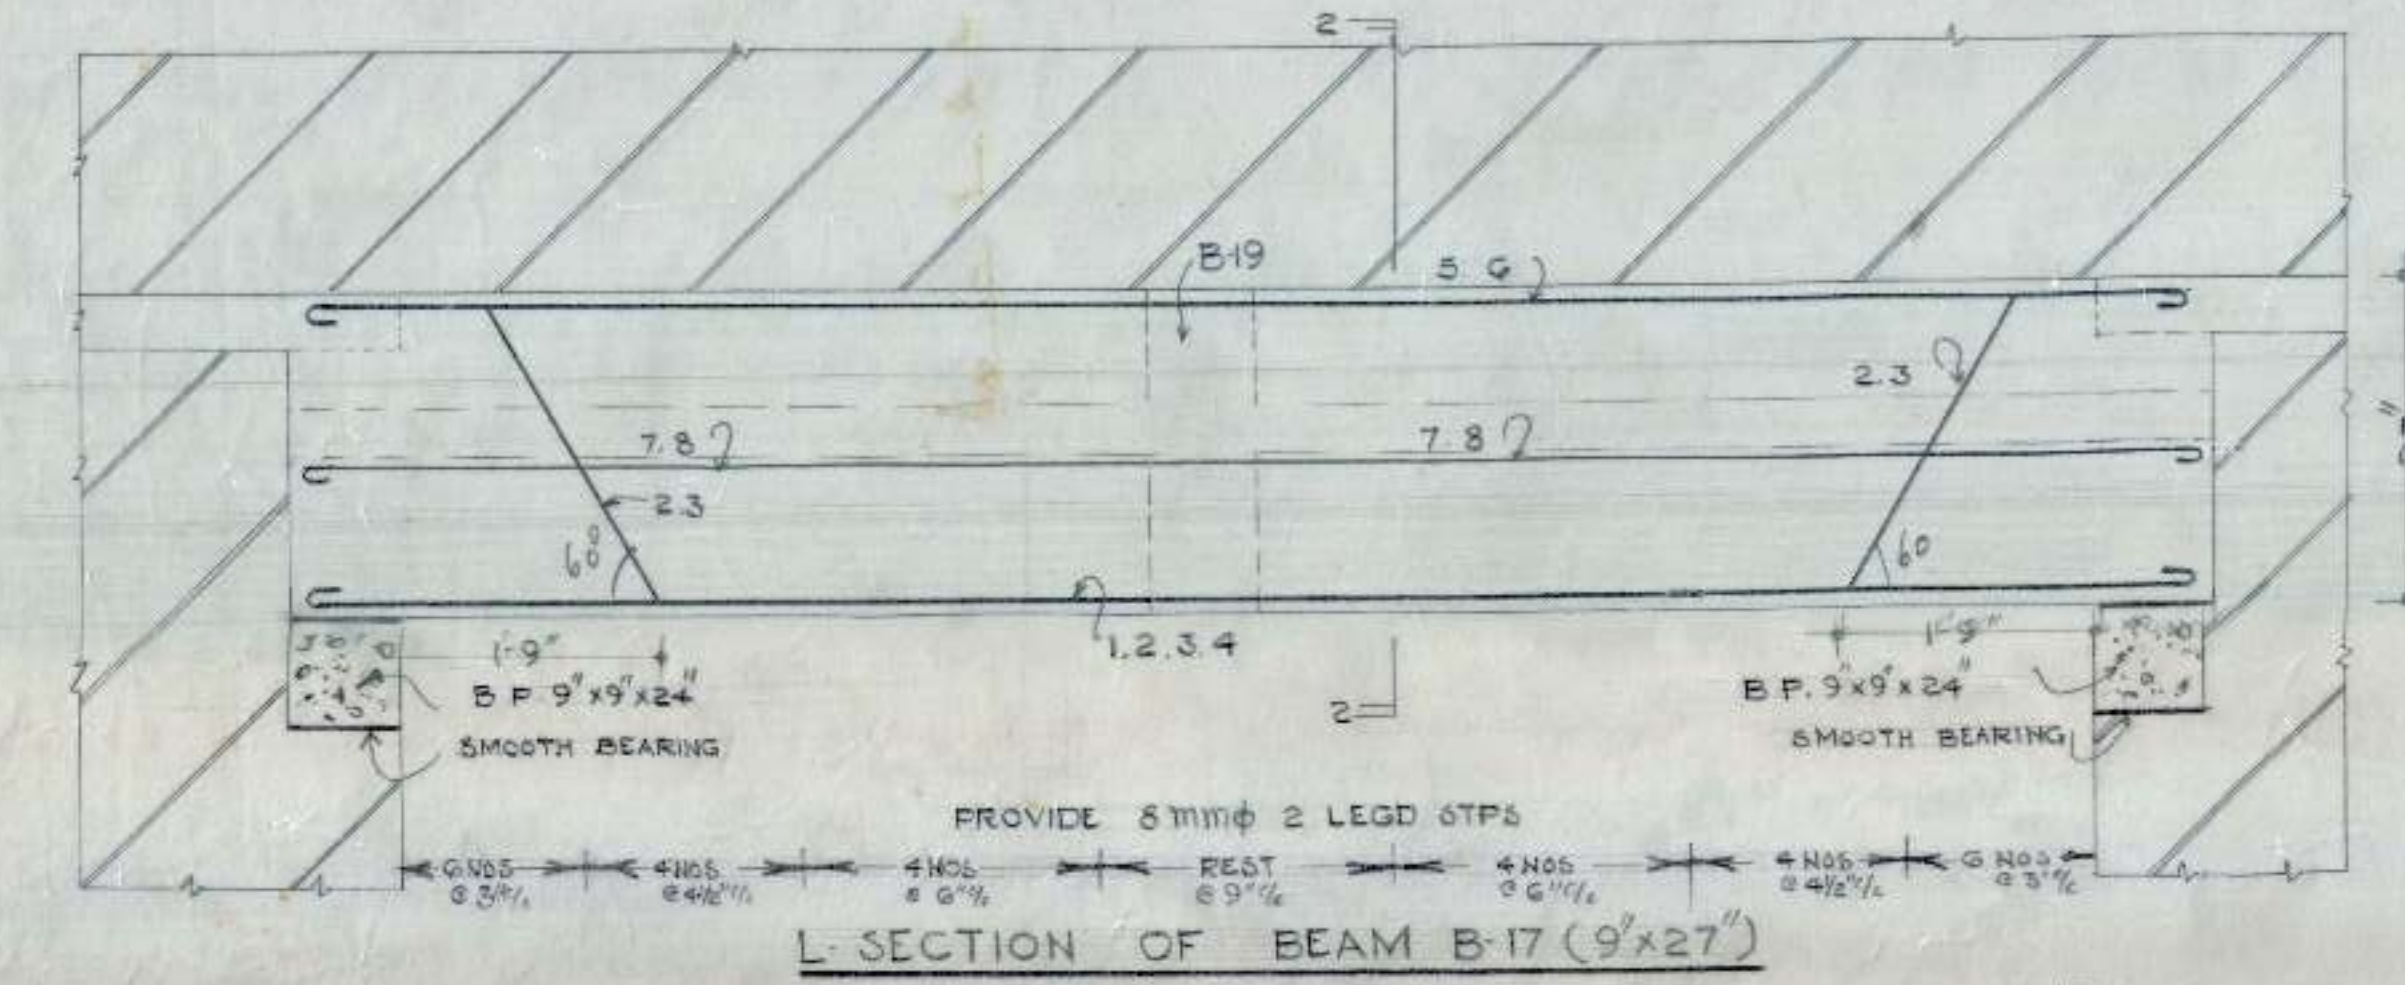


SCHEDULE OF BARS IN B-17	
1 TO 4	20 mmφ
5, 6	16 mmφ
7, 8	12 mmφ

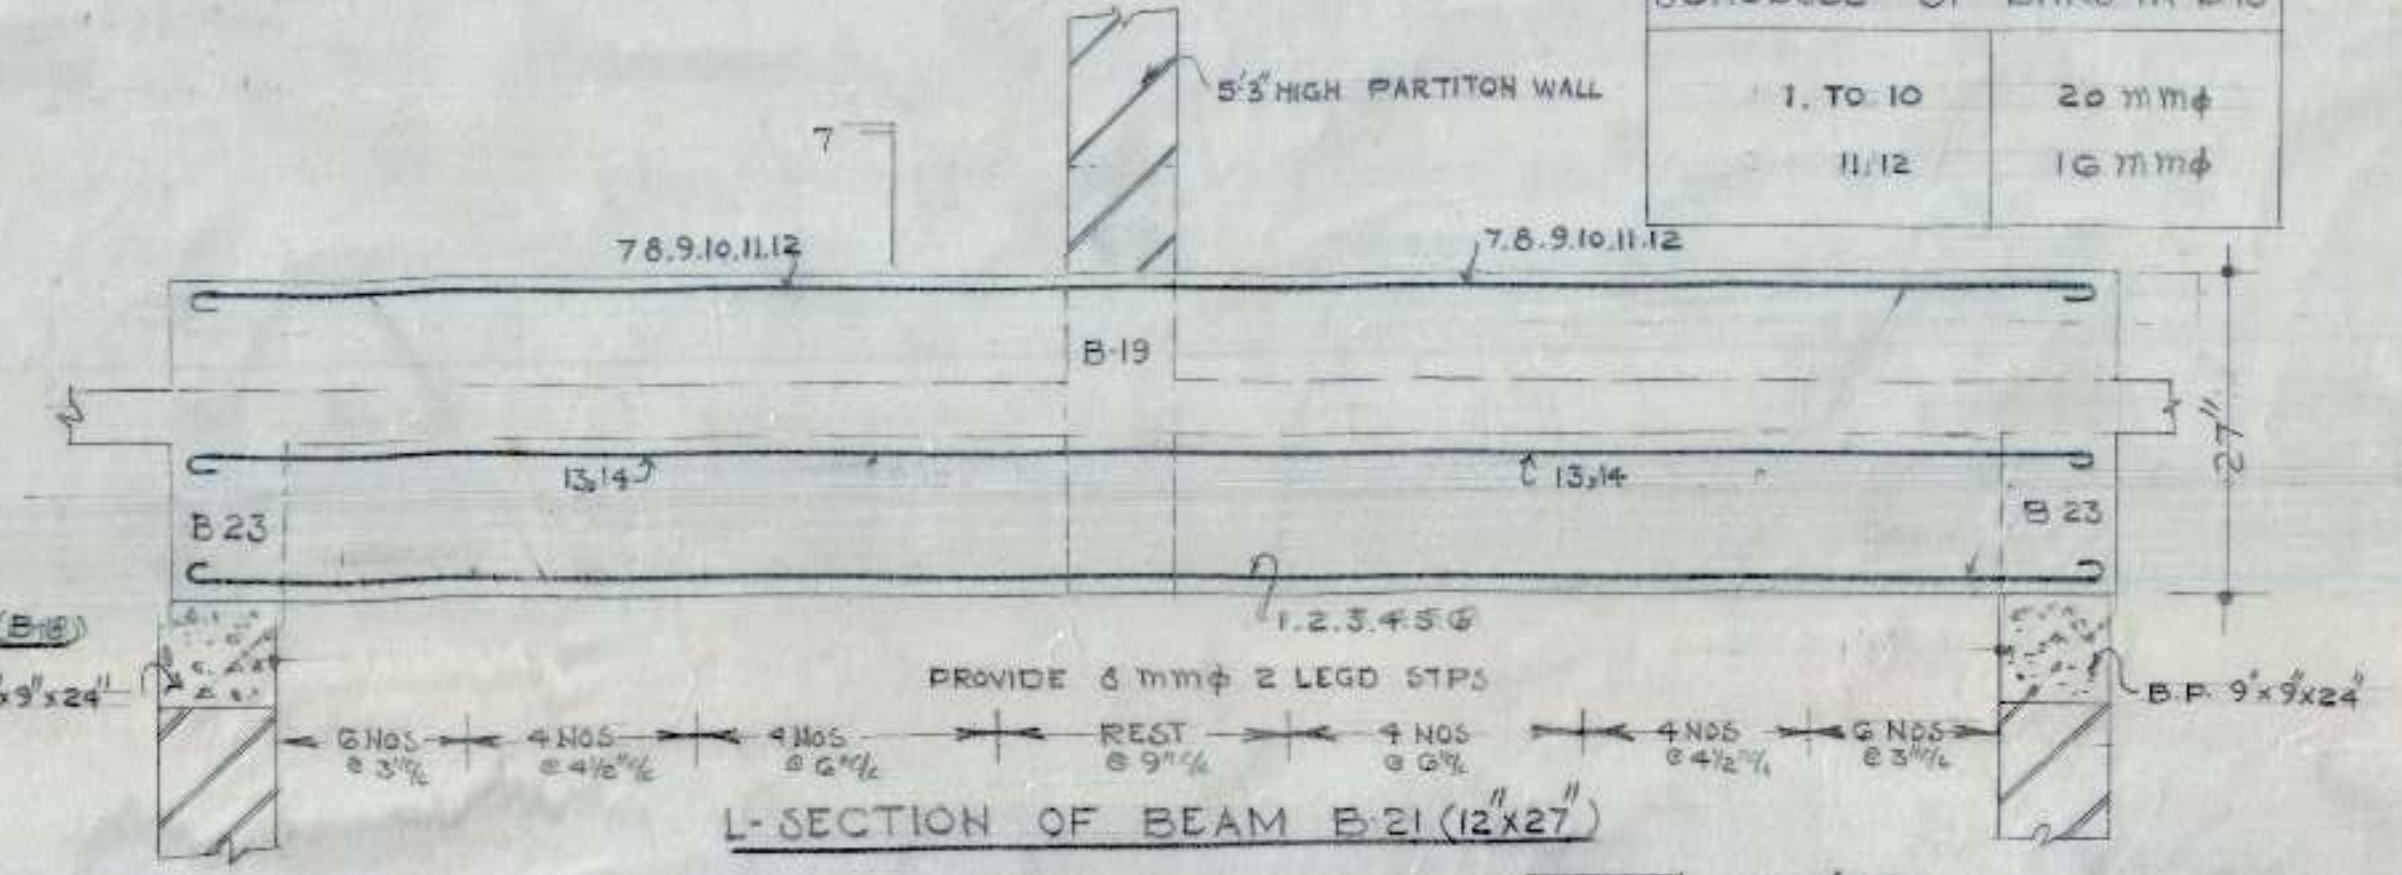


SCHEDULE OF BARS IN B-21	
1, 3, 5, 7, 9, 11	20 mmφ
2, 4, 6, 8, 10, 12	16 mmφ

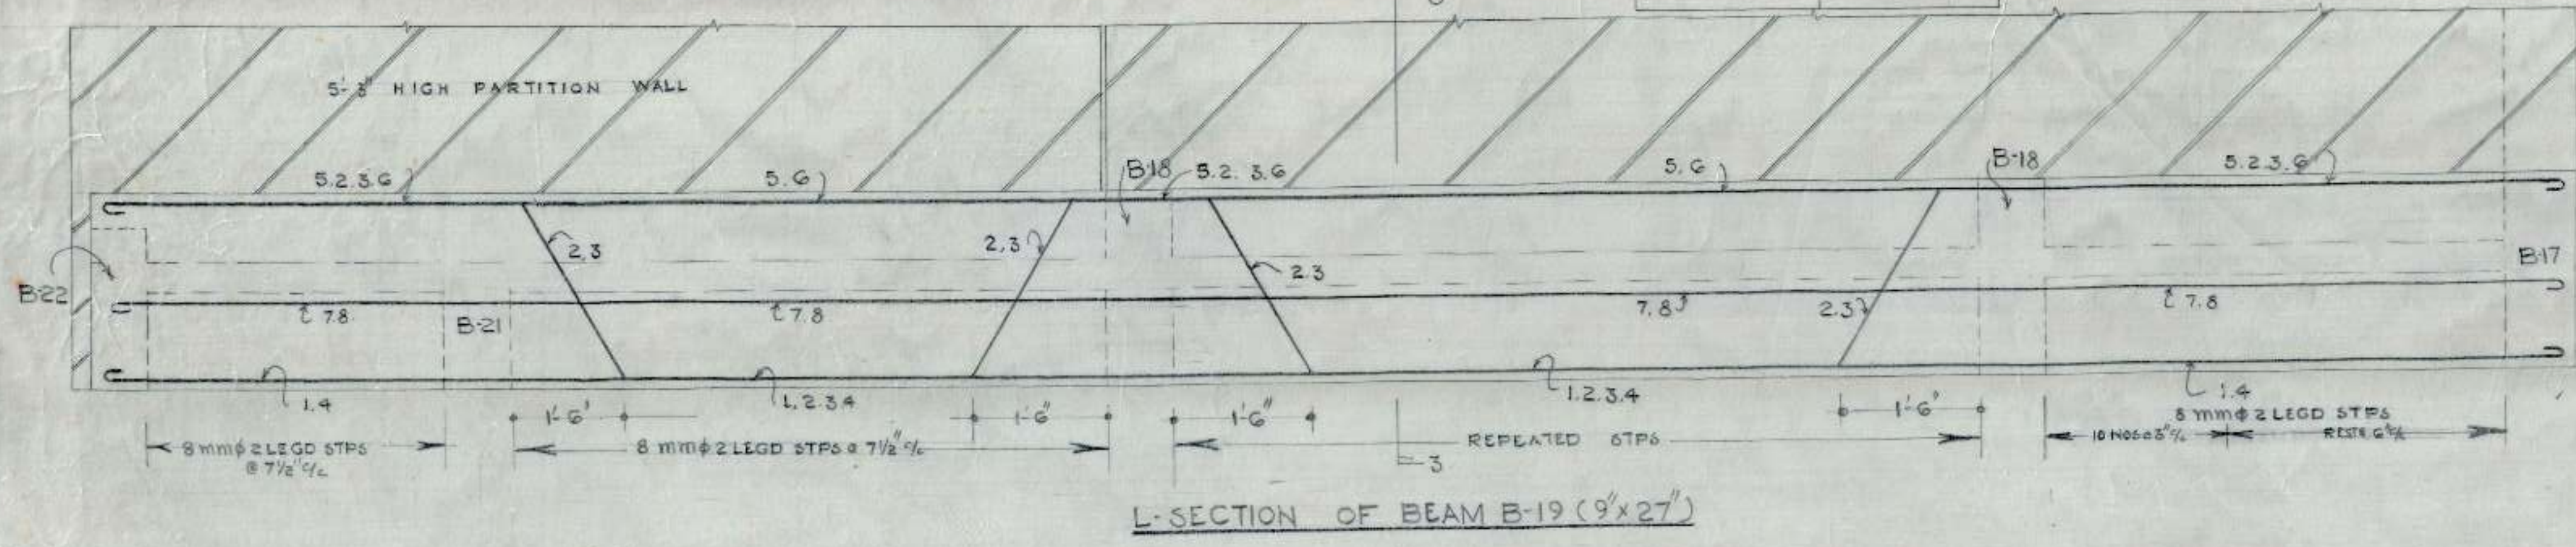


SCHEDULE OF BARS IN B-19	
1, 2, 3, 4	16 mmφ
5, 6	12 mmφ
7, 8	10 mmφ

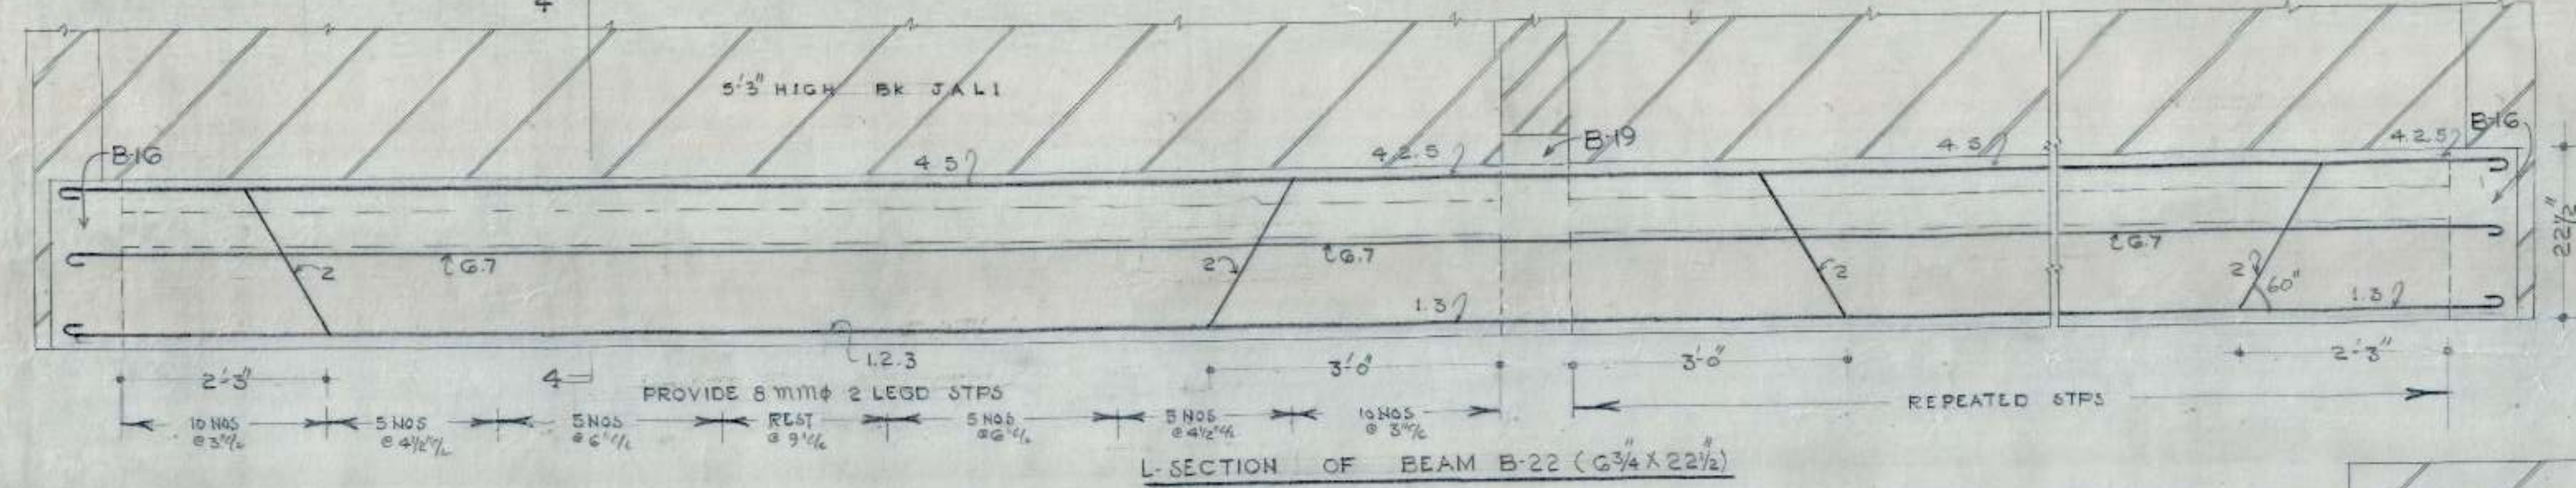

SCHEDULE OF BARS IN B-22	
1, 3	12 mmφ
2	12 mmφ
4, 5, 6, 7	10 mmφ

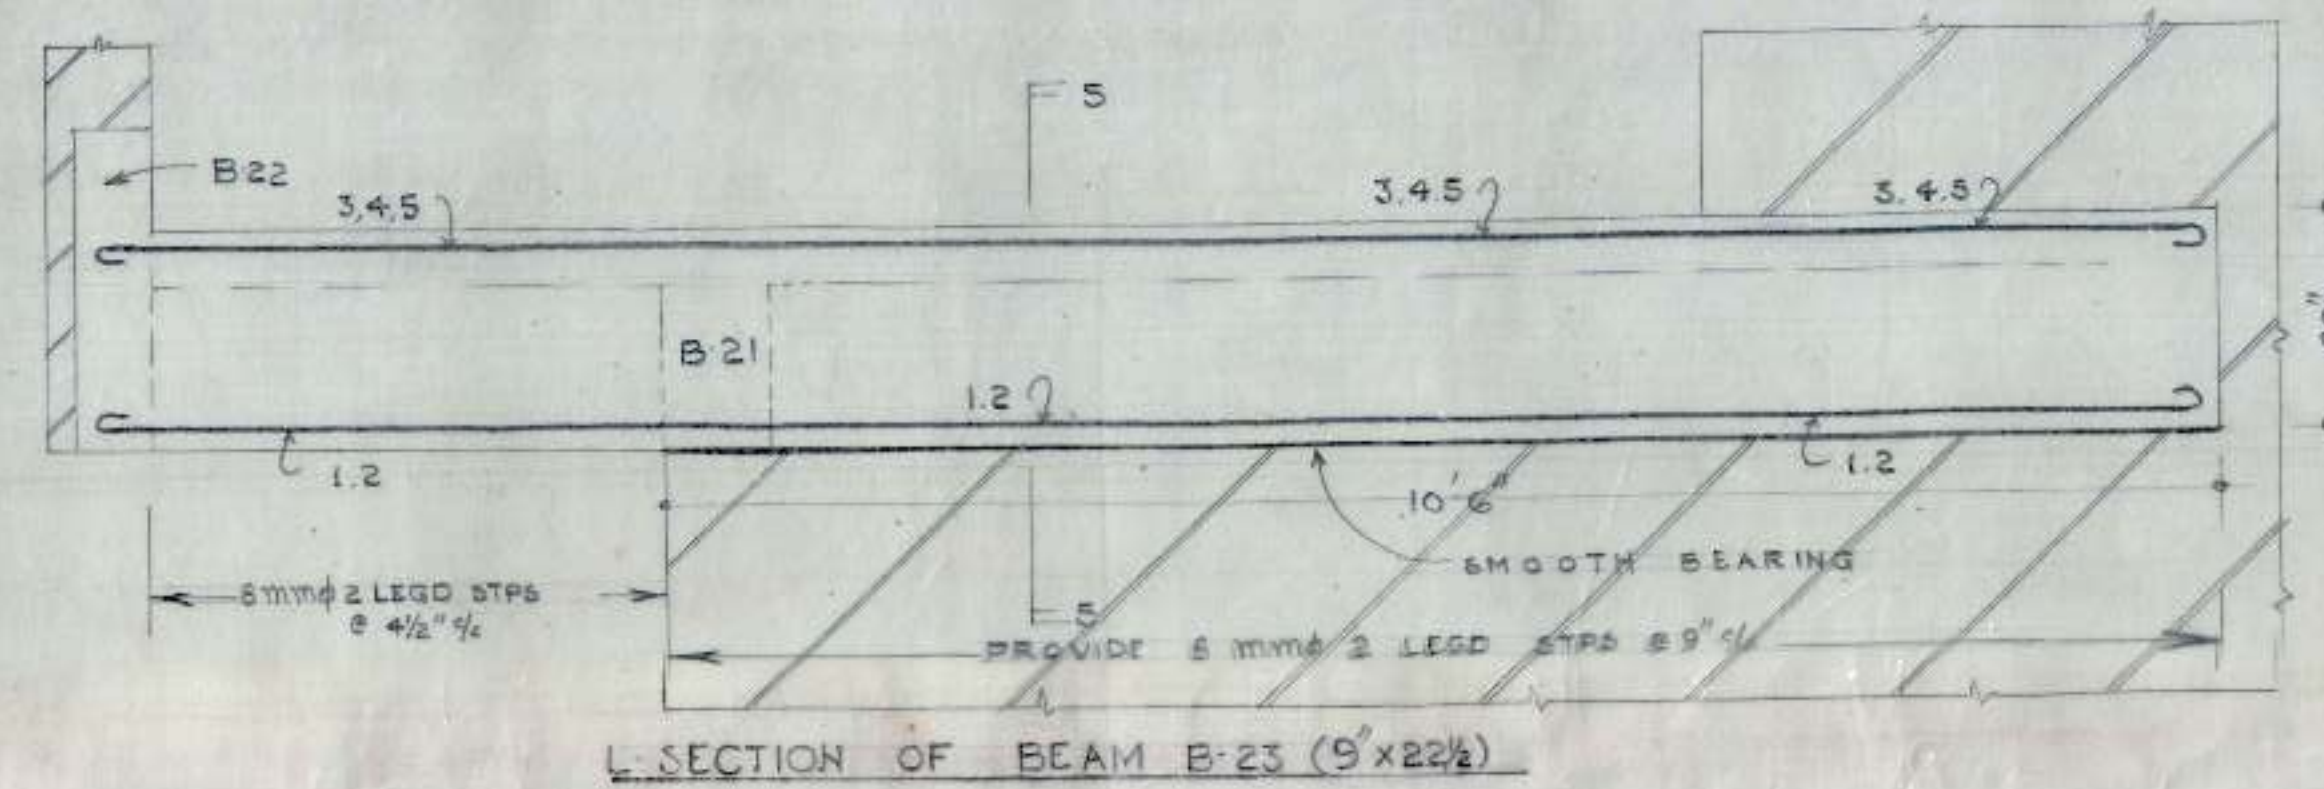

SCHEDULE OF BARS IN B-23	
1, 2	16 mmφ
3, 4, 5	20 mmφ

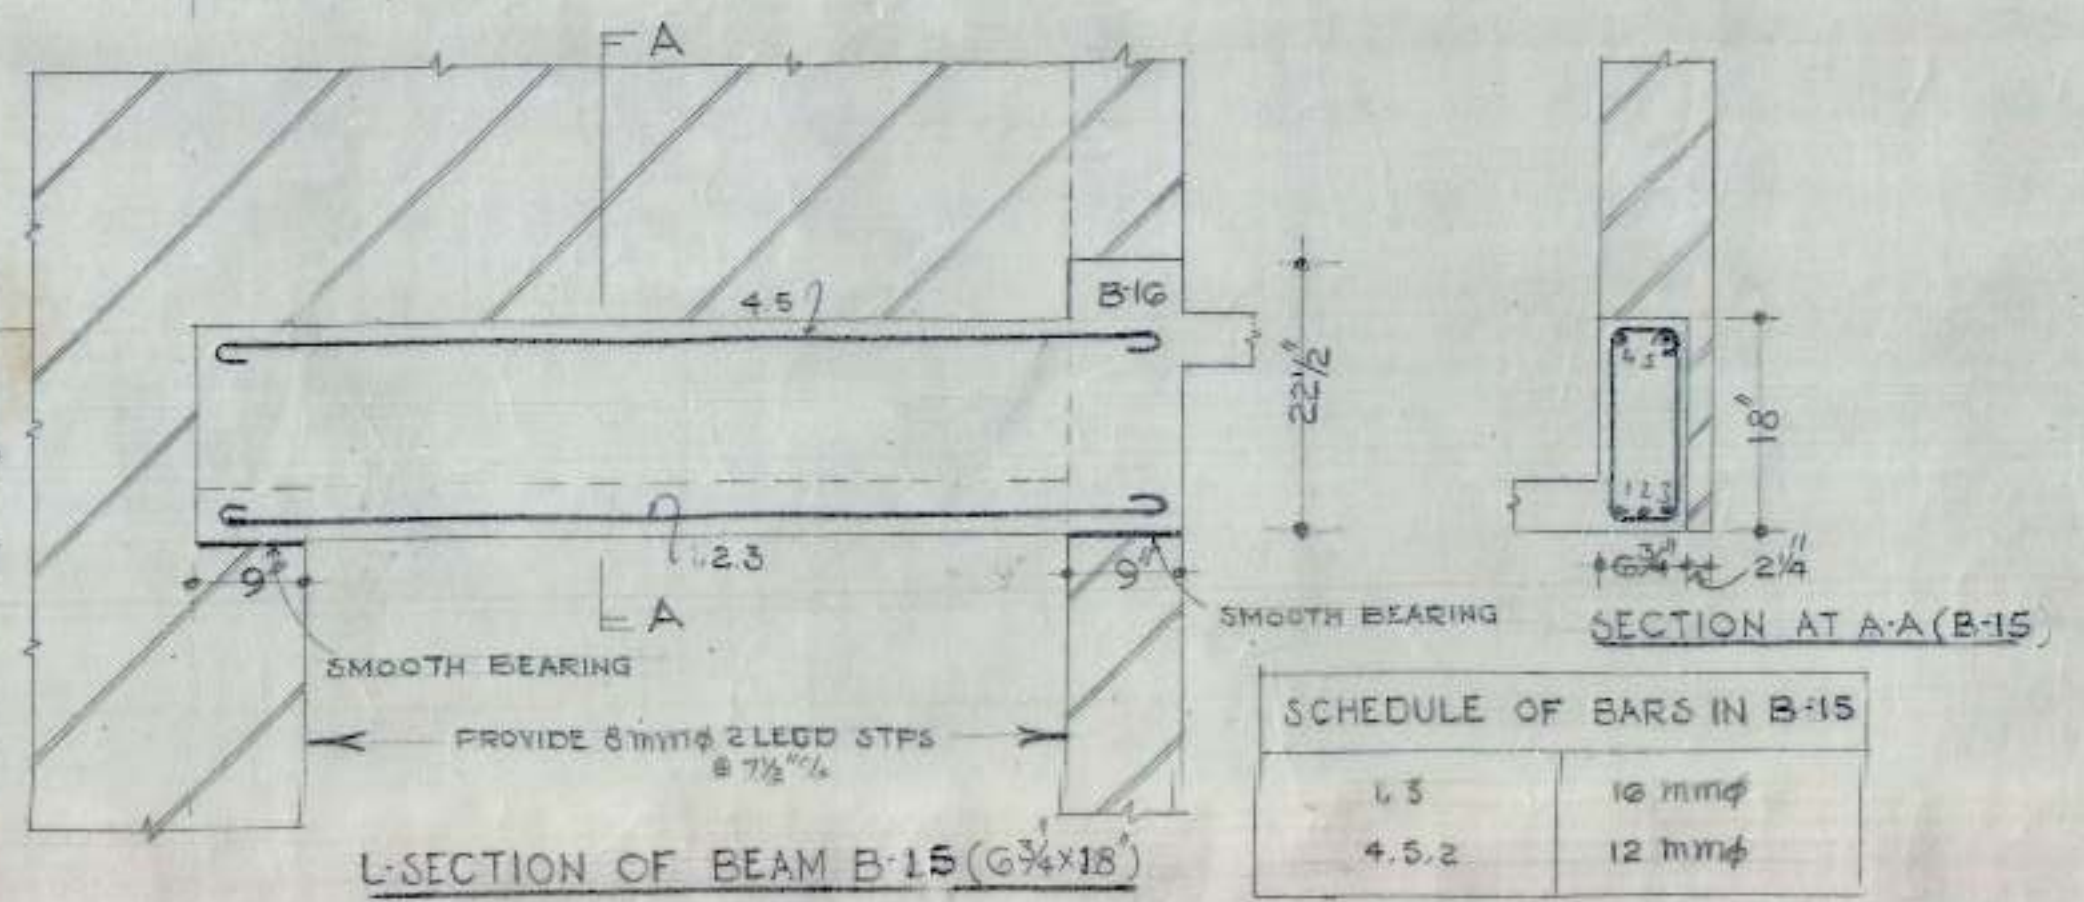

SCHEDULE OF BARS IN B-15	
1, 3	16 mmφ
4, 5, 2	12 mmφ


SNO	NOTES
1	FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG. NO. JOB NO.
2	FOR OTHER NOTES & REFERENCES REFER STR. DRG. NO. JOB NO.

NOTE:-
THE MAIN REINFORCEMENT OF THE SUPPORTED BEAM SHALL BE PLACED ABOVE THE SUPPORTING BEAM

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH		
DRN BY <i>Atinder</i>	M.I.G TWO ROOM	DRG NO 10
SCALE 3/4" = 1'-0"	DETAIL OF REINFORCEMENT IN LINTELS & BEAMS AT G.F. (GROUP)	JOB NO 40
A.E.D. <i>guy</i>	E.E.I. <i>guy</i>	S.E.H.B.


CHB

SCHEDULE OF BAR IN SLAB AT TOP FL.					
A	12	mm	φ	12"	1/4
B	10	mm	φ	12"	1/4
C	10	mm	φ	12"	1/4
D	8	mm	φ	14"	1/4
E	10	mm	φ	14"	1/4
F	10	mm	φ	14"	1/4
G	10	mm	φ	14"	1/4
H	10	mm	φ	15"	1/4
I	8	mm	φ	15"	1/4
J	8	mm	φ	16"	1/4
K	8	mm	φ	16"	1/4
L	8	mm	φ	16"	1/4
M	10	mm	φ	16"	1/4
N	10	mm	φ	16"	1/4
O	8	mm	φ	14"	1/4
P	8	mm	φ	14"	1/4

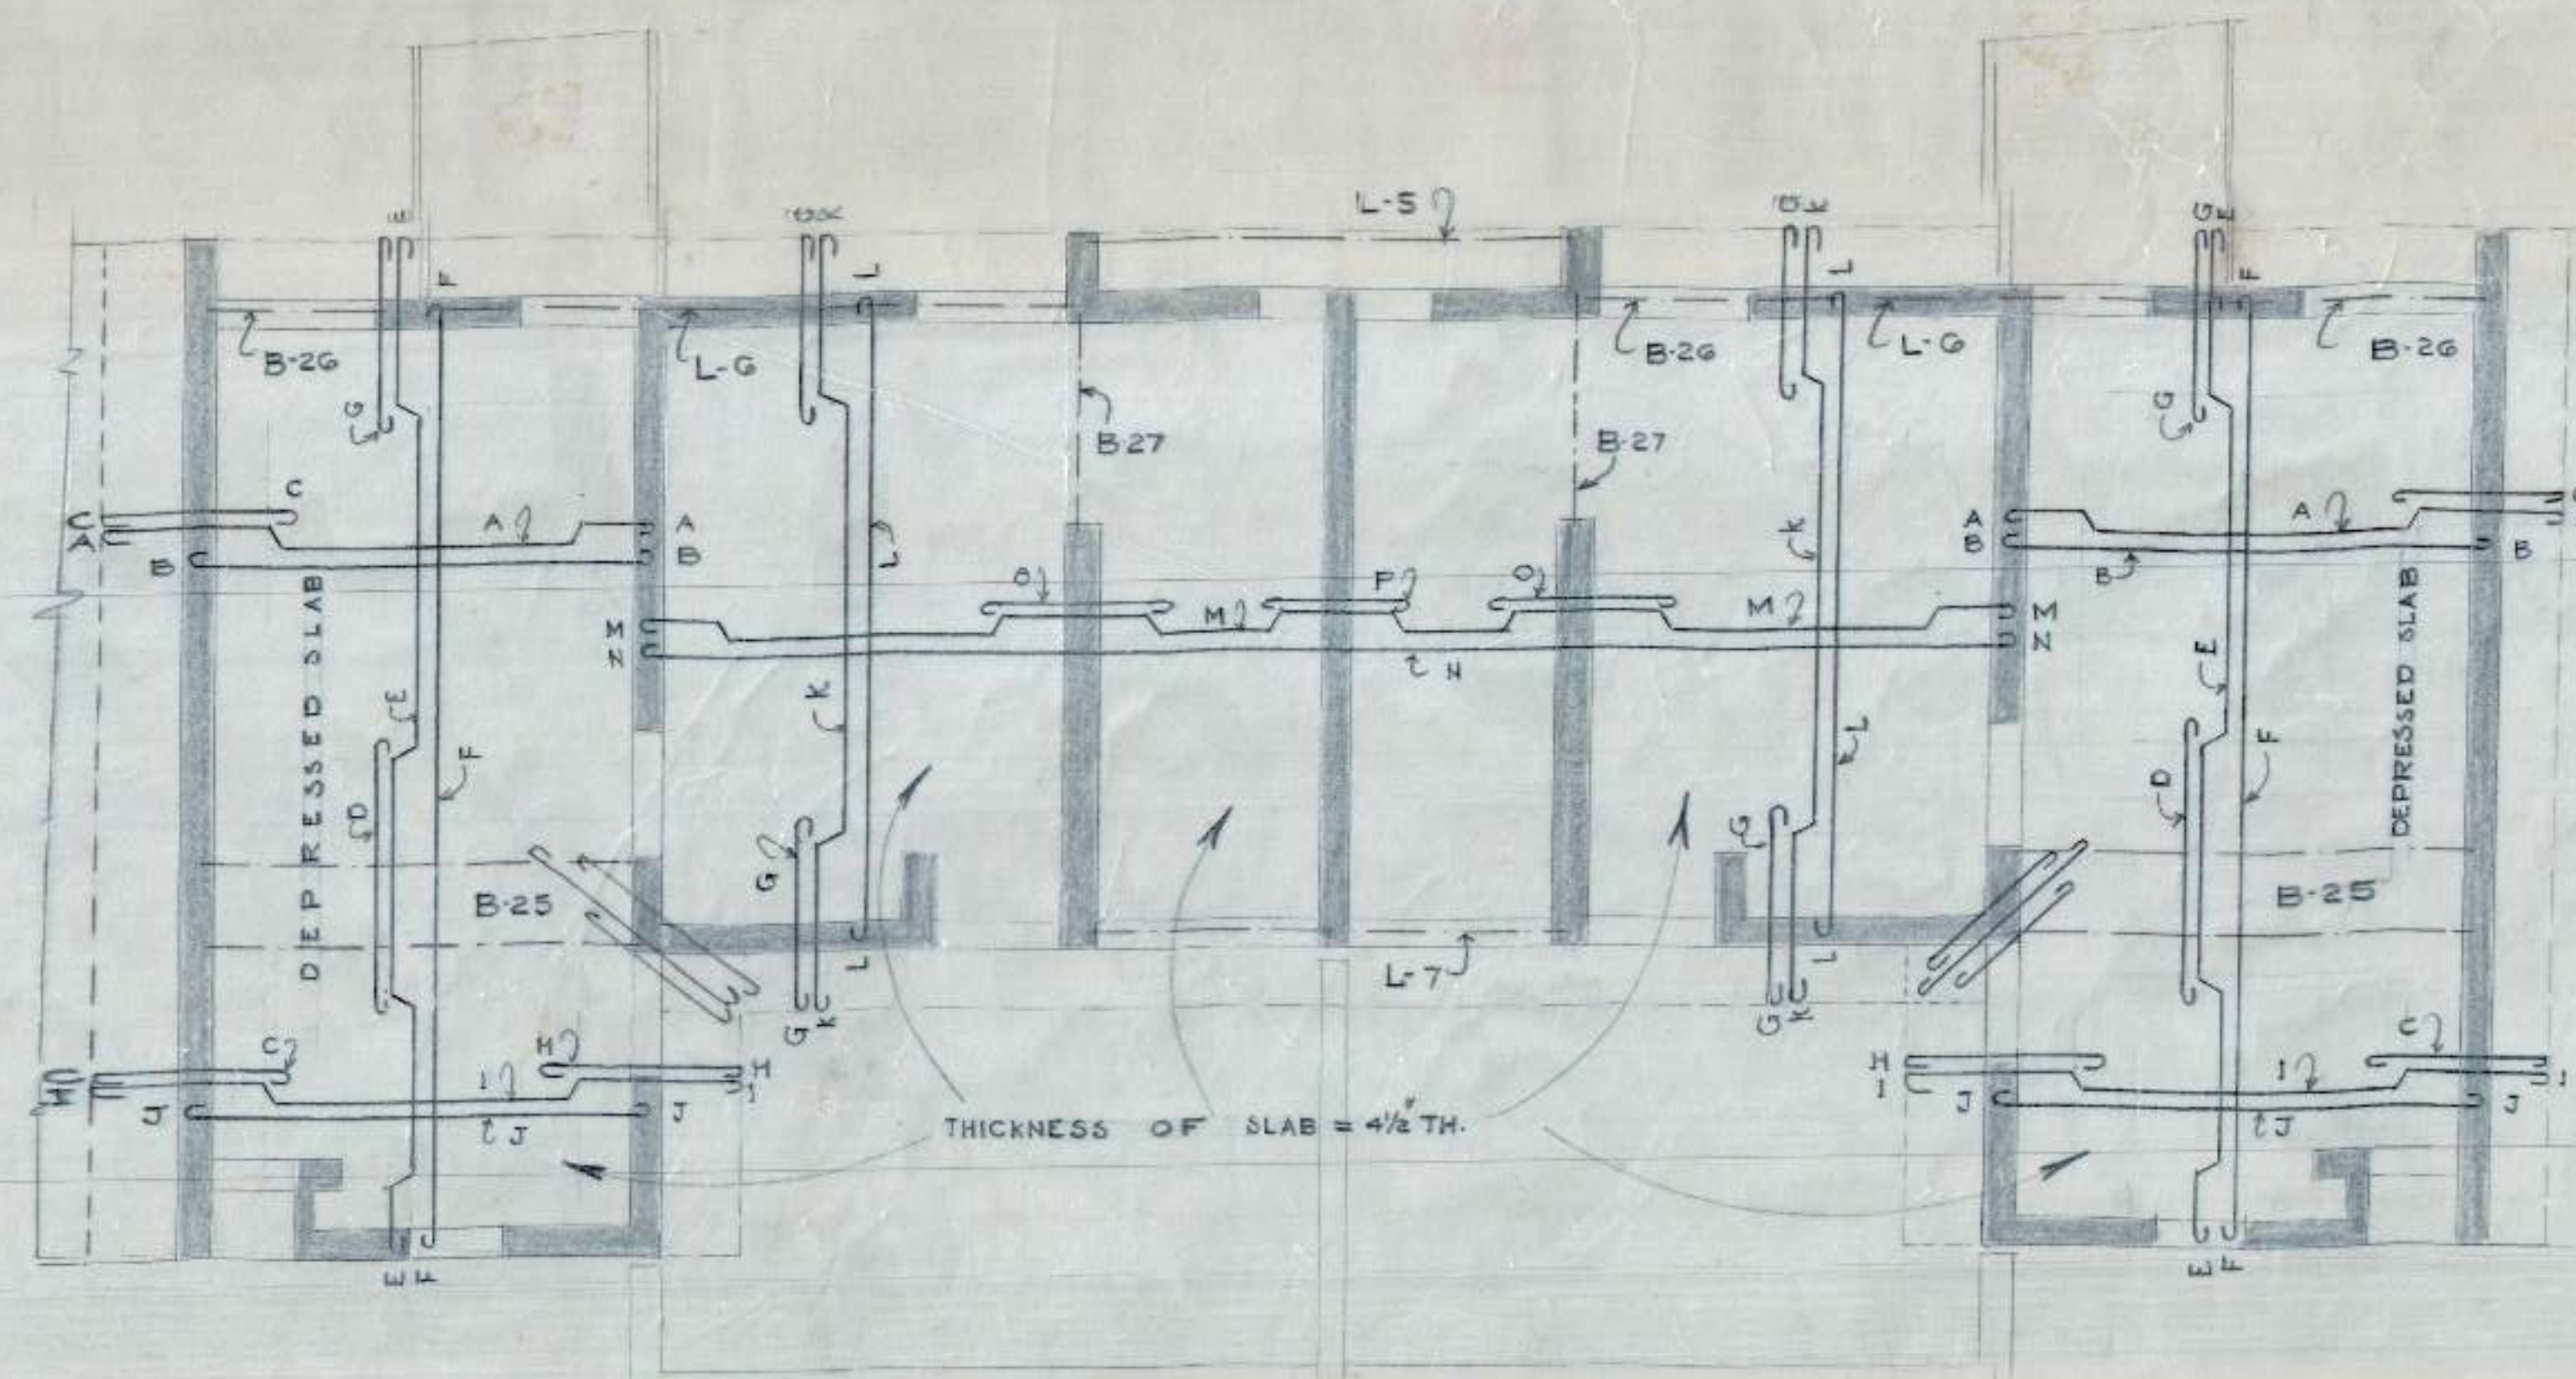

KEY PLAN (TOP FLOOR) SLAB 4 1/2" THICK



S.No.	NOTES.
1	FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG. NO. 36, 37, 38, 39.
2	FOR OTHER NOTES & REFERENCES REFER ST. DRG. NO. 2, JOB NO. 40.

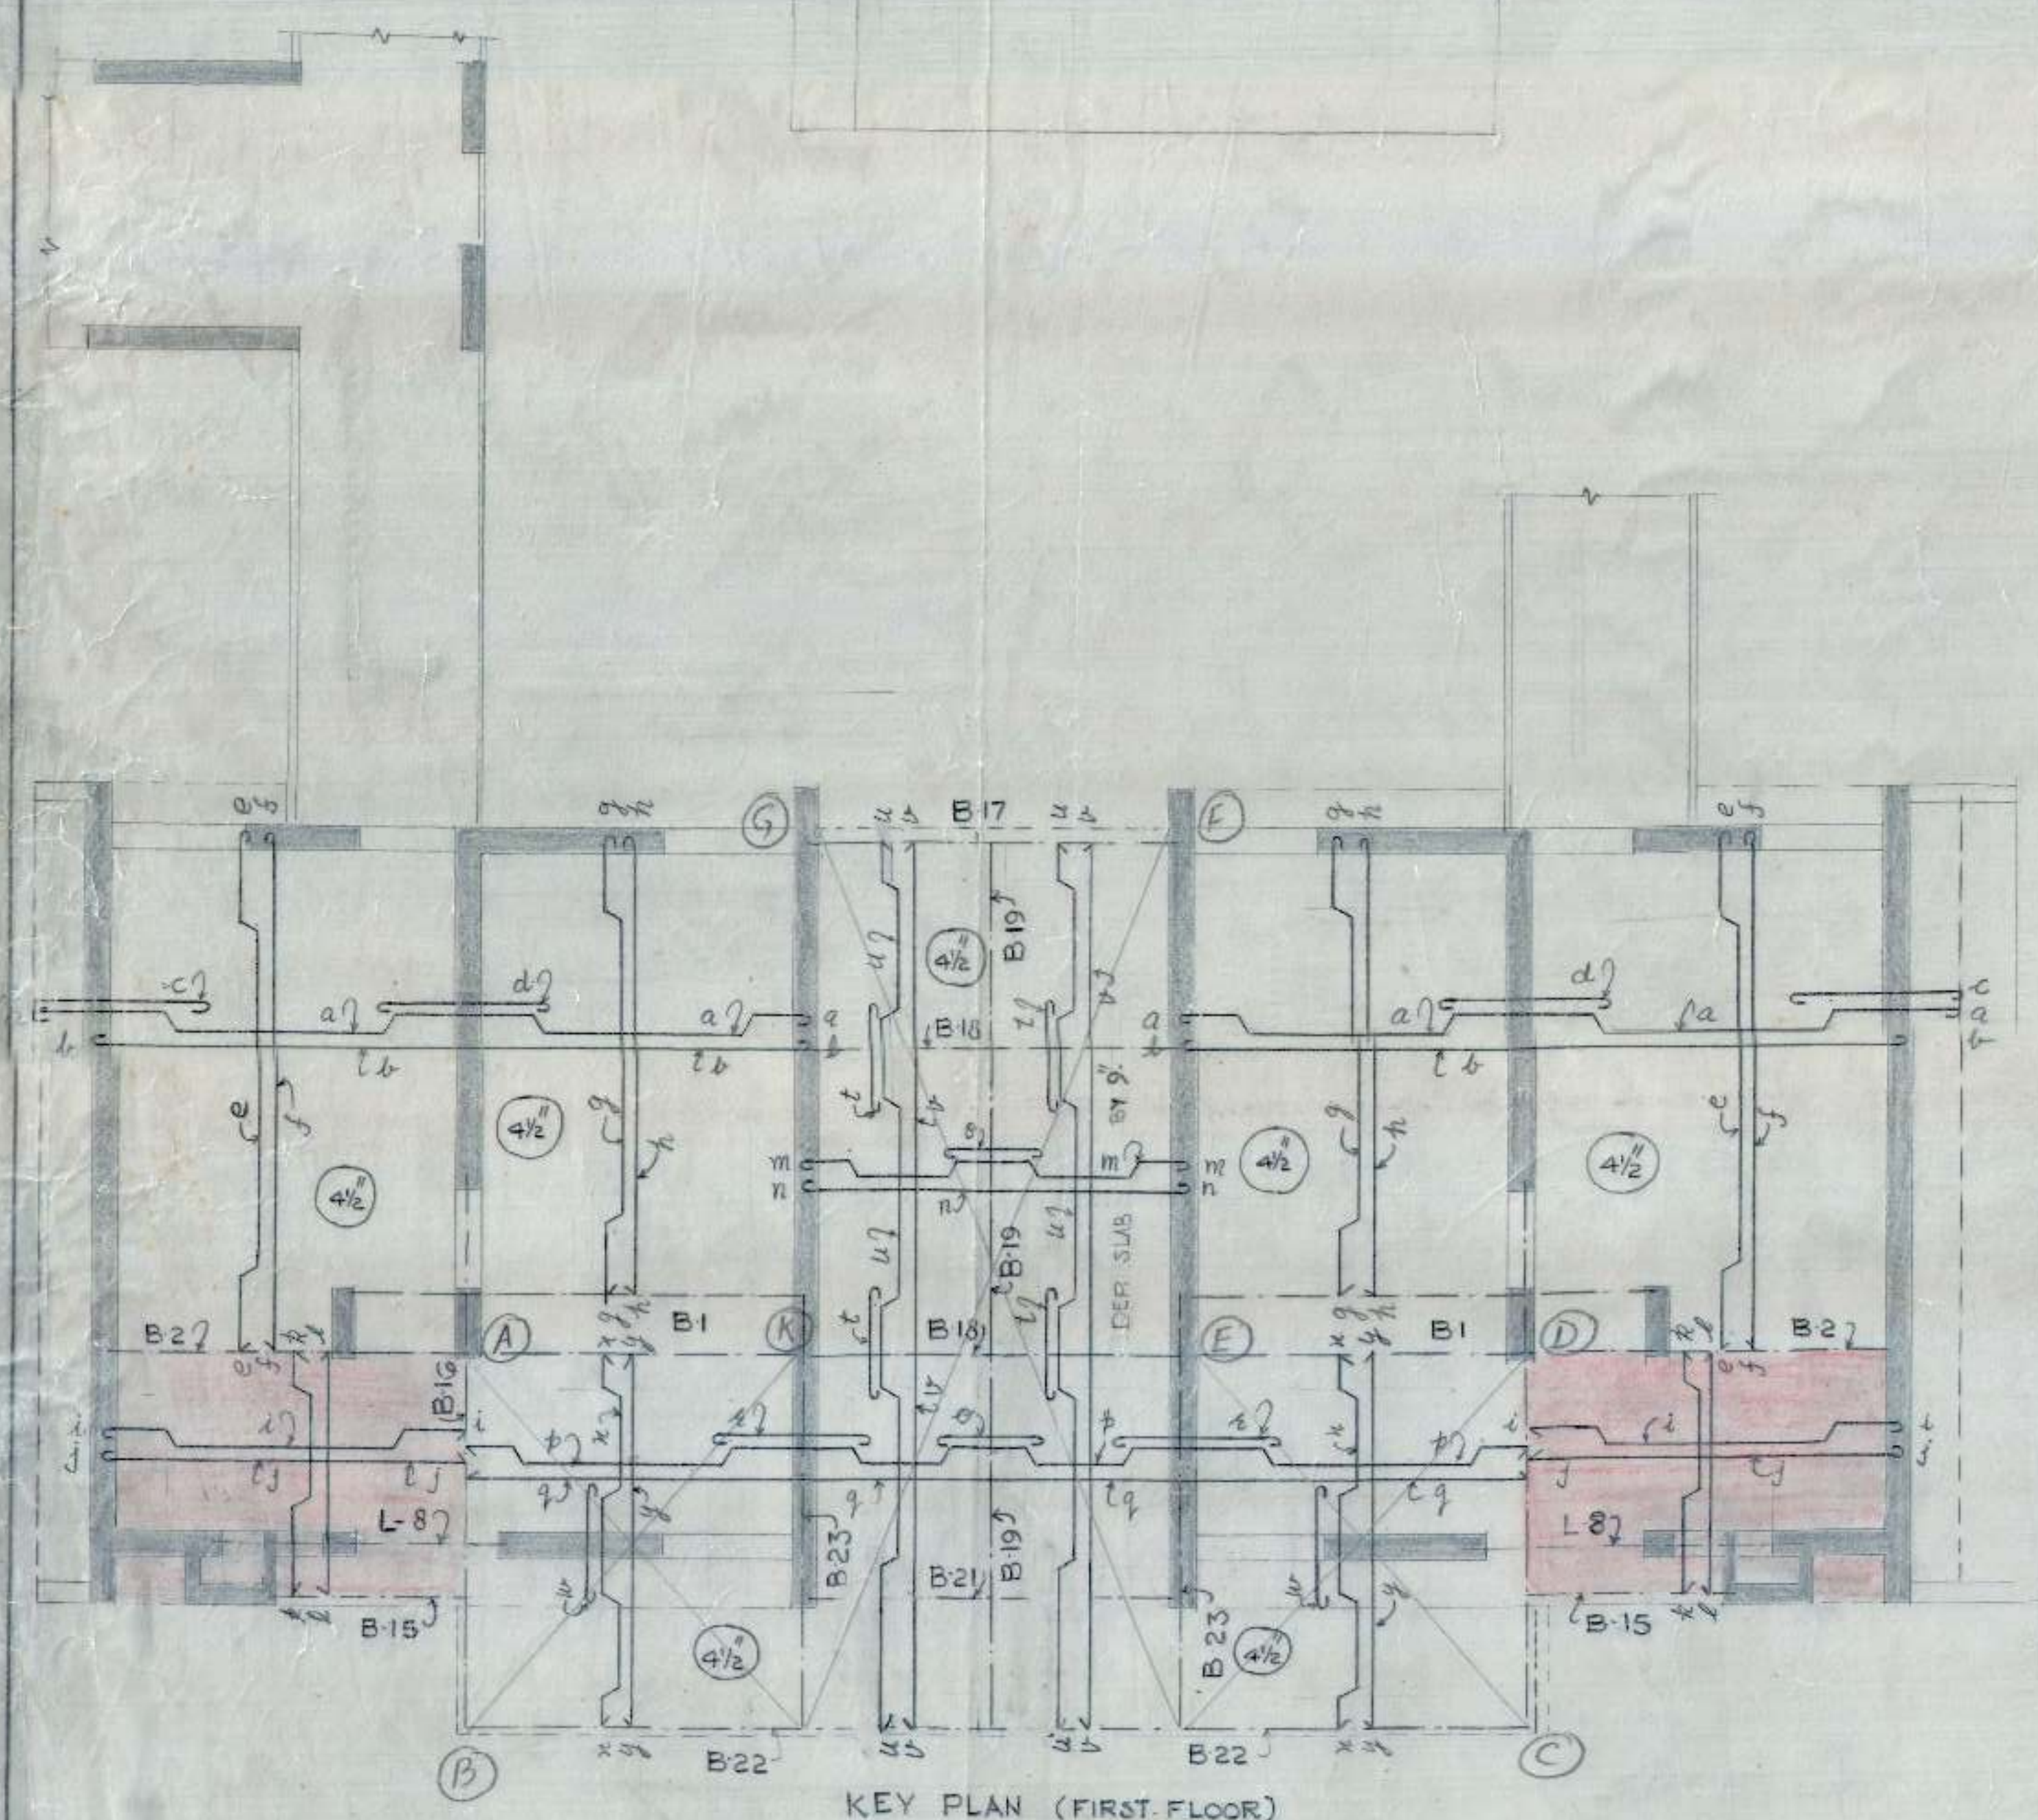

NOTE:- PORTION OF SLAB MARKED AS (A-B-C-D-E-F-G-H-I) IS DEPRESSED BY 9" W.R.T. MAIN SLAB.

SCHEDULE OF BARS IN SLAB AT F.F.					
A	10	mm	φ	12"	1/4
B	10	mm	φ	12"	1/4
C	10	mm	φ	12"	1/4
D	10	mm	φ	12"	1/4
E	10	mm	φ	12"	1/4
F	8	mm	φ	15"	1/4
G	8	mm	φ	15"	1/4
H	8	mm	φ	15"	1/4
I	8	mm	φ	15"	1/4
J	8	mm	φ	15"	1/4
K	8	mm	φ	15"	1/4
L	8	mm	φ	15"	1/4
M	8	mm	φ	15"	1/4
N	8	mm	φ	15"	1/4
O	8	mm	φ	15"	1/4
P	8	mm	φ	15"	1/4
Q	8	mm	φ	15"	1/4
R	8	mm	φ	15"	1/4
S	8	mm	φ	15"	1/4
T	8	mm	φ	15"	1/4
U	8	mm	φ	15"	1/4
V	8	mm	φ	15"	1/4
W	8	mm	φ	15"	1/4
X	8	mm	φ	15"	1/4
Y	8	mm	φ	15"	1/4
Z	8	mm	φ	15"	1/4

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH.		
DRN BY <i>Atul</i>	M.I.G TWO ROOM	DRG No 11
SCALE 1/4" = 1'-0"	DETAIL OF REINFOR- CEMENT IN SLAB AT F.F. & TOP FL. GROUP-B	JOB No 40
A.E.D. <i>17/2/76</i>	E.E-1 <i>17/2/76</i>	SE/HB

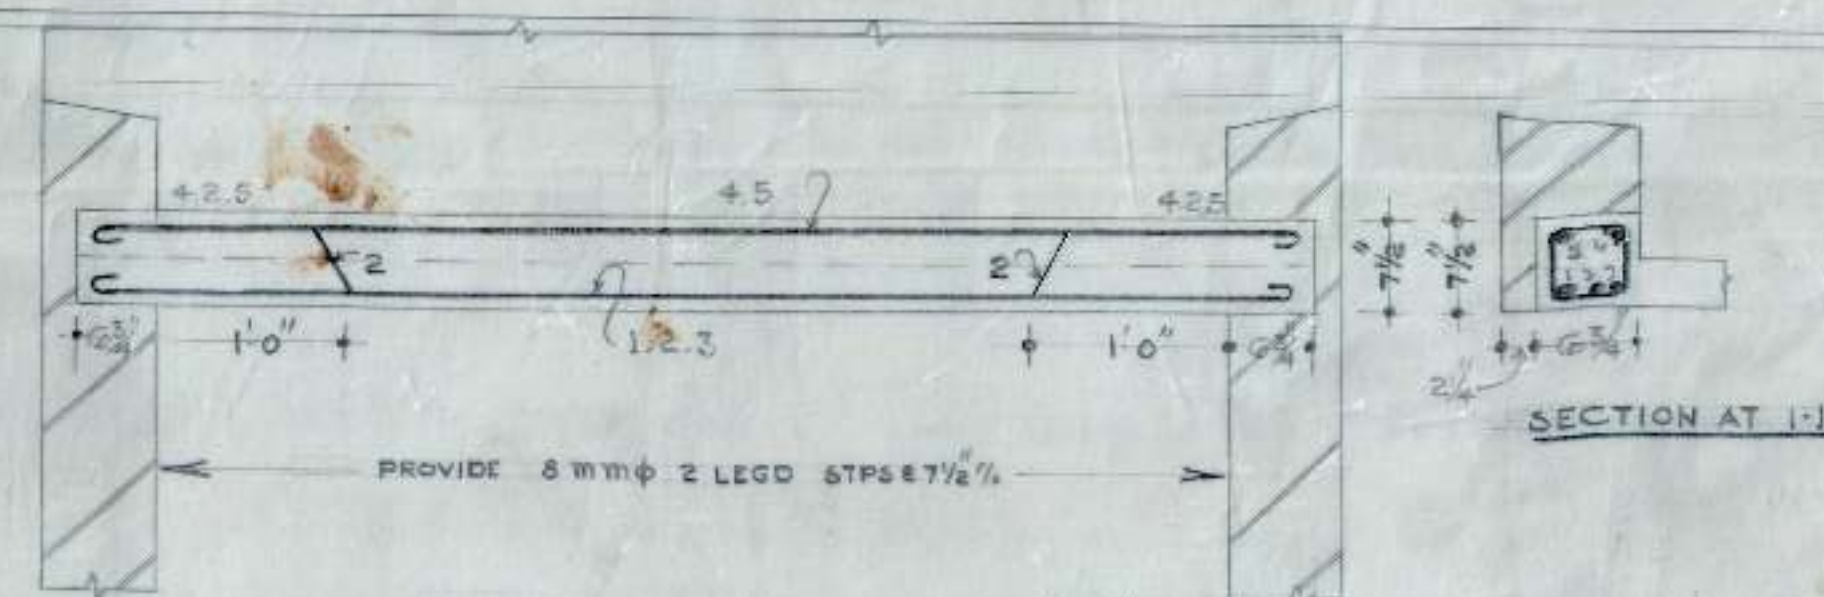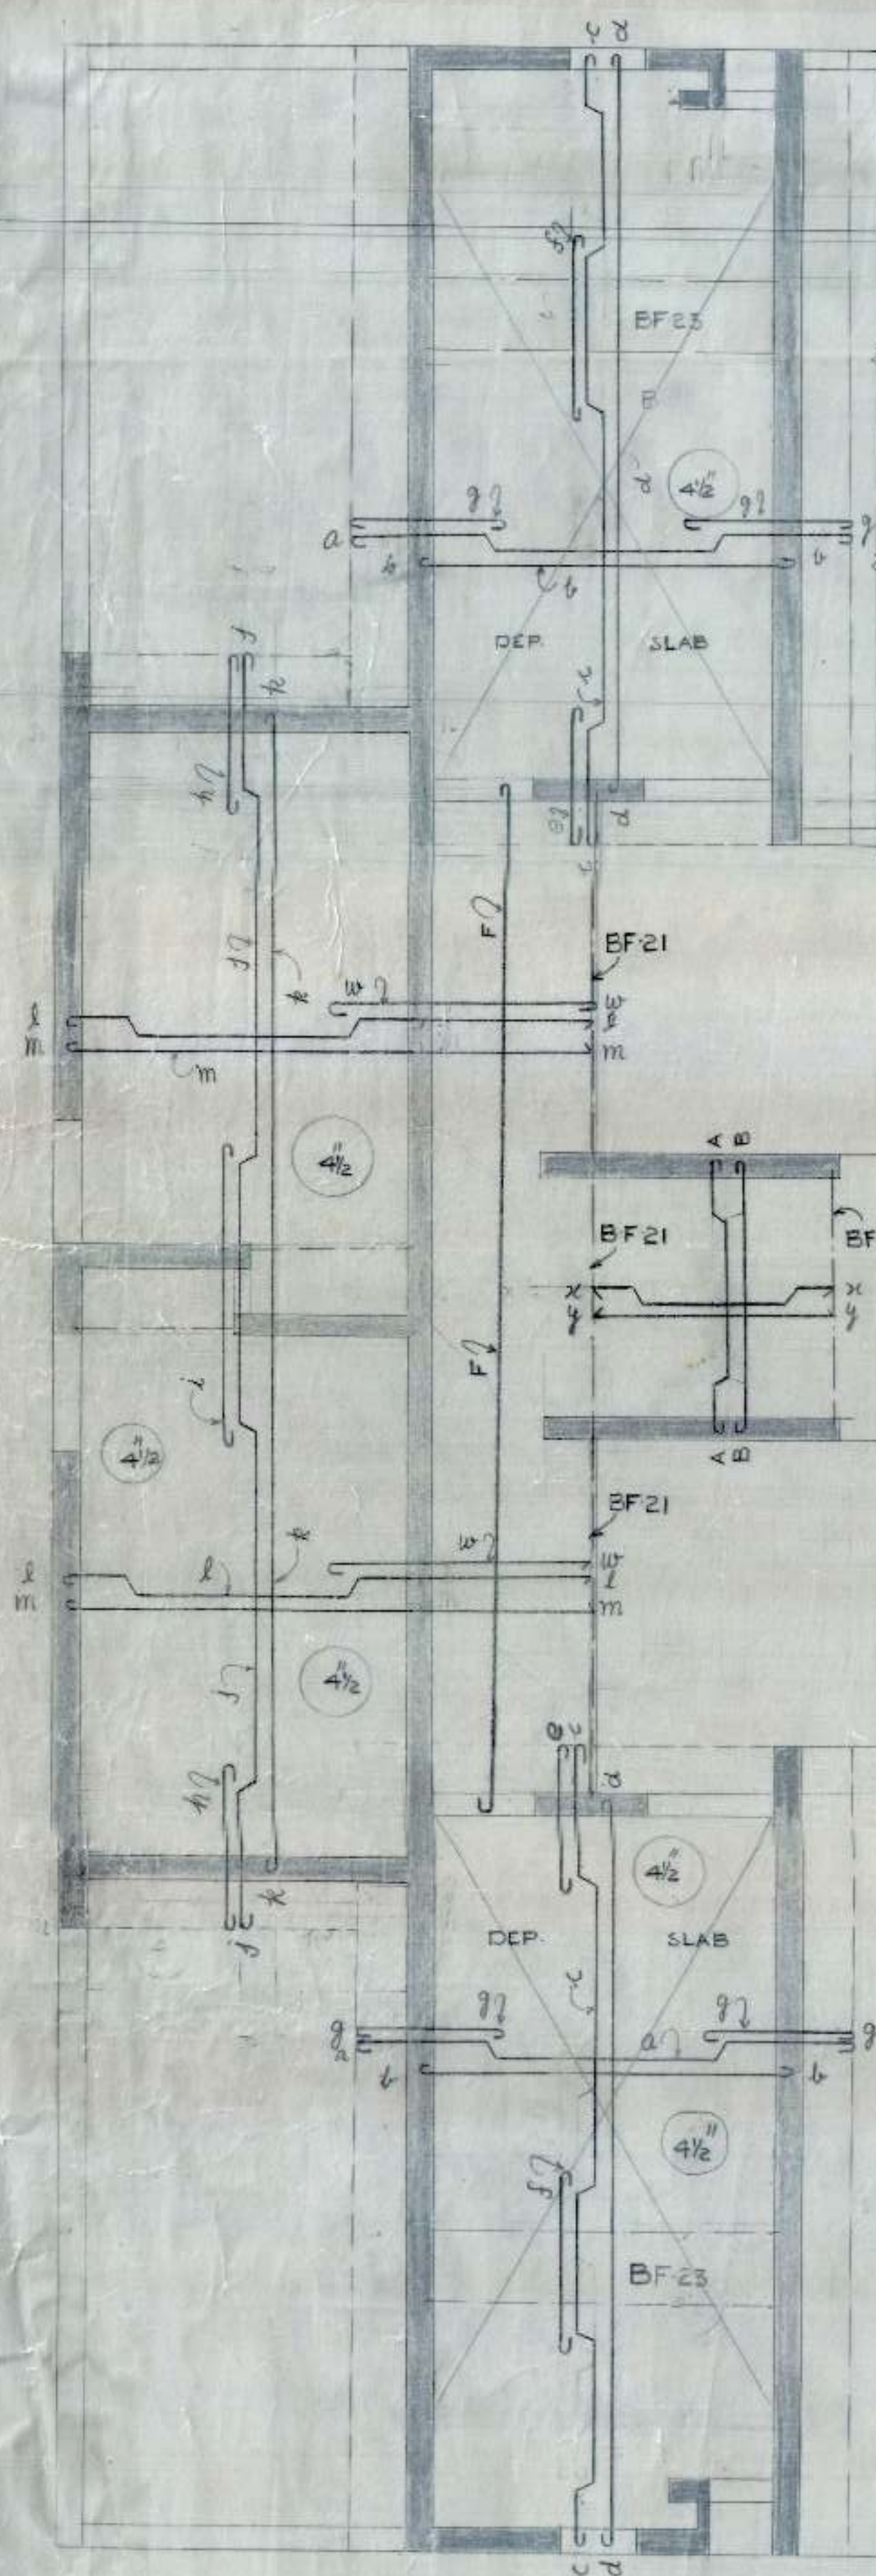

L-SECTION OF BEAM BF26 (2 3/4 x 7 1/2)


SECTION AT 1-1

SCHEDULE OF BARS IN BF26

1. 3	12 mm
2. 4. 5	10 mm

SCHEDULE OF BARS IN SLAB														
a	12 mm	φ	ⓔ	12" 9/16	k	8 mm	φ	ⓔ	14" 9/16	u	10 mm	φ	ⓔ	14" 9/16
b	10 mm	φ	ⓔ	12" 9/16	l	12 mm	φ	ⓔ	14" 9/16	v	8 mm	φ	ⓔ	14" 9/16
c	12 mm	φ	ⓔ	14" 9/16	m	10 mm	φ	ⓔ	14" 9/16	w	8 mm	φ	ⓔ	14" 9/16
d	10 mm	φ	ⓔ	14" 9/16	n	12 mm	φ	ⓔ	14" 9/16	x	10 mm	φ	ⓔ	15" 9/16
e	10 mm; SO THAT (2+c) MAKES A NET PITCH OF 15" 9/16 = 5" 9/16				o	10 mm	φ	ⓔ	14" 9/16	y	8 mm	φ	ⓔ	15" 9/16
f	10 mm	φ	ⓔ	14" 9/16	p	10 mm	φ	ⓔ	12" 9/16	z	10 mm; SO THAT (3+b) MAKES A NET PITCH OF 4" 9/16			
g	10 mm; SO THAT (4-b) MAKES A NET PITCH OF 4" 9/16				q	10 mm	φ	ⓔ	12" 9/16	A	10 mm	φ	ⓔ	15" 9/16
h	10 mm; SO THAT (3+h) MAKES A NET PITCH OF 4" 9/16				r	12 mm	φ	ⓔ	12" 9/16	B	8 mm	φ	ⓔ	15" 9/16
i	10 mm	φ	ⓔ	16" 9/16	s	8 mm	φ	ⓔ	14" 9/16	C	8 mm	φ	ⓔ	15" 9/16
j	8 mm	φ	ⓔ	16" 9/16	t	10 mm	φ	ⓔ	14" 9/16	D	8 mm	φ	ⓔ	15" 9/16
					F	8 mm	φ	ⓔ	9" 9/16	E	8 mm	φ	ⓔ	15" 9/16

KEY PLAN

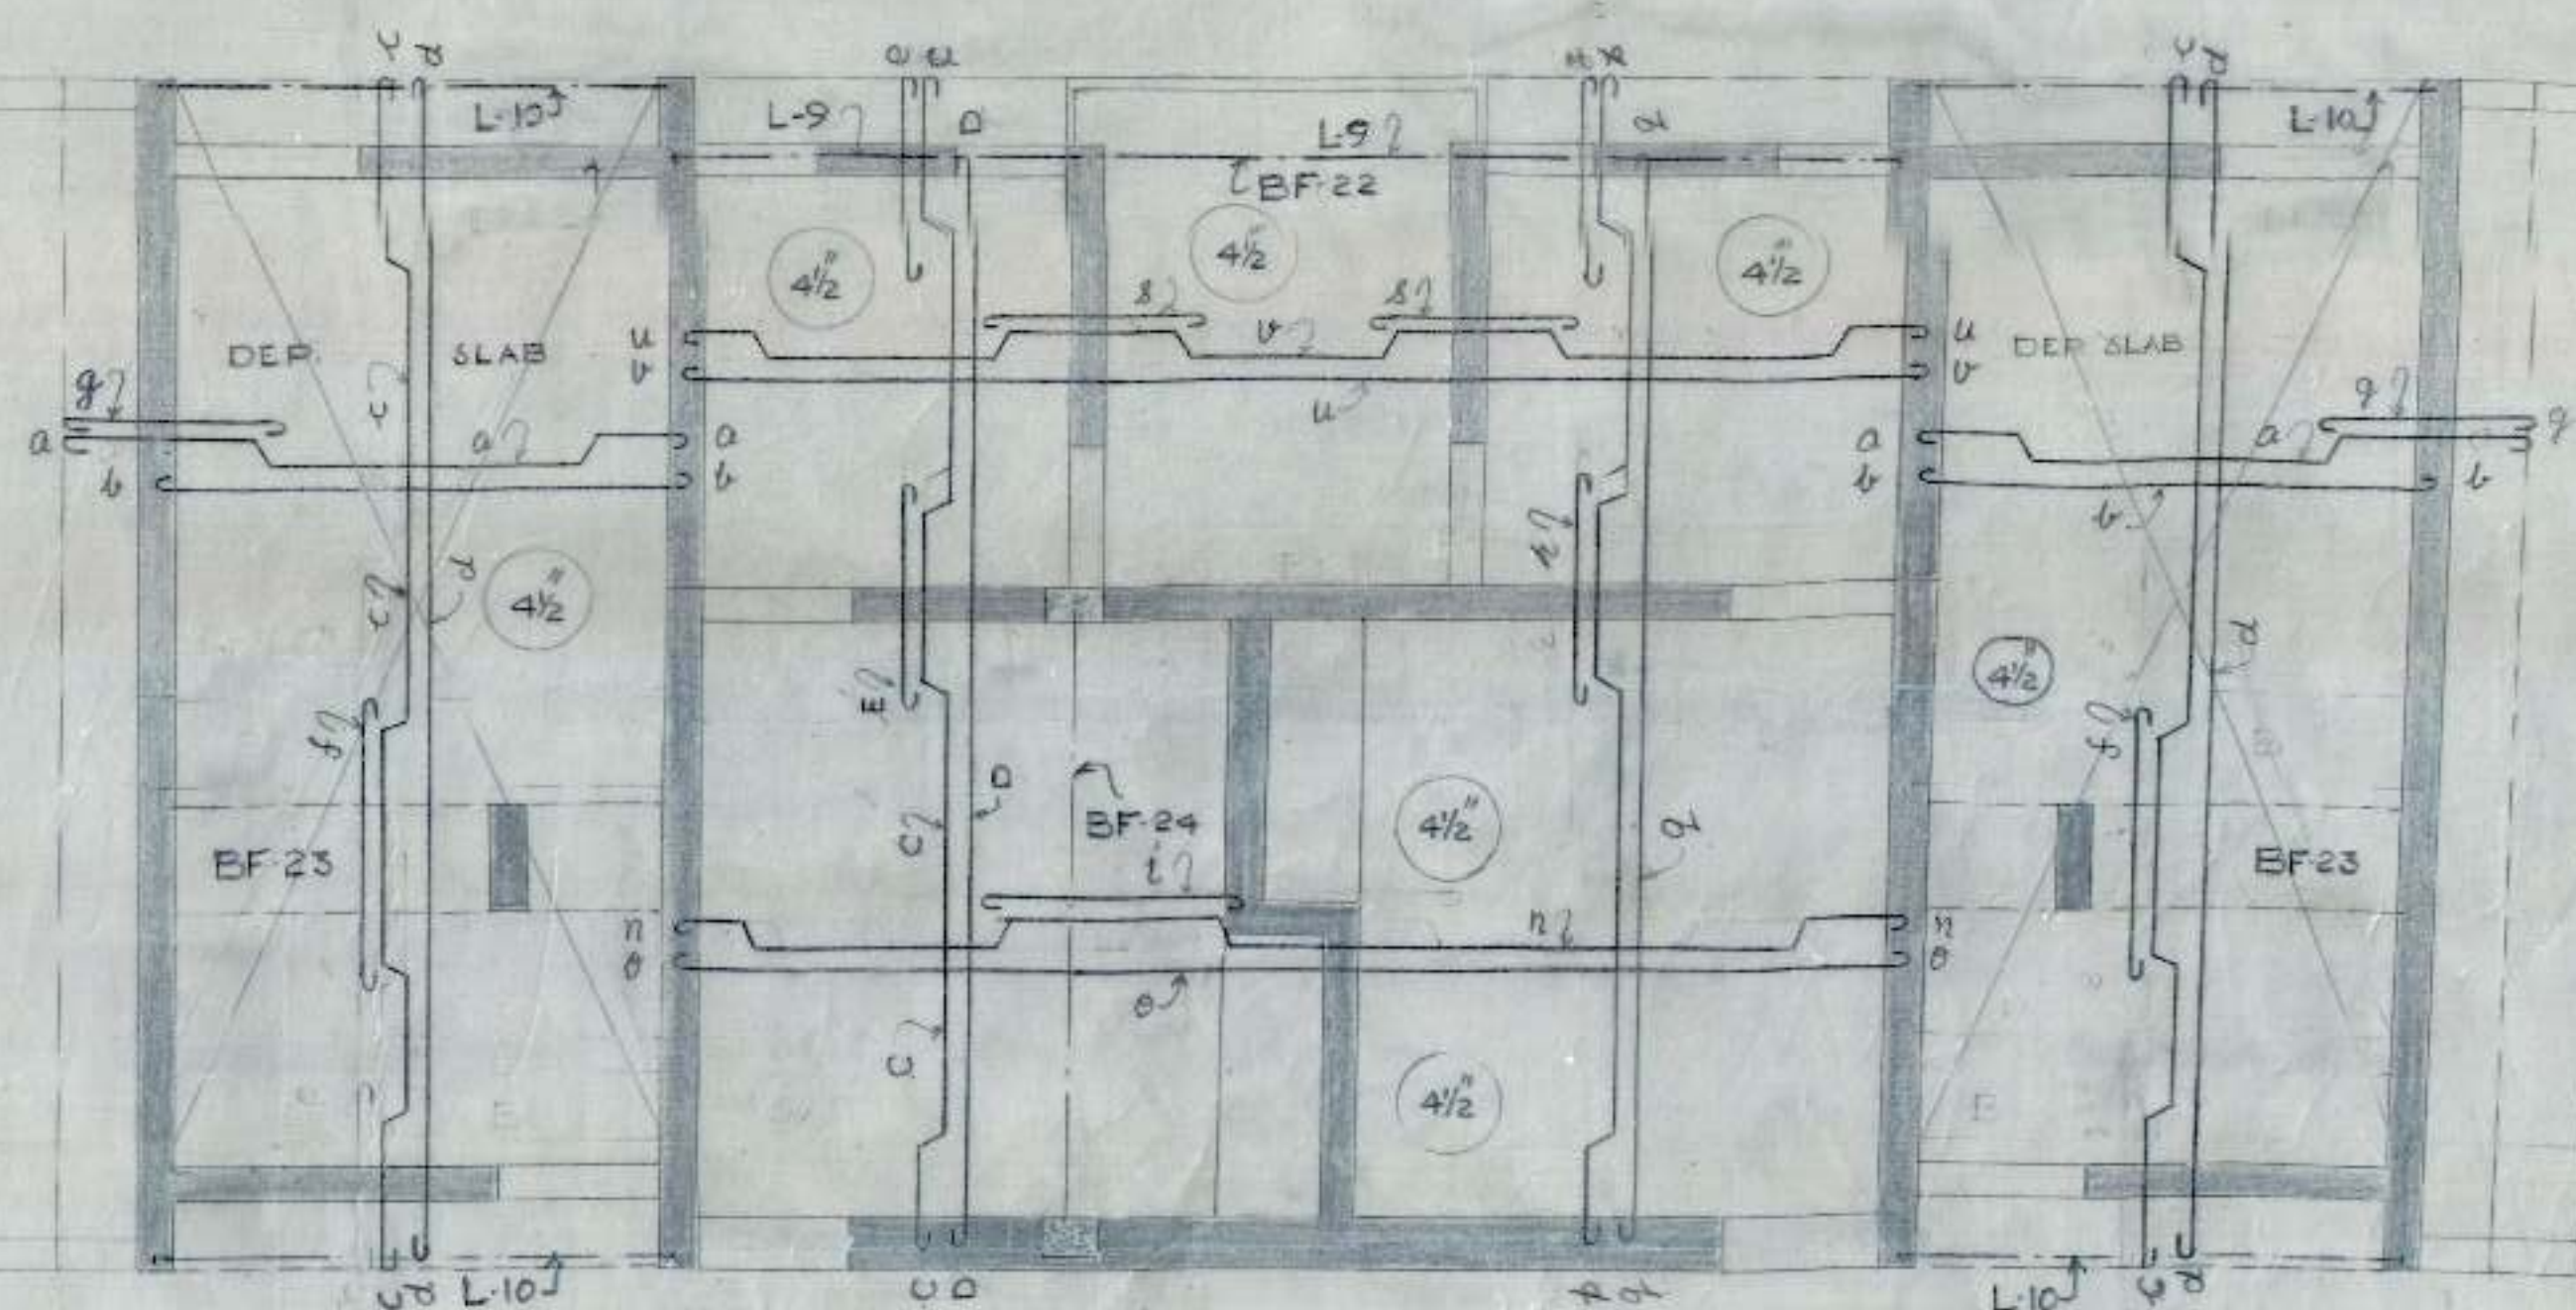

C.H.B



S.No	NOTES
1	FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG No. 27 JOB No. 79
2	FOR OTHER NOTES & REFERENCES REFER STR. DRG No. 2 JOB No.

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH



DRN BY	M.I.G TWO ROOM	DRG No
SCALE	DETAIL OF REINFORCE- MENT IN SLAB AT TOP FLOOR	JOB No
		12
		40

20.2.80
A.E.D. E.E-1 3/1/80 S.E.H.B



CHB

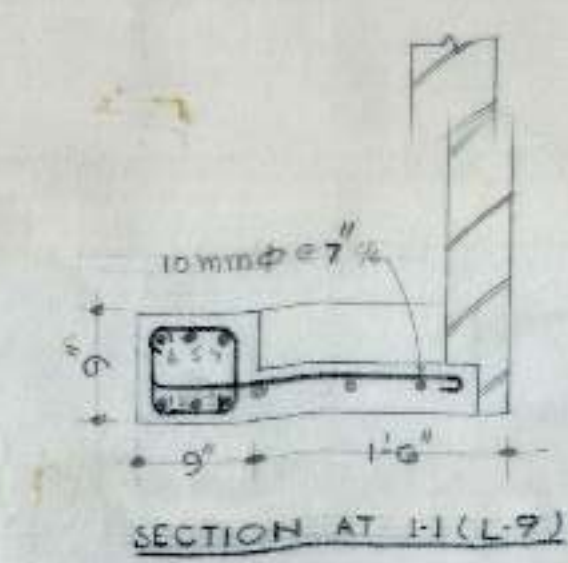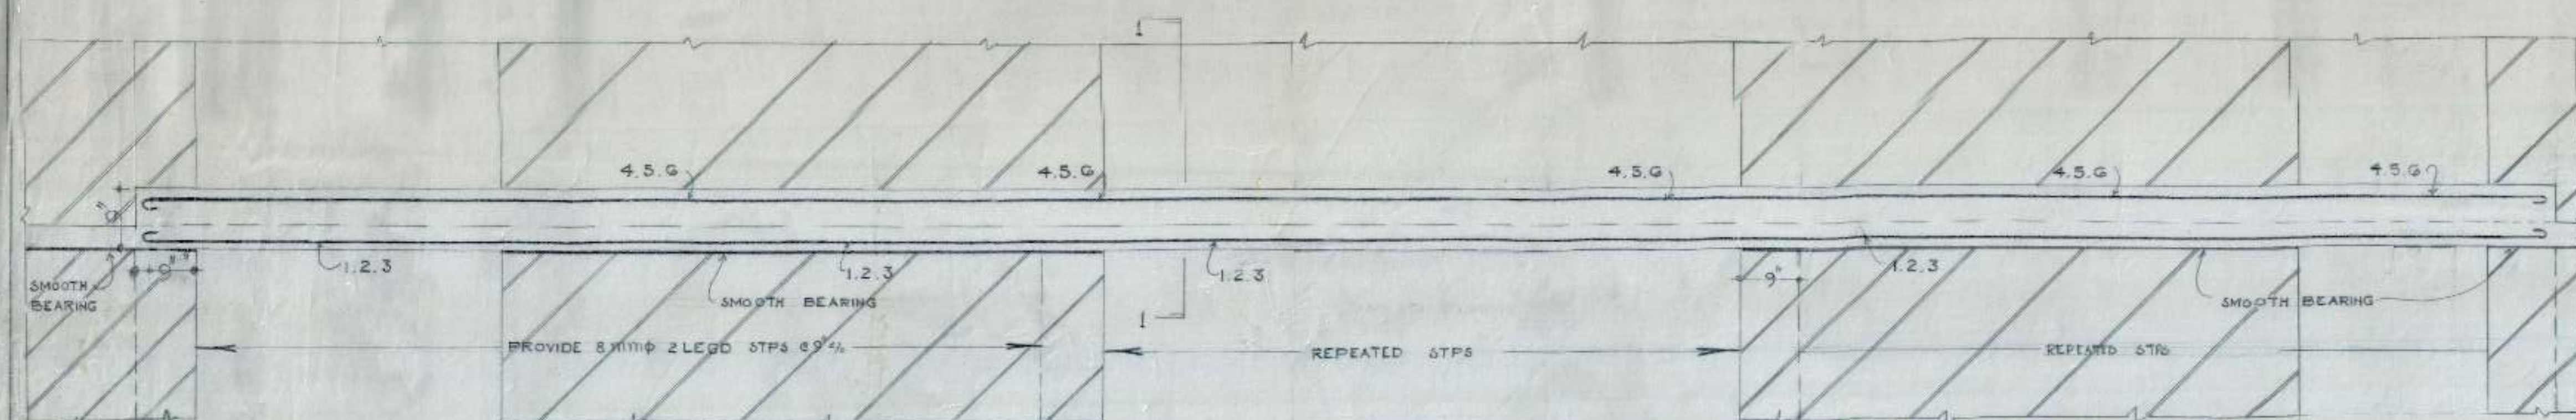


SCHEDULE OF BARS IN L9	
1.3, 4.5	10 mm ϕ
2.5	12 mm ϕ

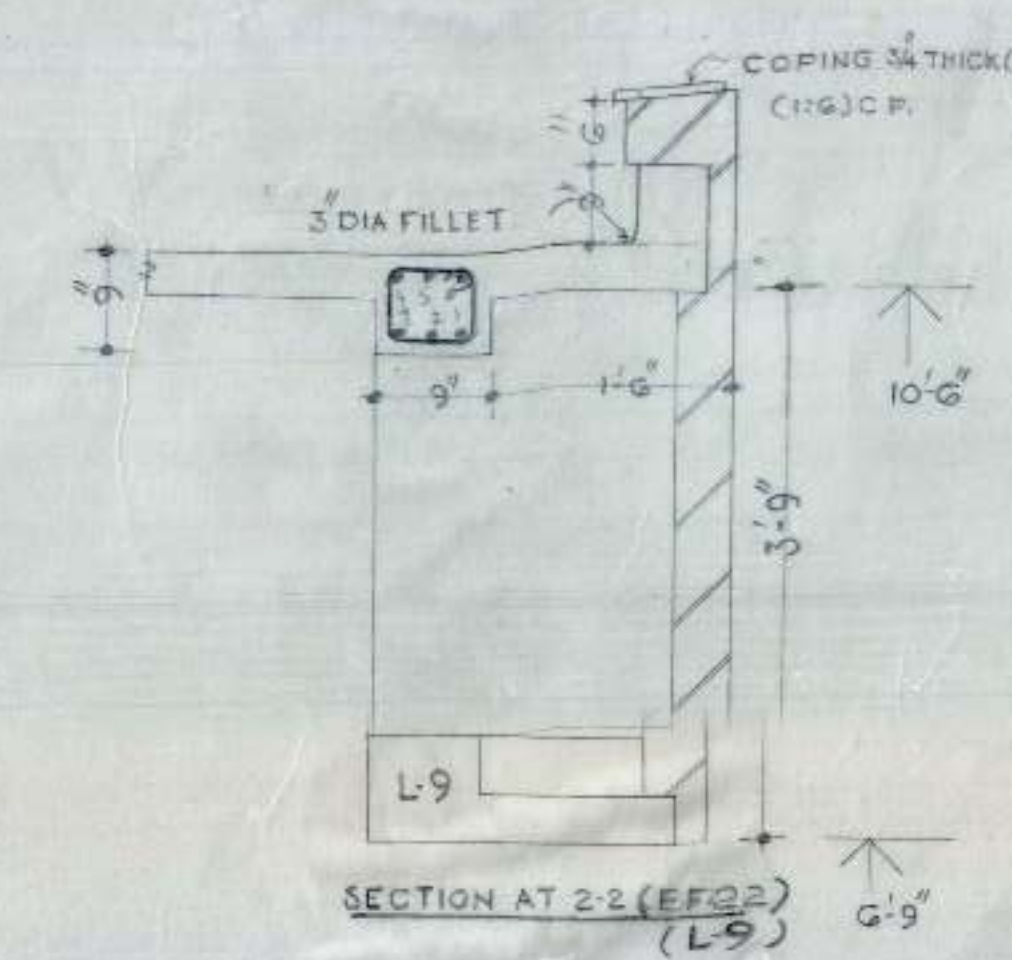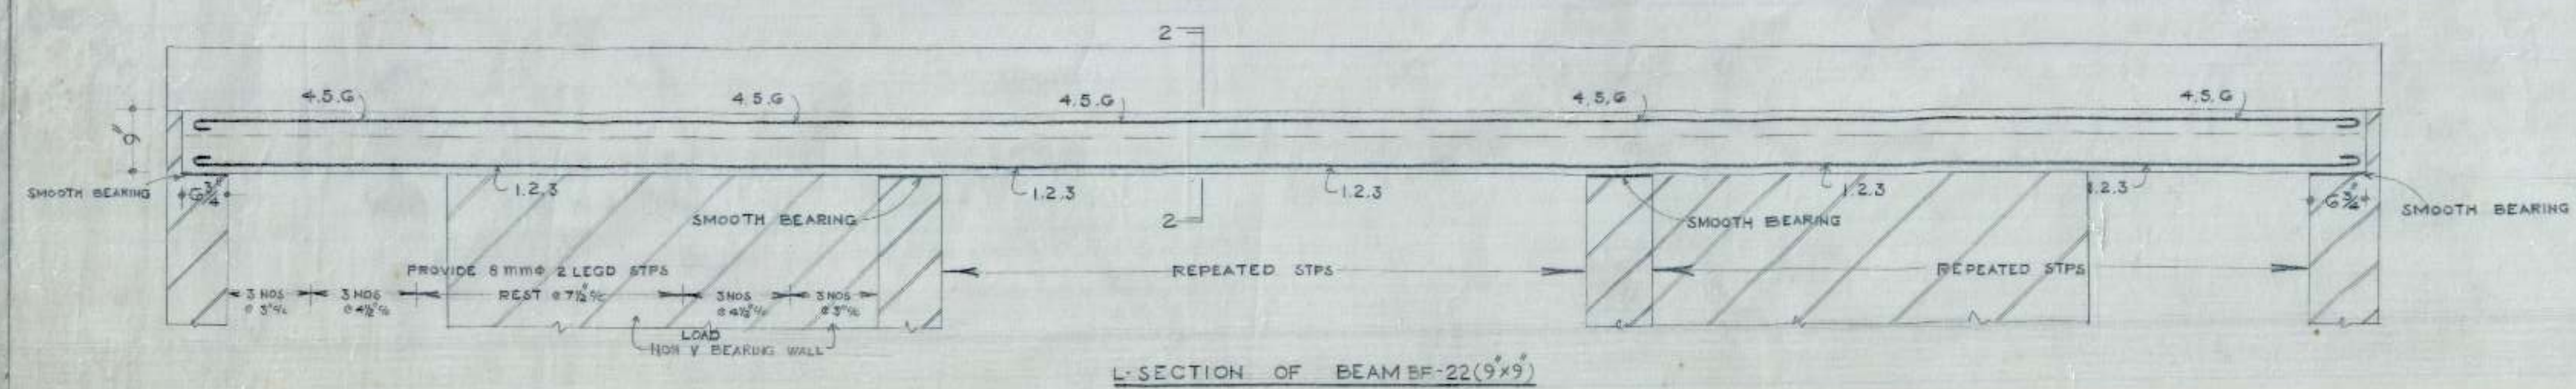



SCHEDULE OF BARS IN BF-22	
1.3, 4.5	10 mm ϕ
2.5	12 mm ϕ

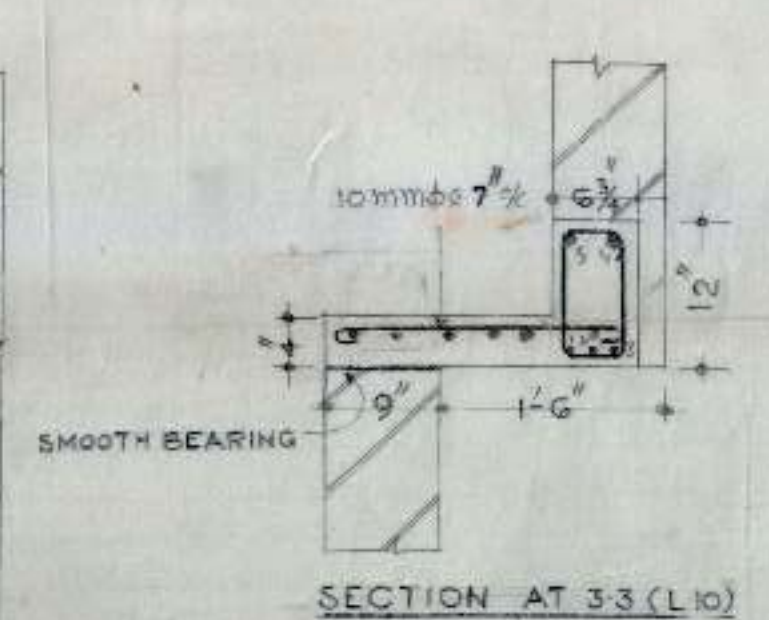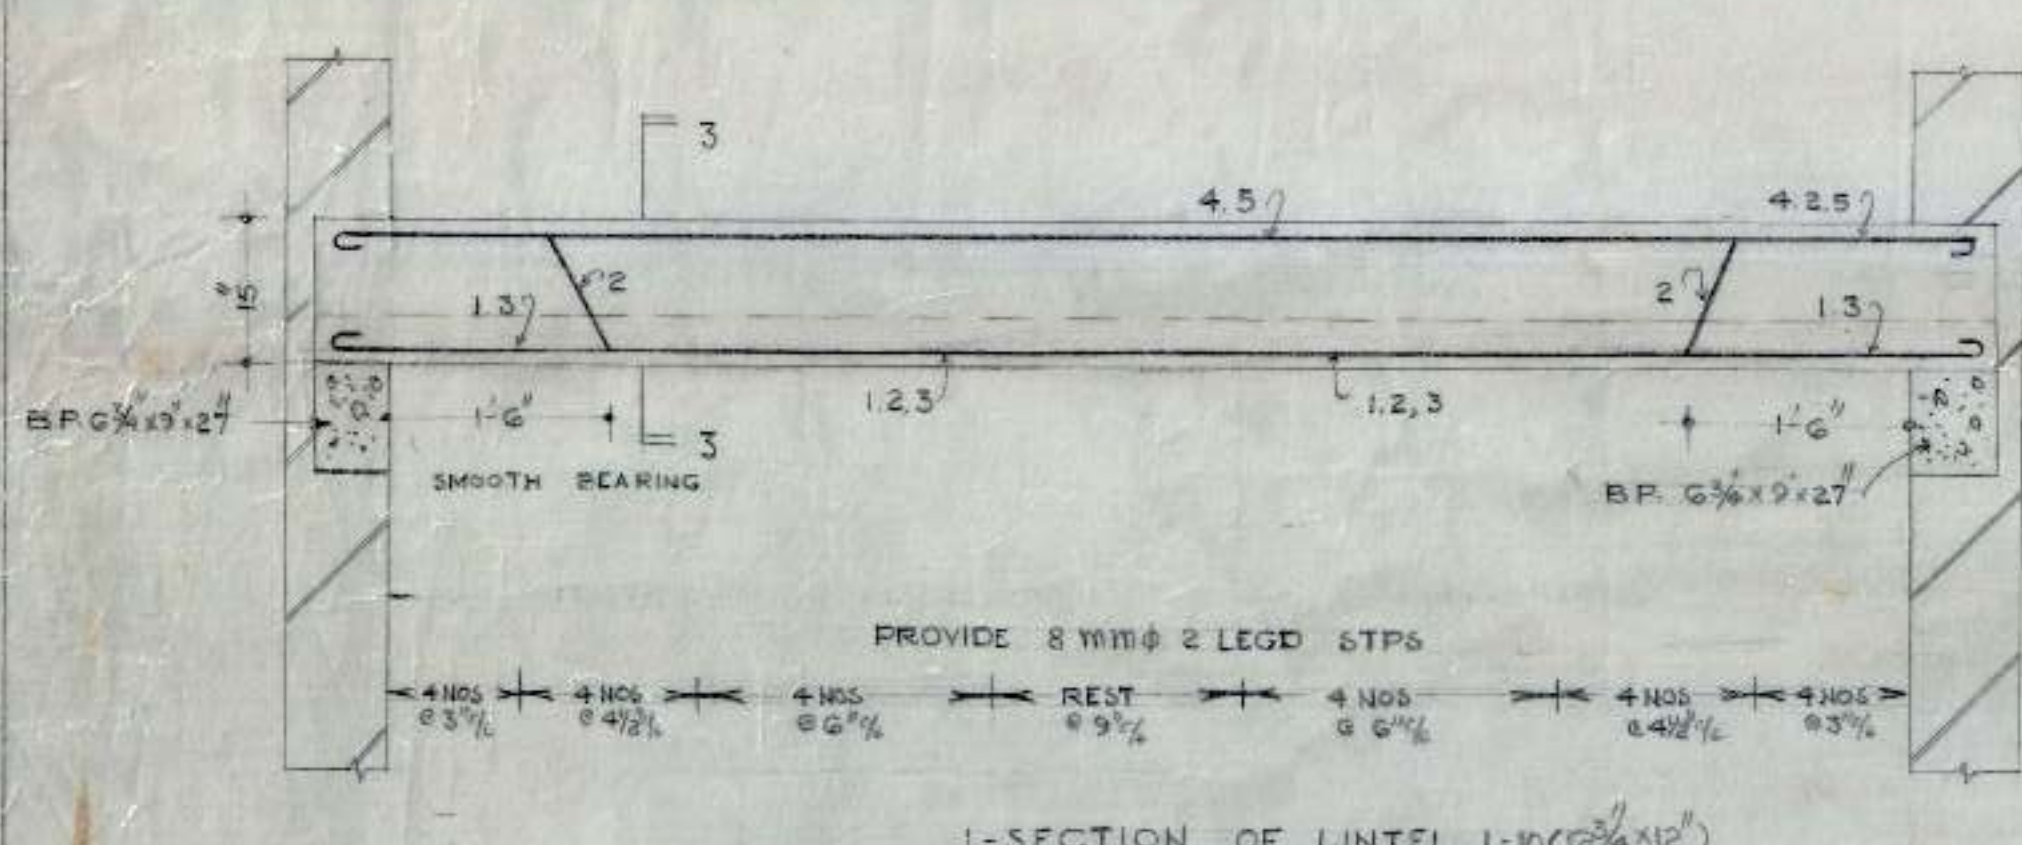




SCHEDULE OF BARS IN L10	
4.5	12 mm ϕ
1.2.3	10 mm ϕ

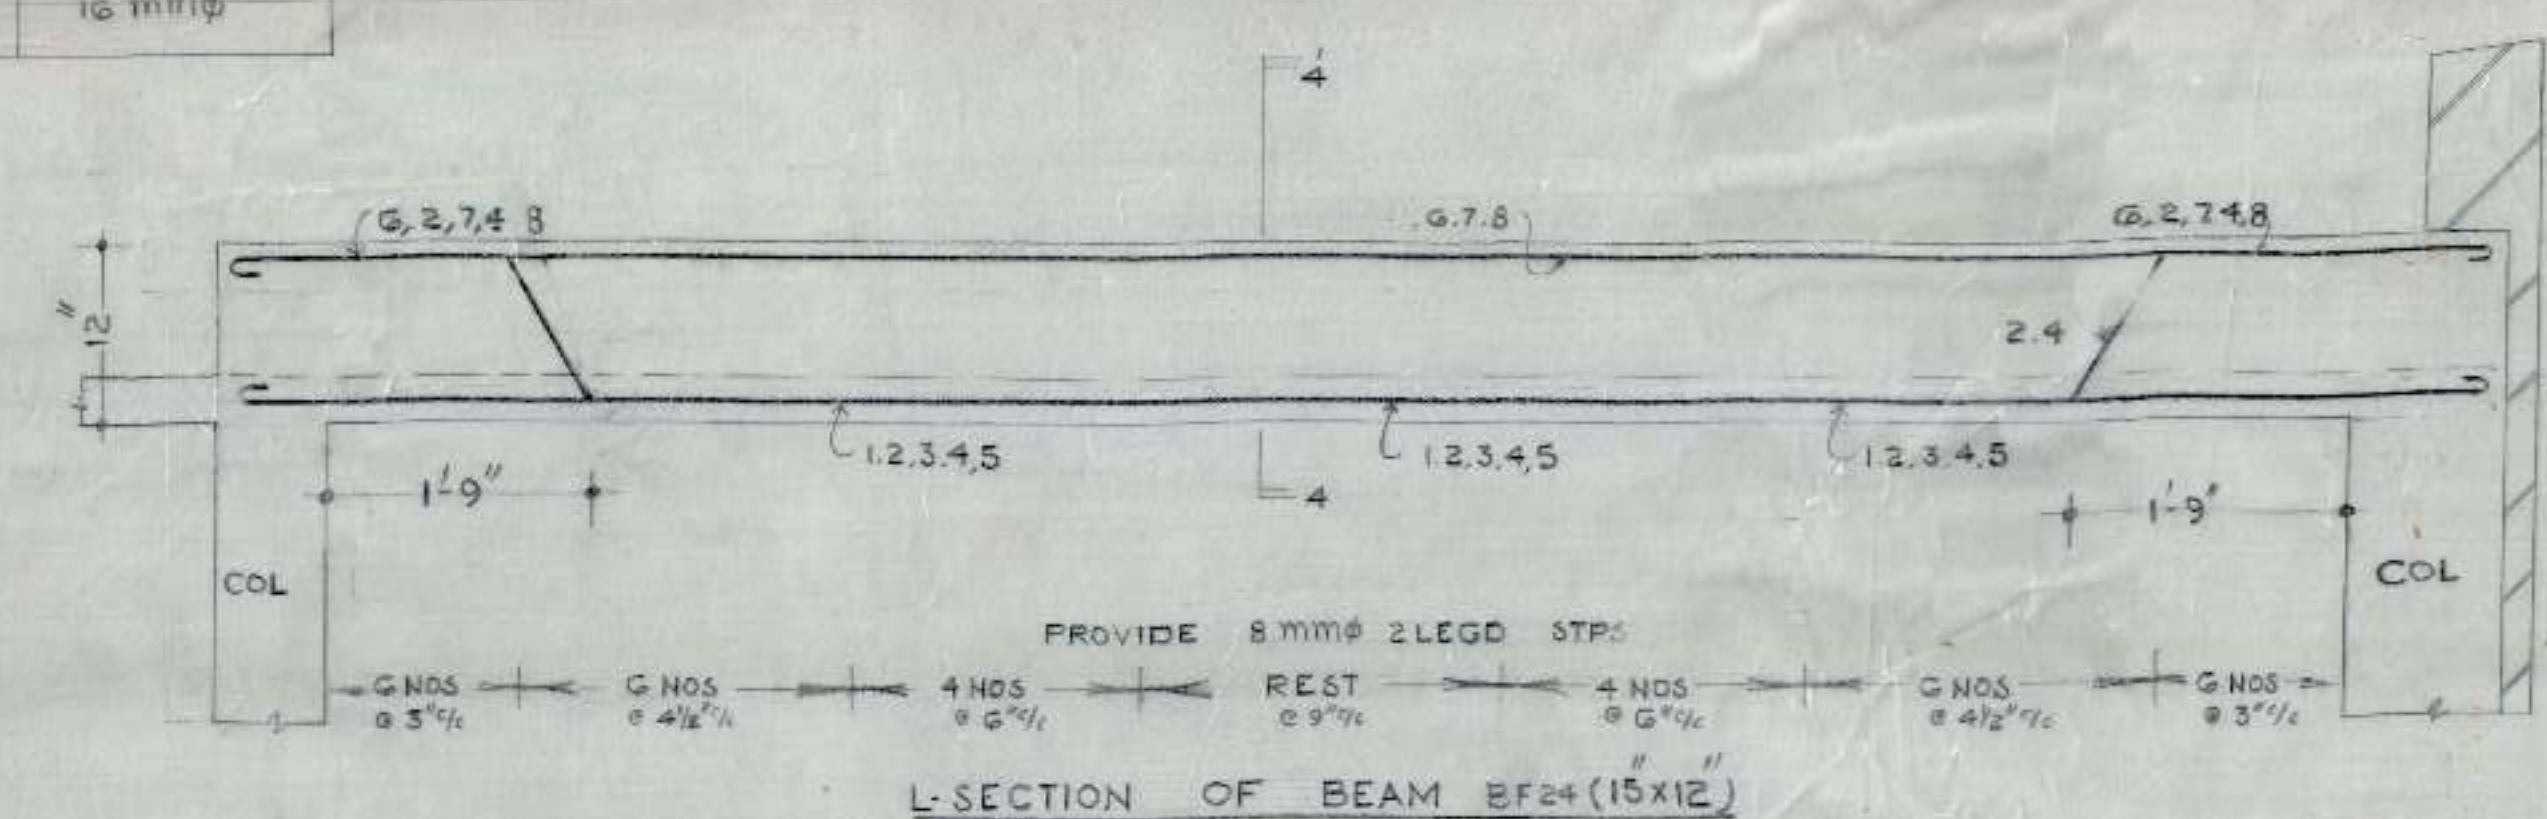

SCHEDULE OF BARS IN BF-24	
1 TO 8	10 mm ϕ
9	12 mm ϕ

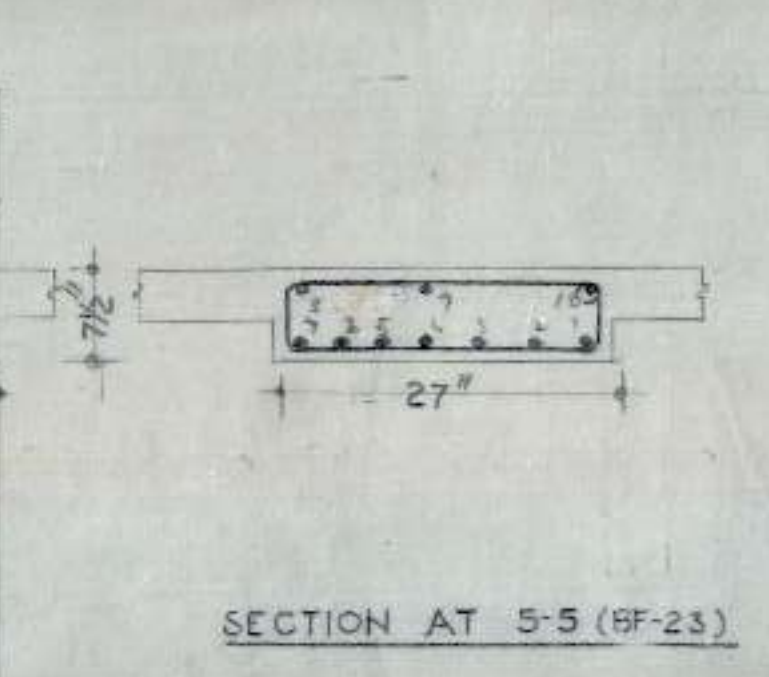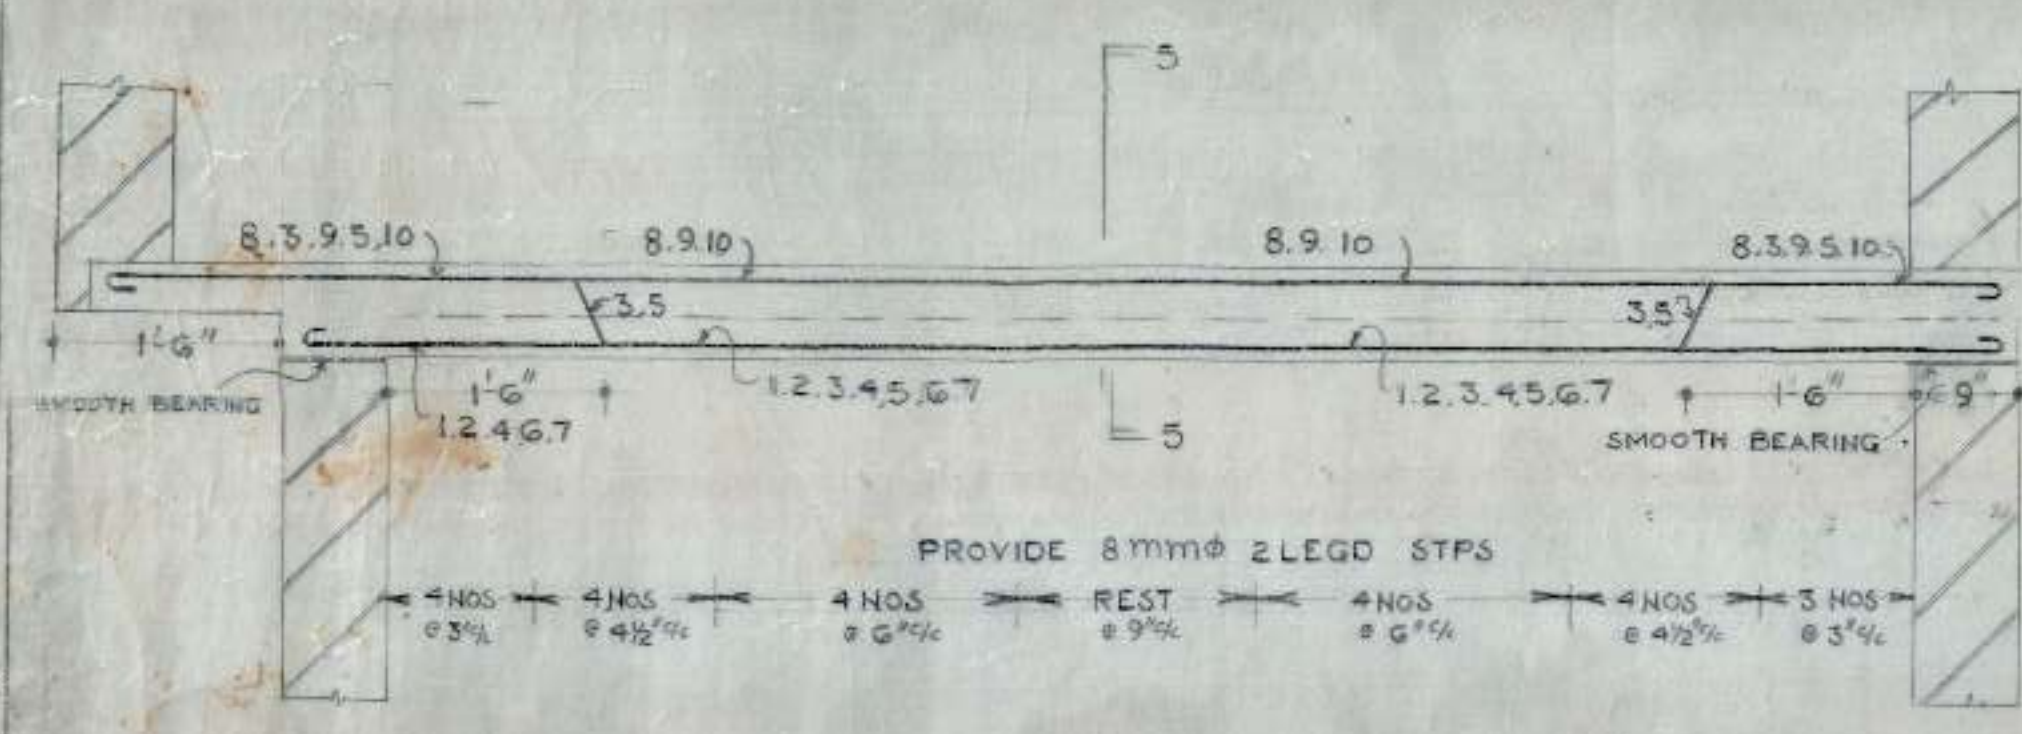

SCHEDULE OF BARS IN BF-23	
1.2.3, 5.6.7, 8.10	10 mm ϕ
4.9	12 mm ϕ

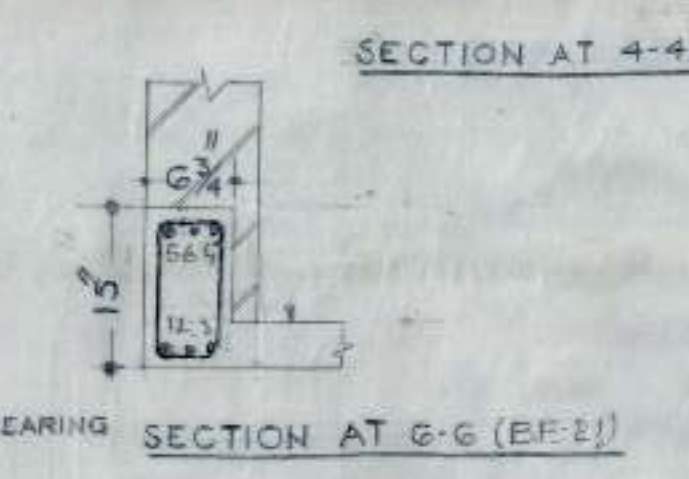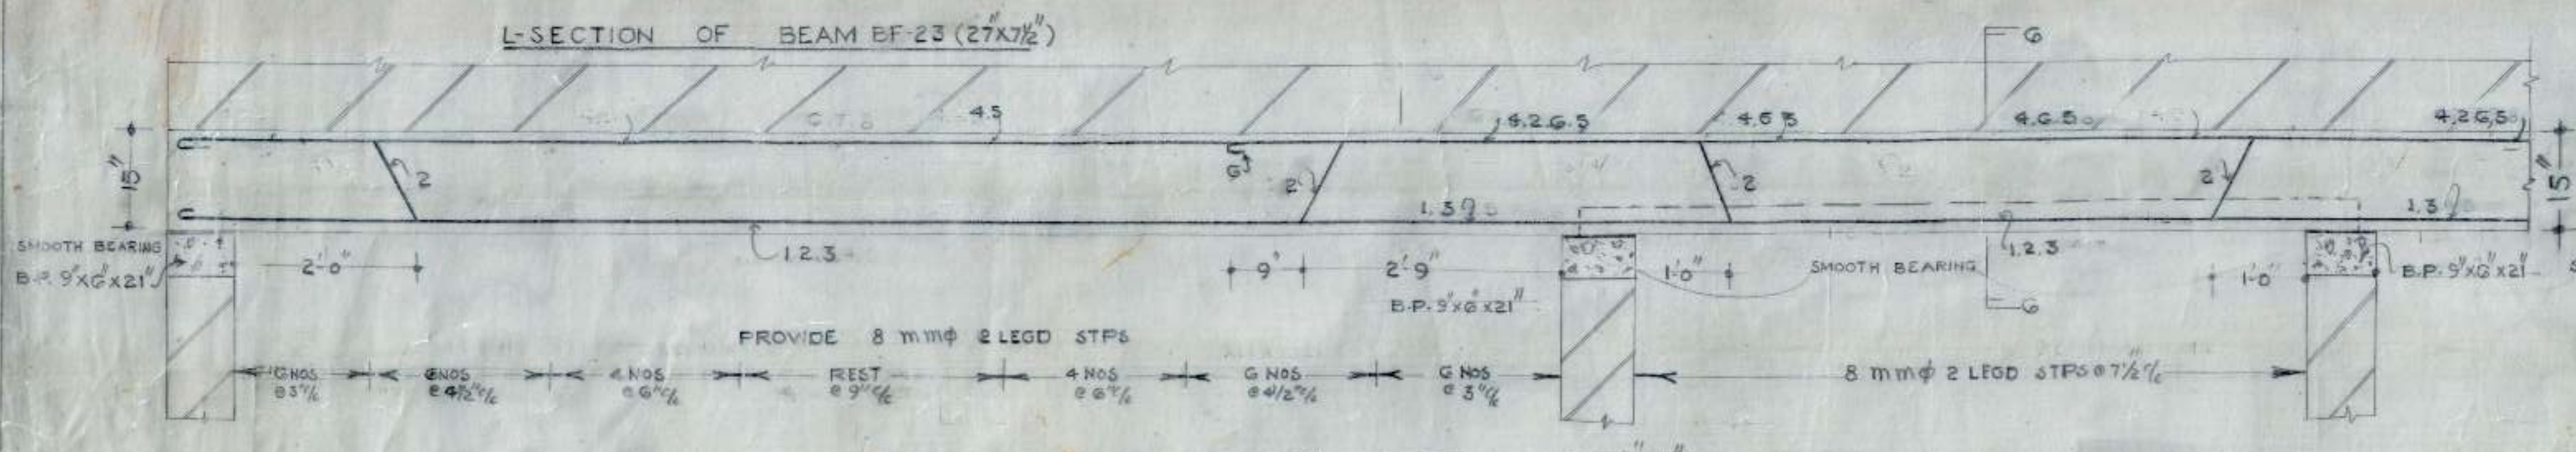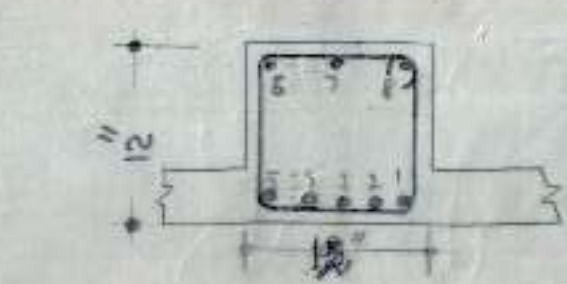

SCHEDULE OF BARS IN BF-21	
1.2.3	10 mm ϕ
4.5	12 mm ϕ

- NOTES
- FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG NO. 38 JOB NO. 79
 - FOR OTHER NOTES & REFERENCES REFER STR DRG NO. 2 JOB NO. 40.

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

Noted
DRN BY

SCALE
3/4"=1'-0"

DATE
28.2.86

M-I.G TWO ROOM
DETAIL OF REINFORCEMENT
IN BEAMS & LINTELS
AT TOP FLOOR









DRG NO.
13

JOB NO.
40

AE-1
28/2/86

SEHB

CHB

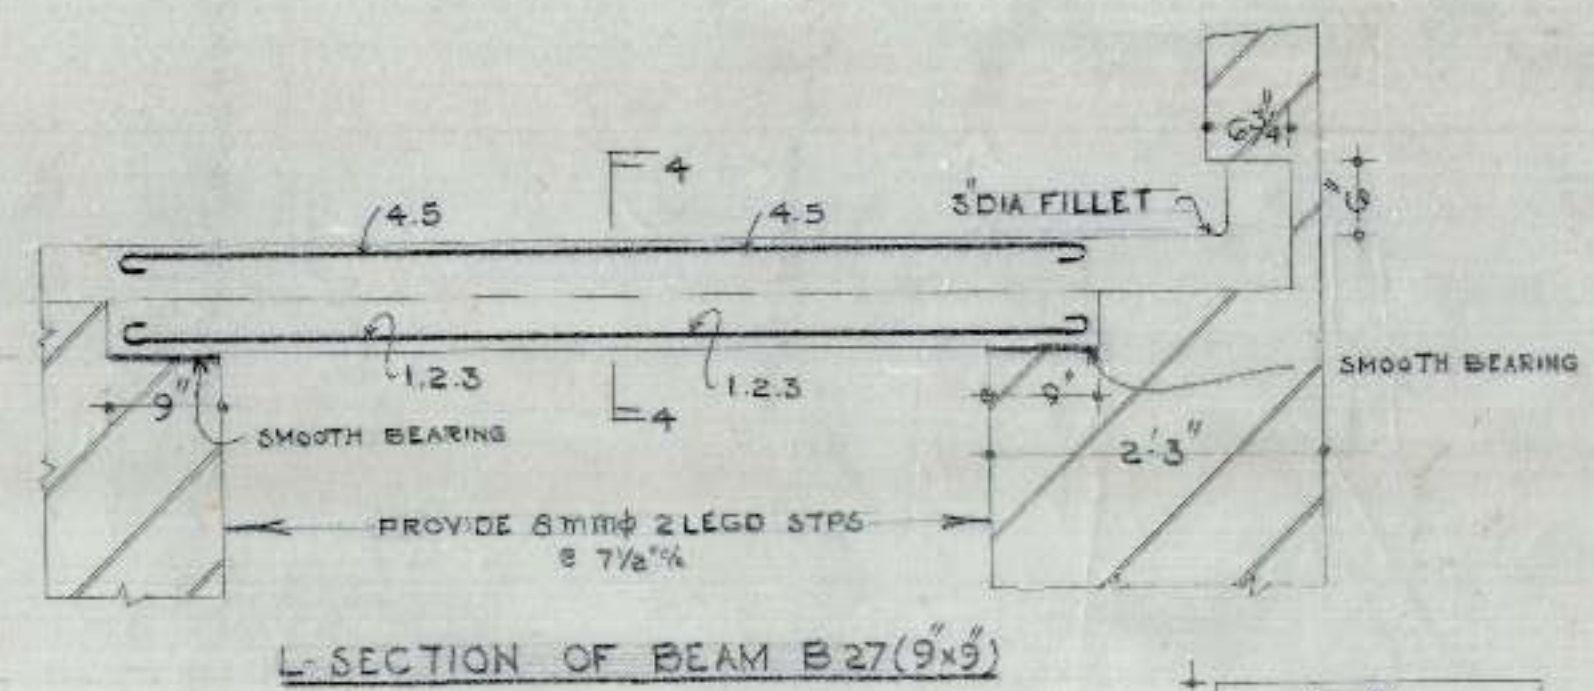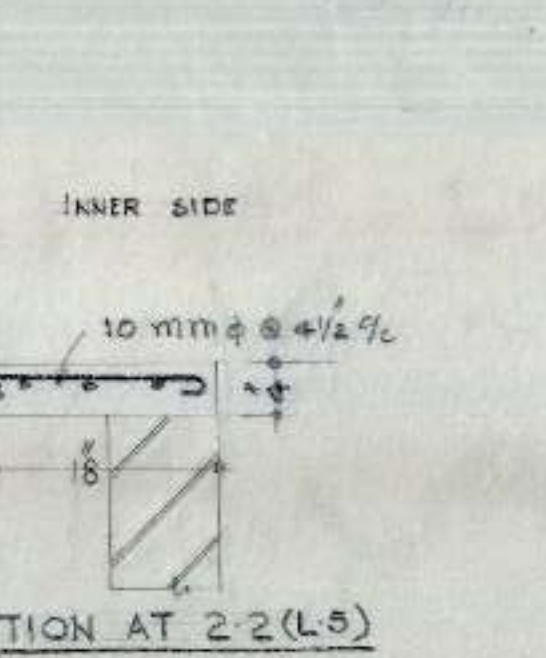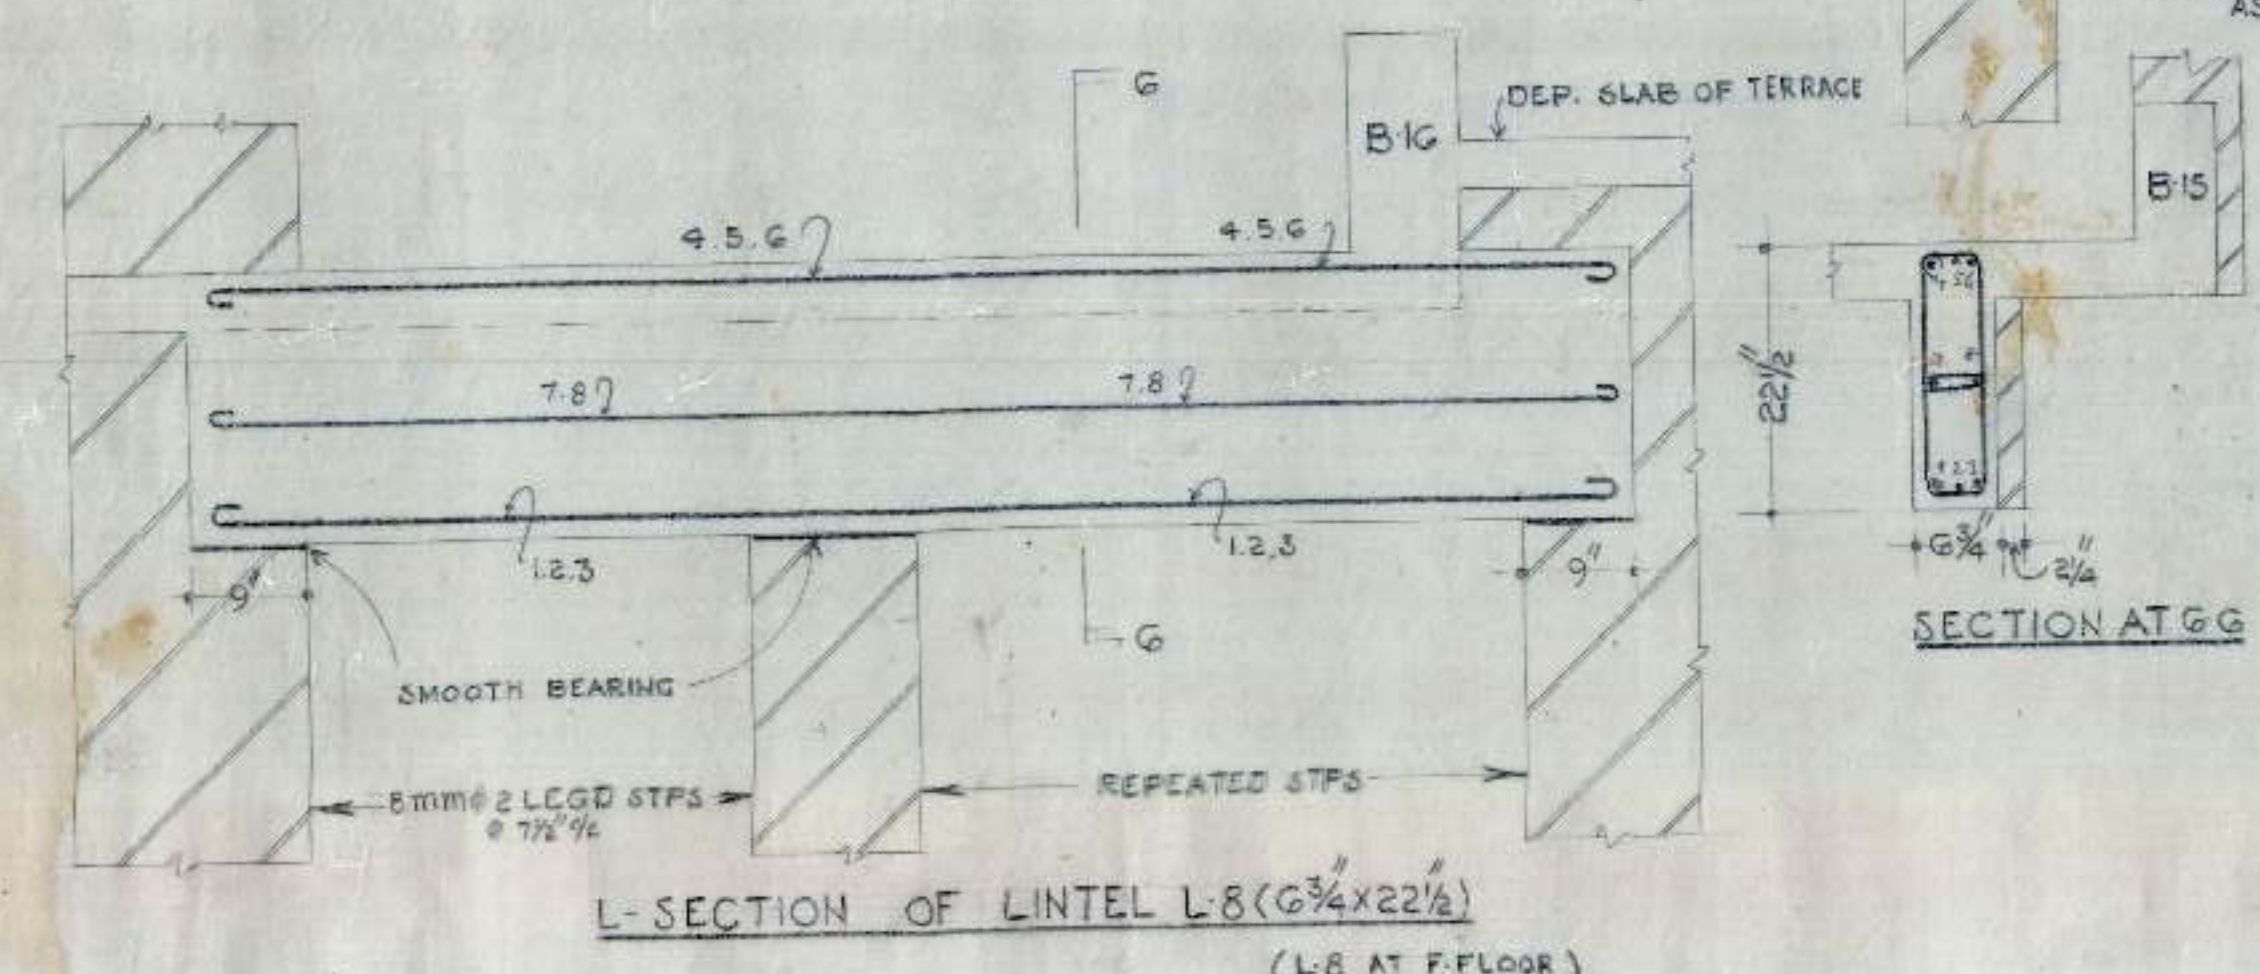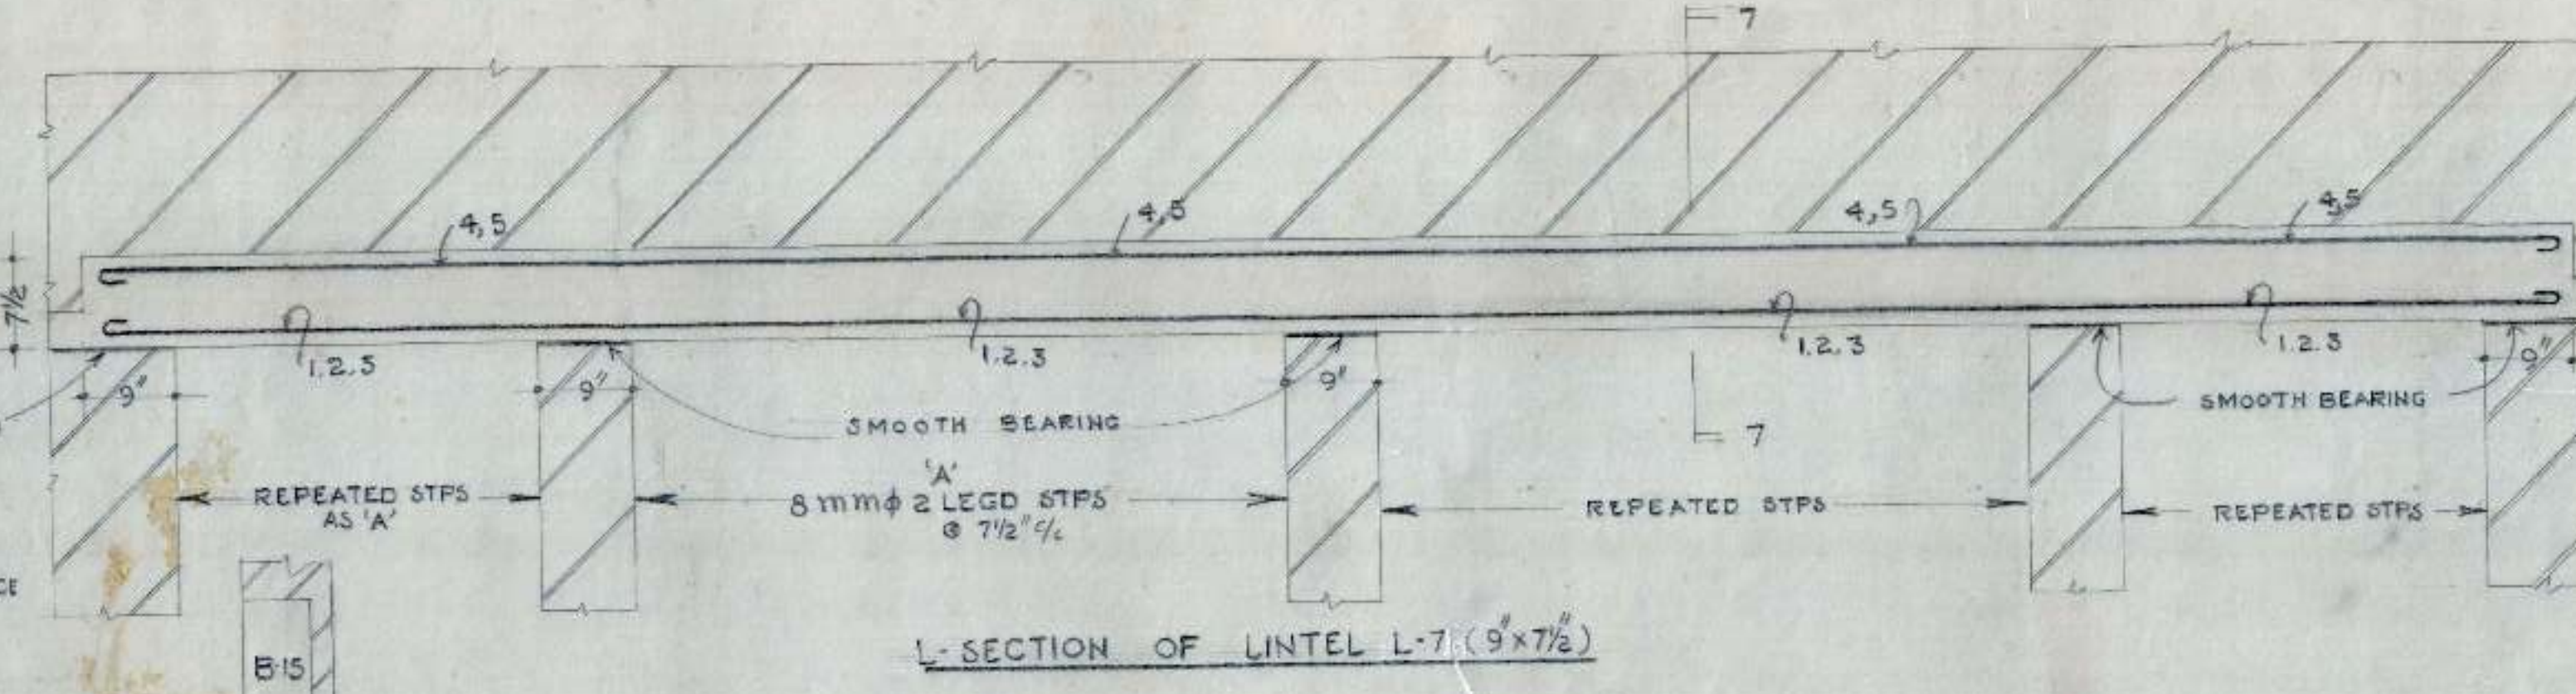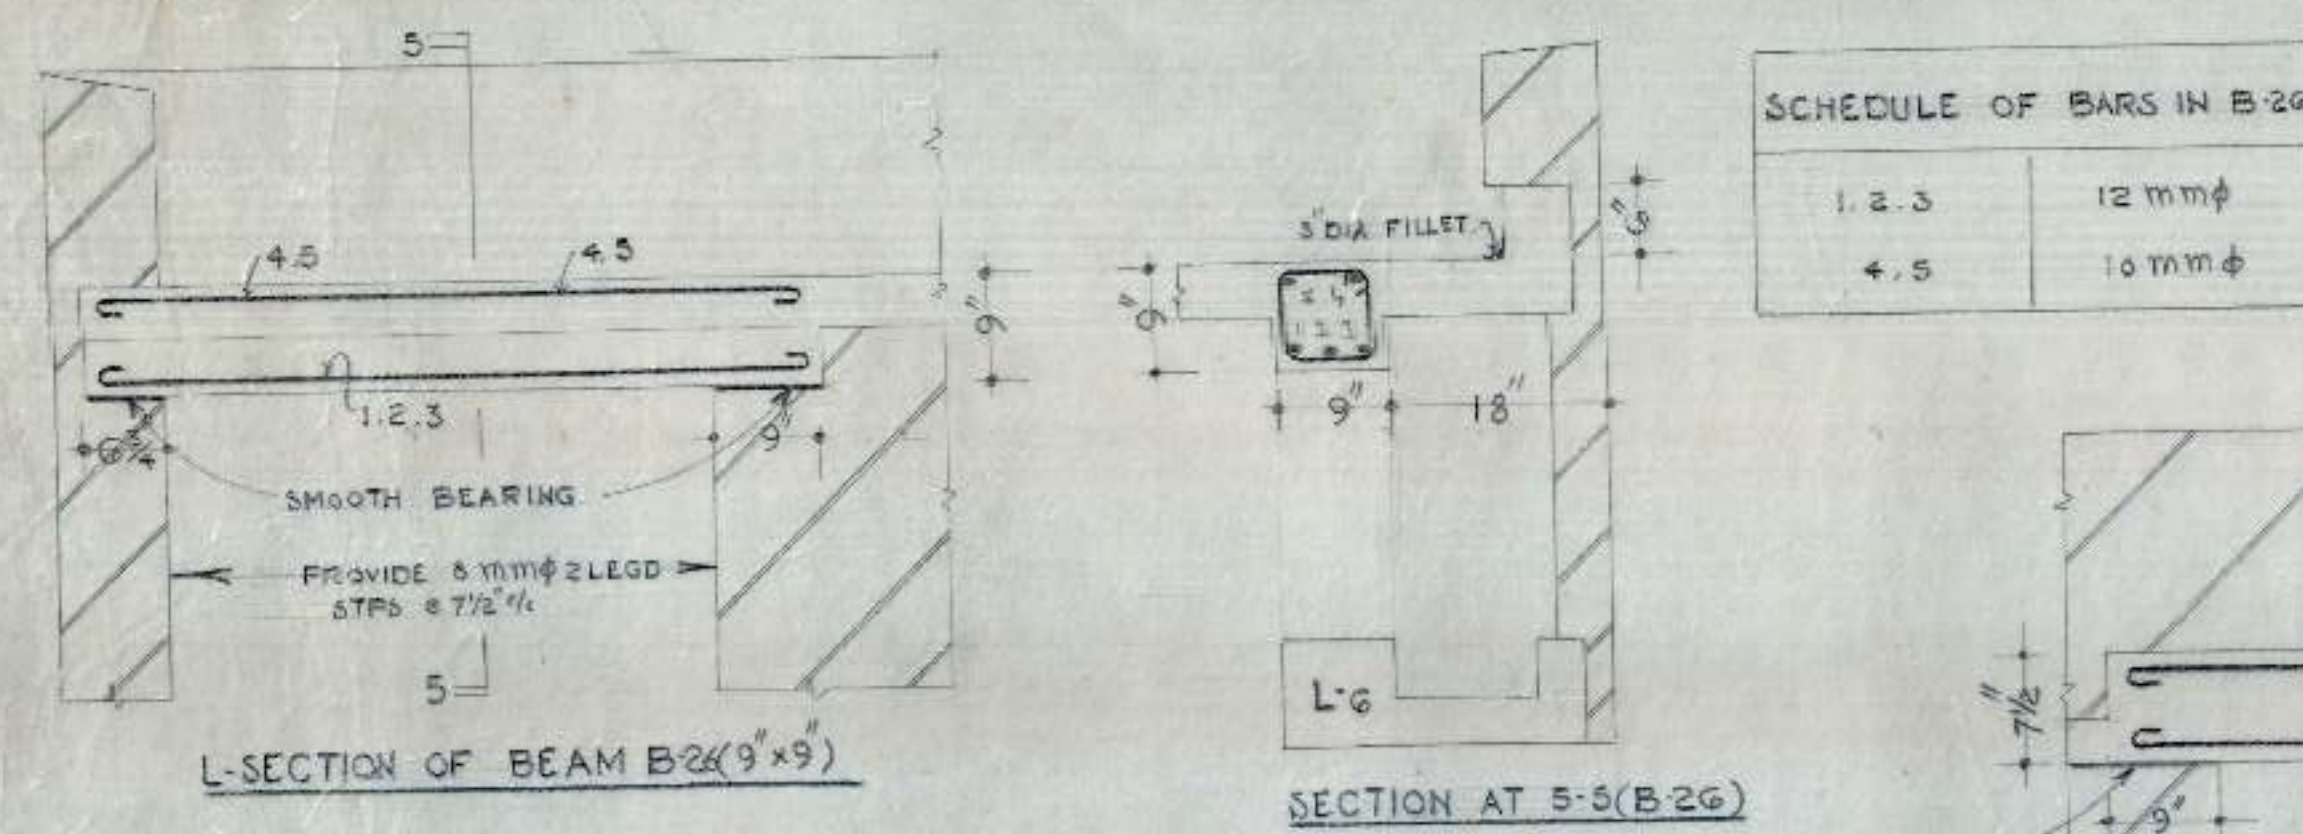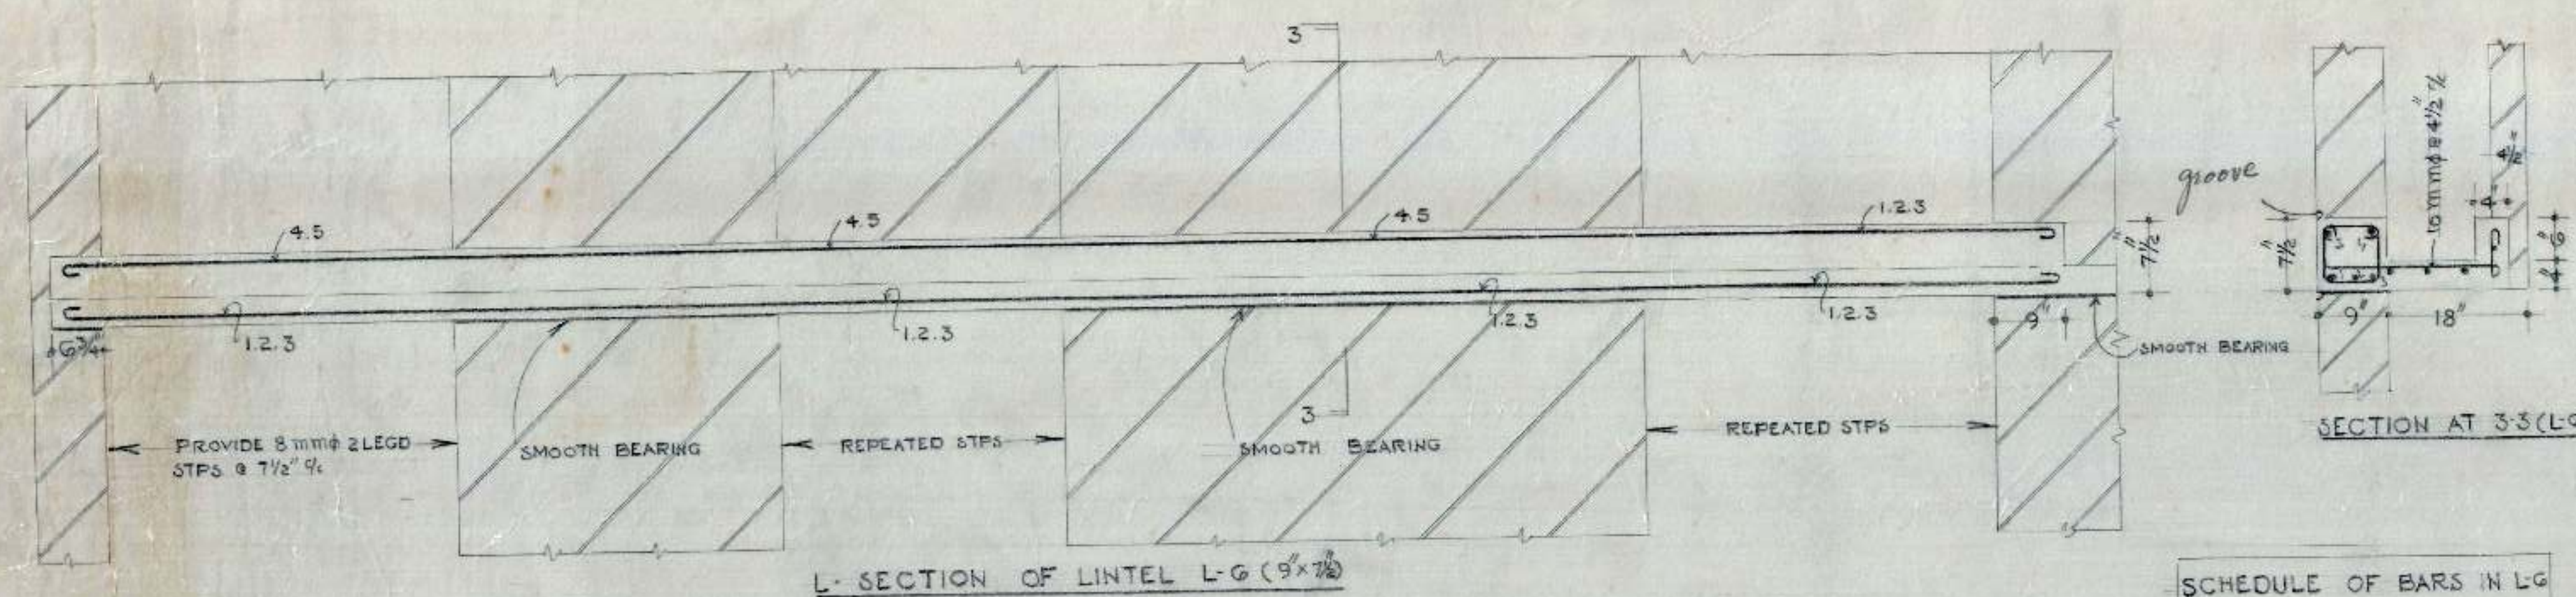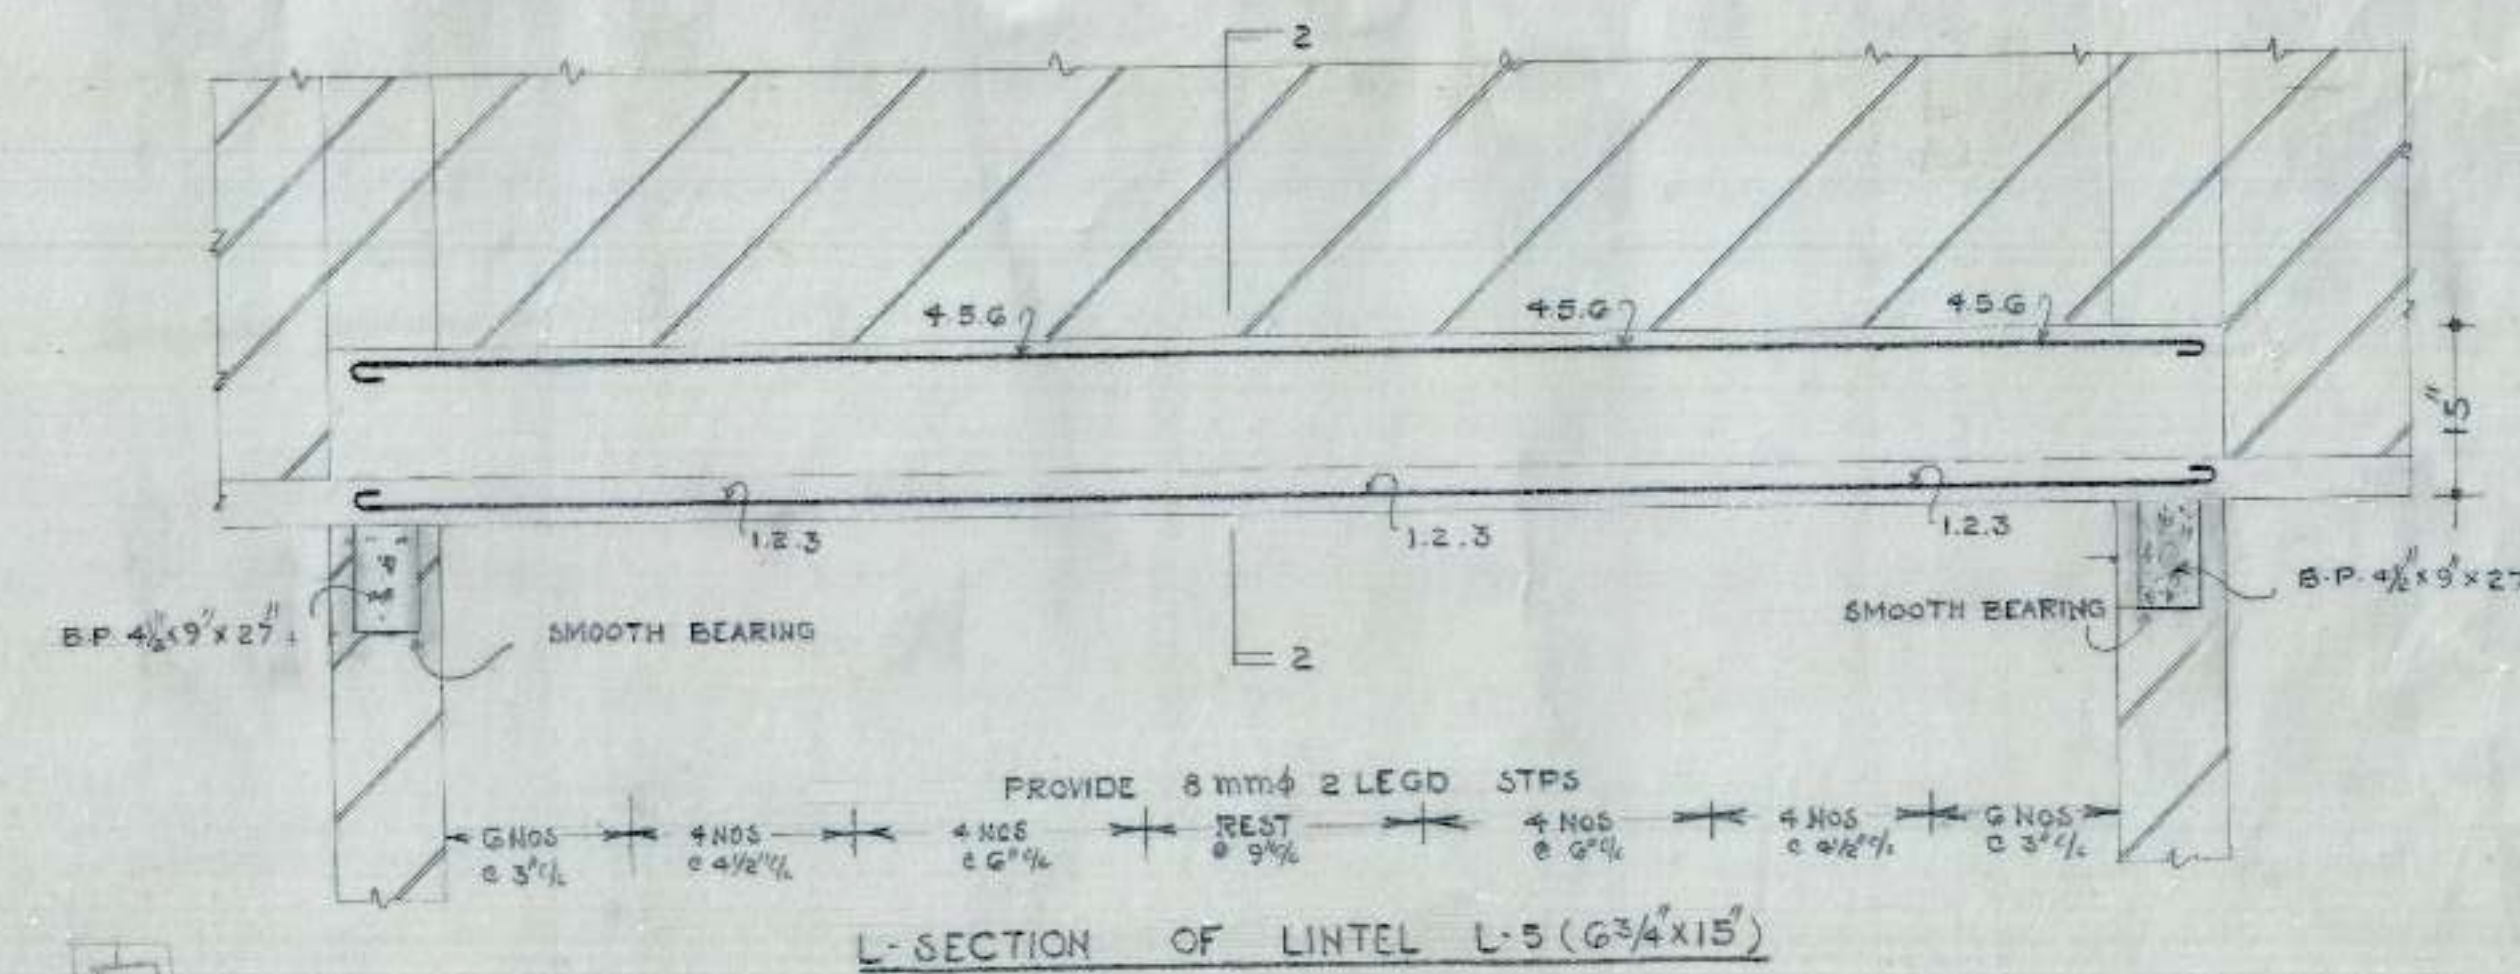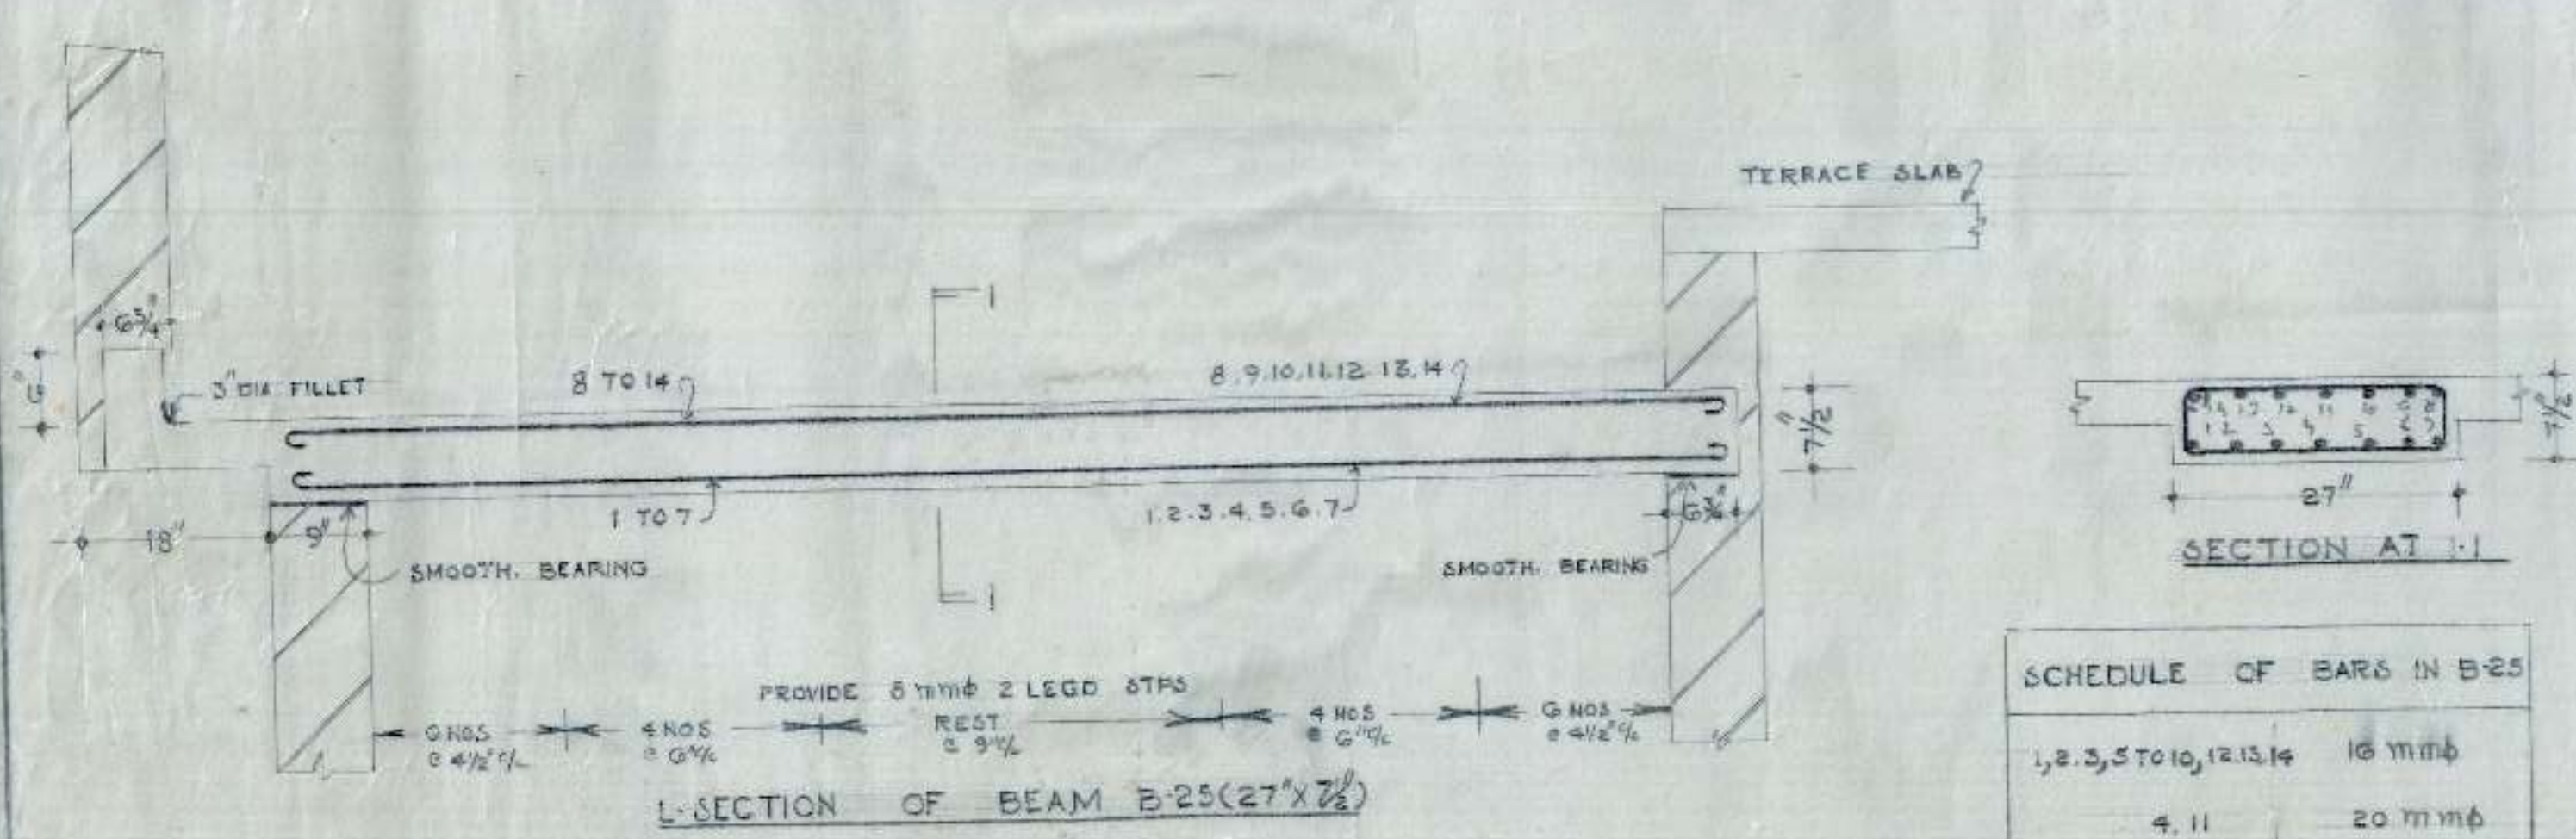

- S.No. NOTES
1. FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG. No. JOB No.
 2. FOR OTHER NOTES & REFERENCES REFER ST. DRG. No. 2, JOB No. 40.

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

DRAWN BY SCALE 3/4" = 1'-0"	M.I.G TWO ROOM	DRG. No. 14
	DETAIL OF REINFORCEMENT IN LINTELS & BEAMS AT TOP FL. G-B.	JOB No. 40
CHECKED BY A.E.D.	E.E.I.	S.E.H.B.