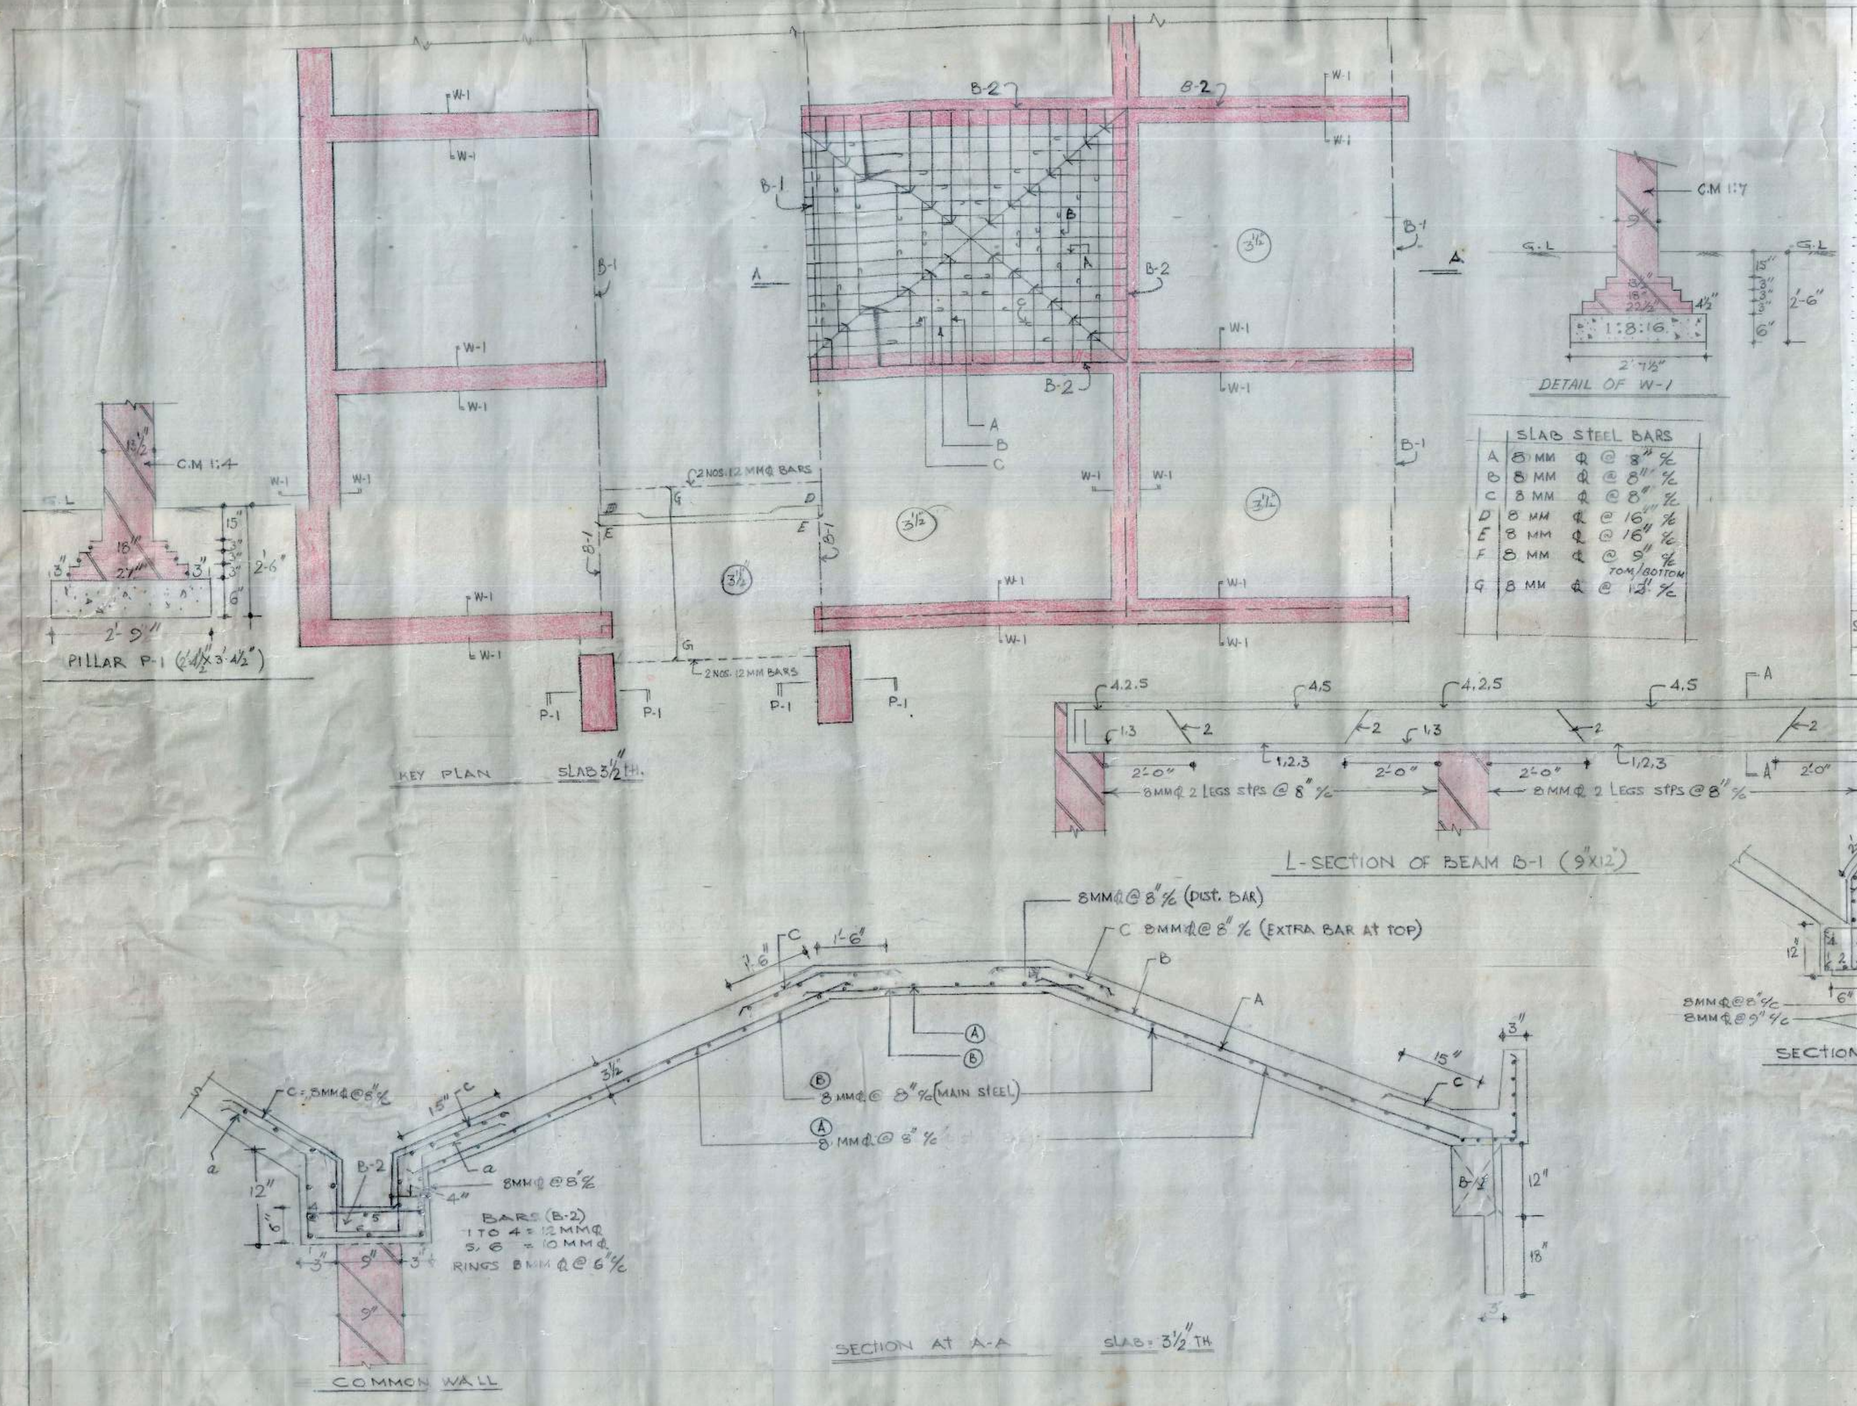

SLAB STEEL BARS		
A	8 MM ϕ	@ 8" c/c
B	8 MM ϕ	@ 8" c/c
C	8 MM ϕ	@ 8" c/c
D	8 MM ϕ	@ 16" c/c
E	8 MM ϕ	@ 16" c/c
F	8 MM ϕ	@ 9" c/c TOM/BOTTOM
G	8 MM ϕ	@ 12" c/c

NOTES

1. FOR CENTER LINE DIMENSIONS REFER ARCH. DRG.
2. SUITABLE D.P.C. MAY BE PROVIDED AT SITE.
3. THE SAFE BEARING CAPACITY OF SOIL HAS BEEN ASSUMED AS 1.0T/□' WHICH SHOULD BE ENSURED AT SITE.

S.NO	DESCRIPTION	DATE	SING.
2.	BEAM B-1 (9"x12")	11/8/95	
1.	COMMON WALL BEAM B-2	11/8/95	

REVISION

E.E. I

A.E.D

DRAWN BY

DETAIL OF SLAB/FOND. & BEAM

JOB NO. 90

DAY MARKET
SECTOR 22-D
CHANDIGARH.

DRG. NO. 01

DATE 6/95