

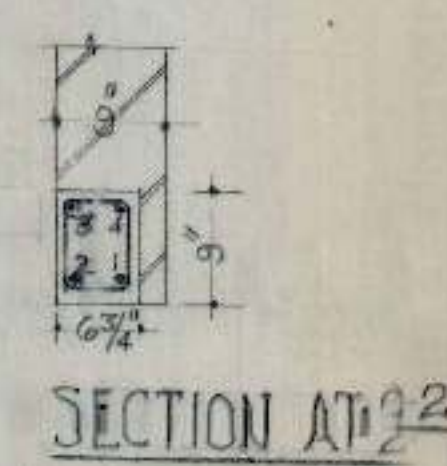
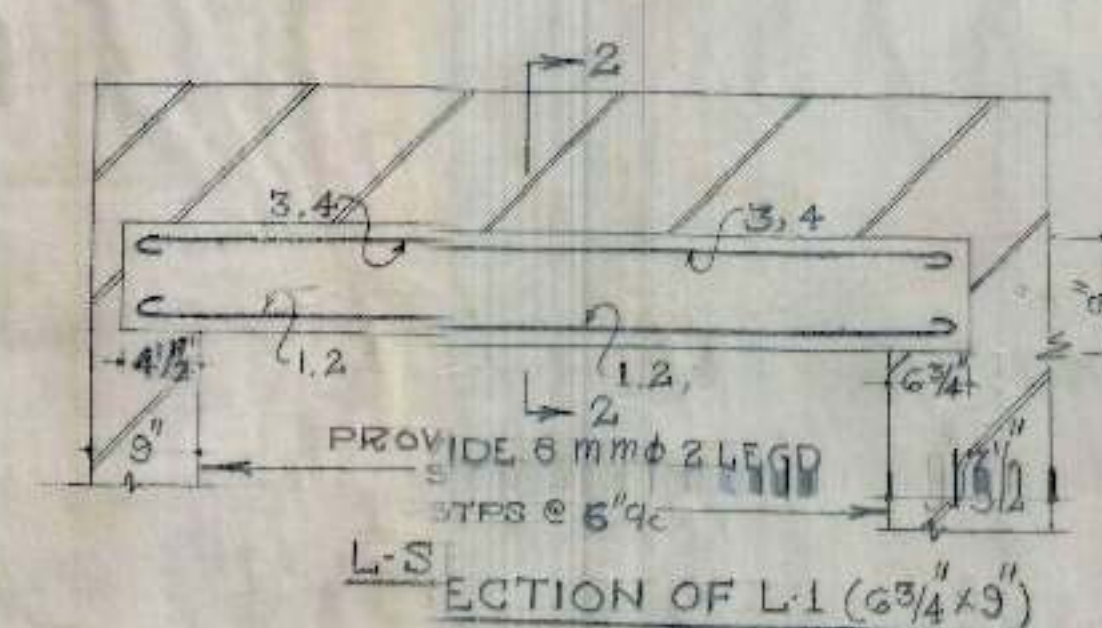


C.H.B

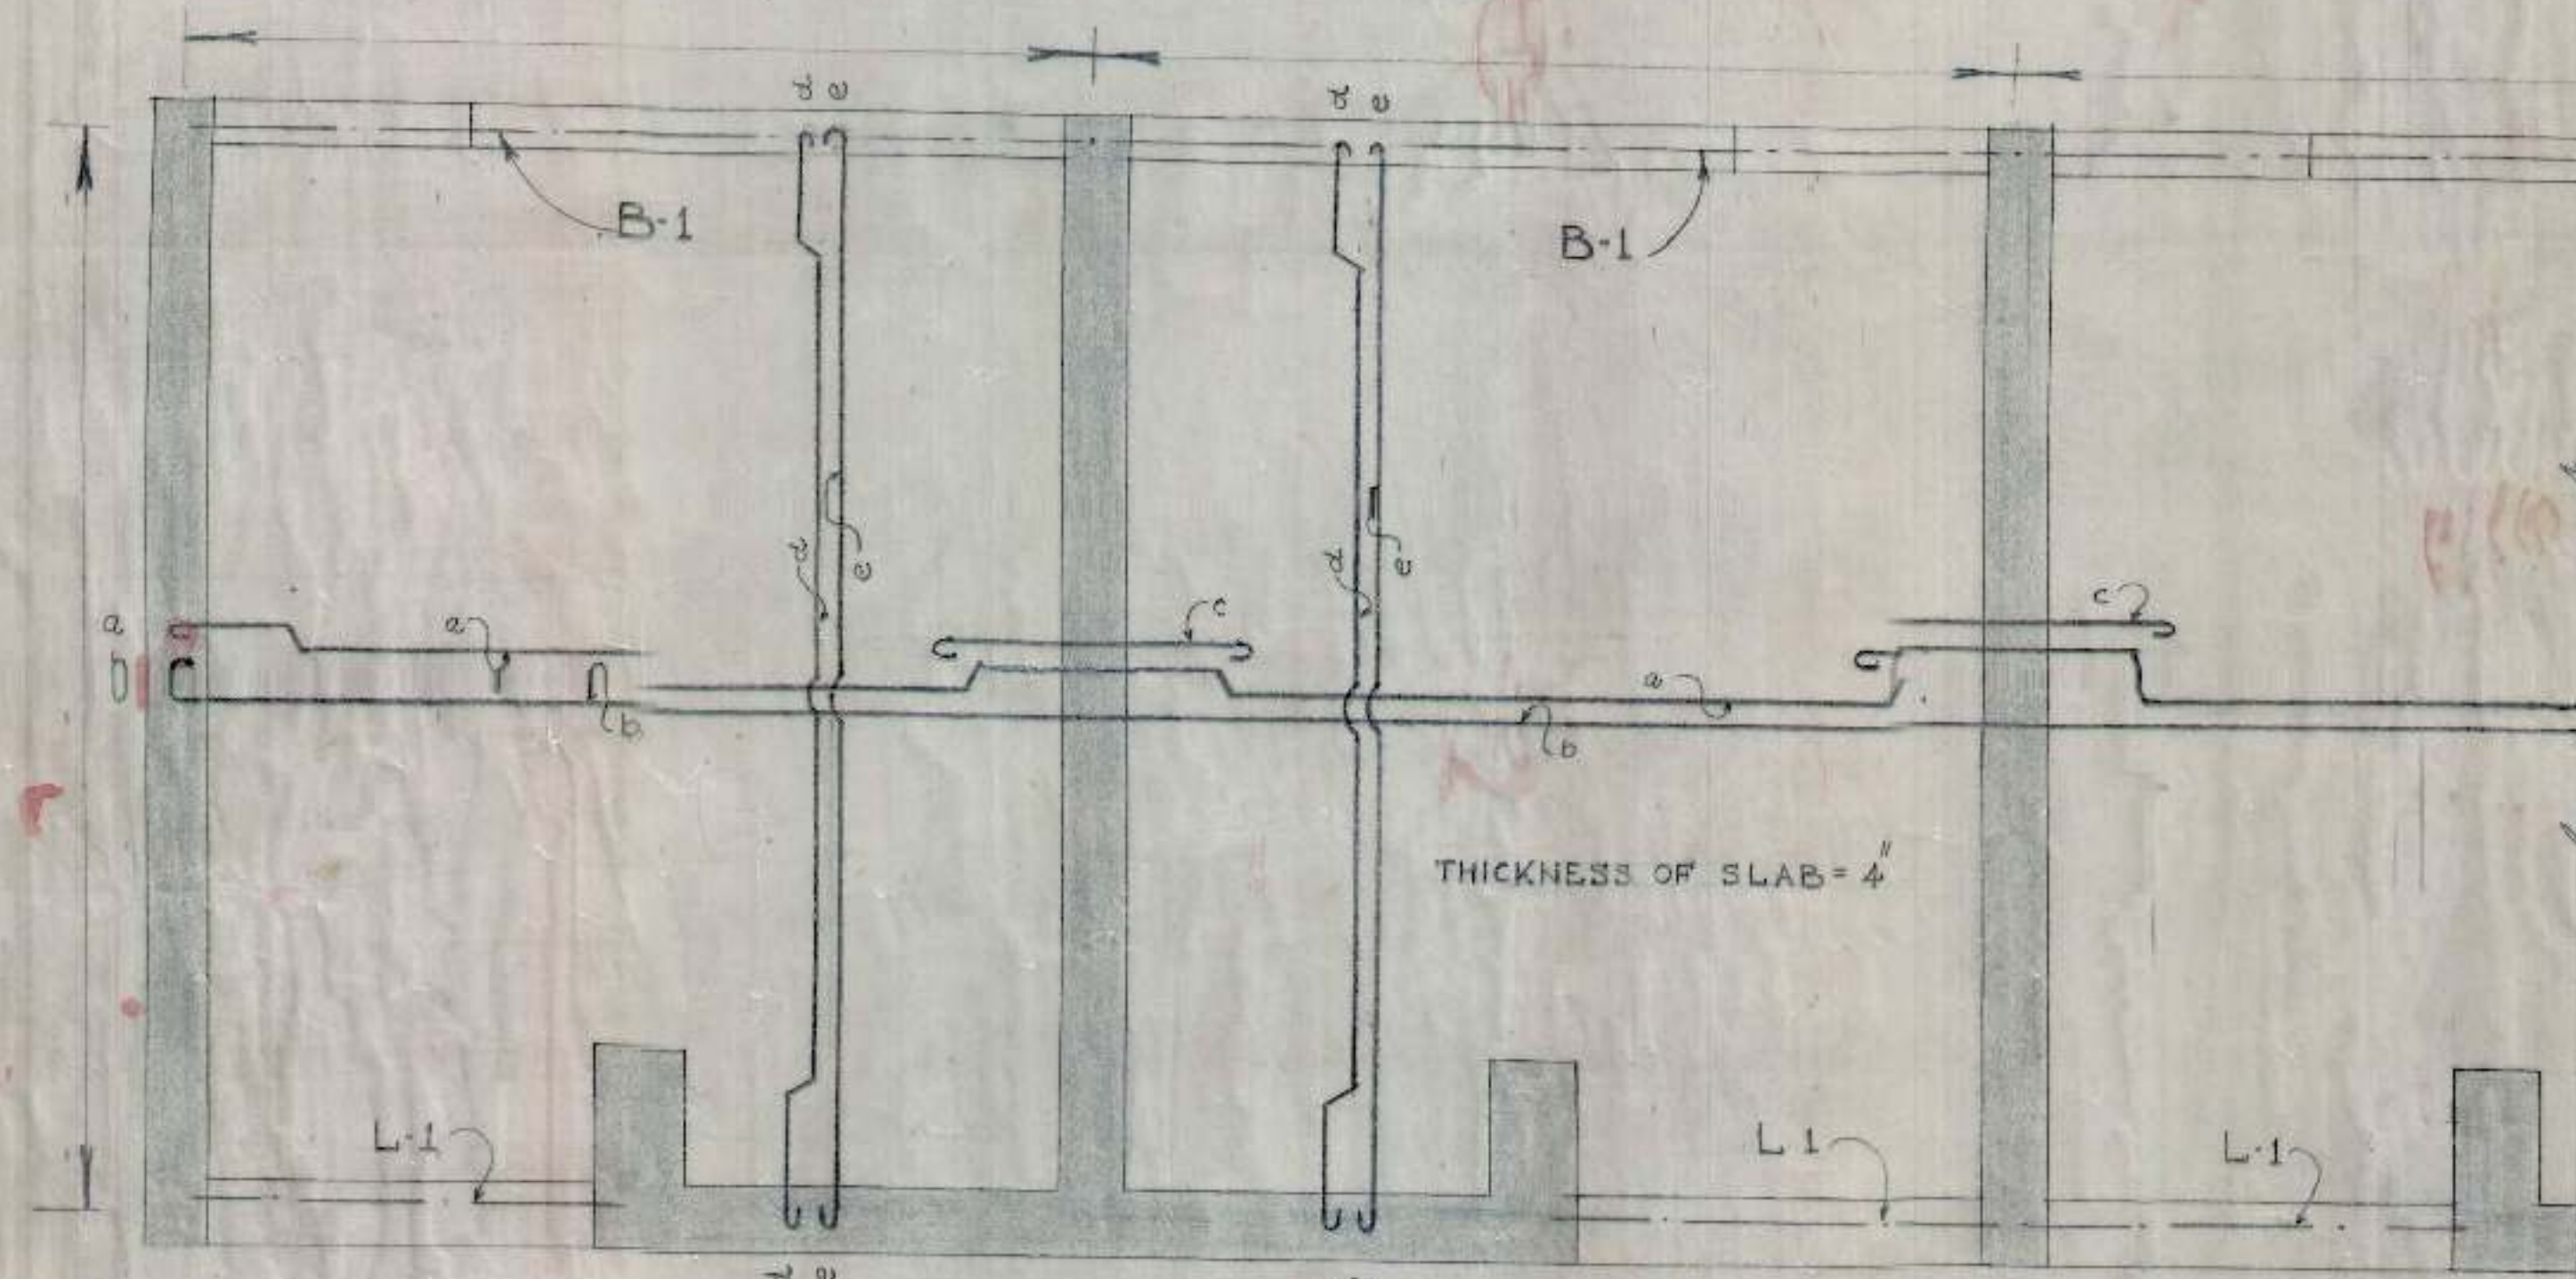


SCHEDULE OF BARS IN L-1	
1 TO 4	4 NOS 12 mm φ

SCHEDULE OF BARS IN SLAB				
a	10 mm φ	@ 13"	c/c	
b	10 mm φ	@ 13"	c/c	
c	10 mm φ	@ 13"	c/c	
d	10 mm φ	@ 14"	c/c	
e	10 mm φ	@ 14"	c/c	

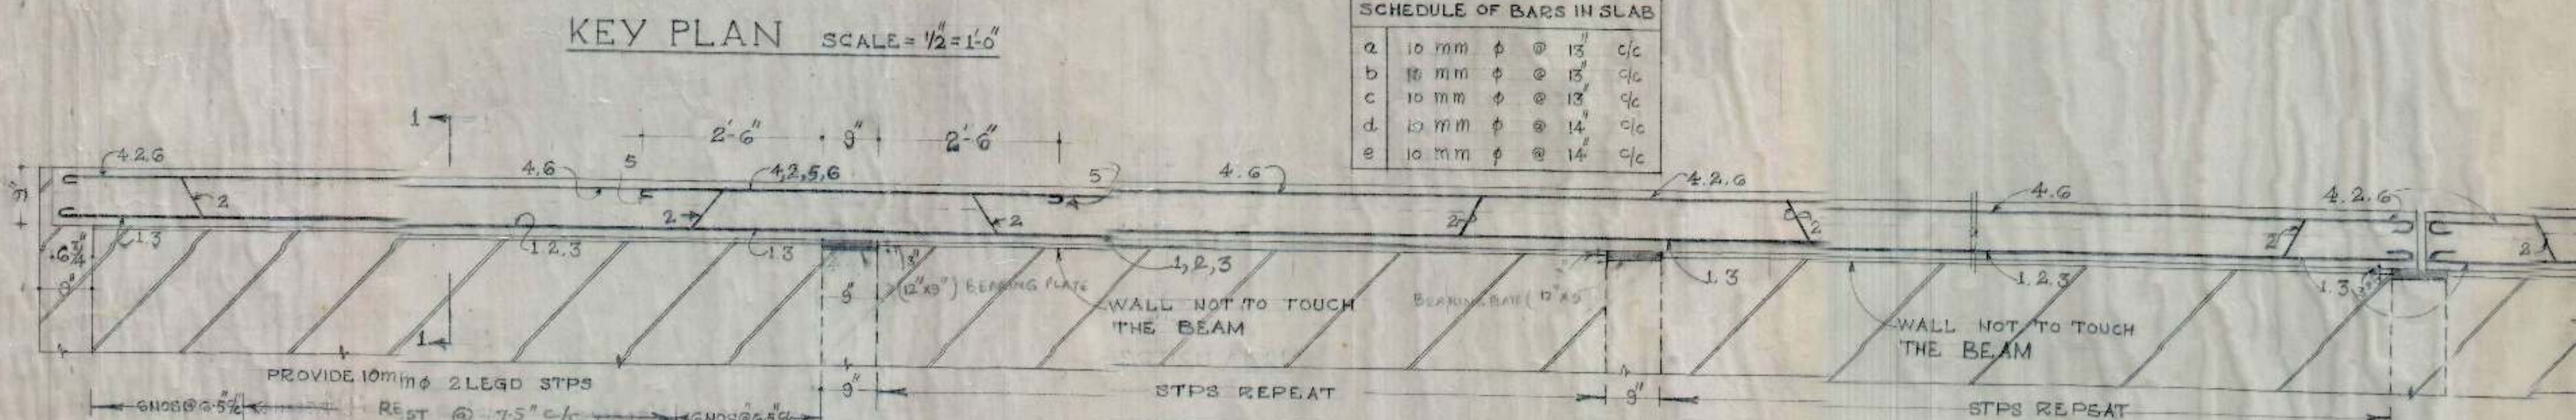

SCHEDULE OF BARS IN B-1	
1 TO 6	6 NOS 16 mm φ

NOTE: CONTINUITY TO BE BROKEN AT EVERY 10TH HOUSE


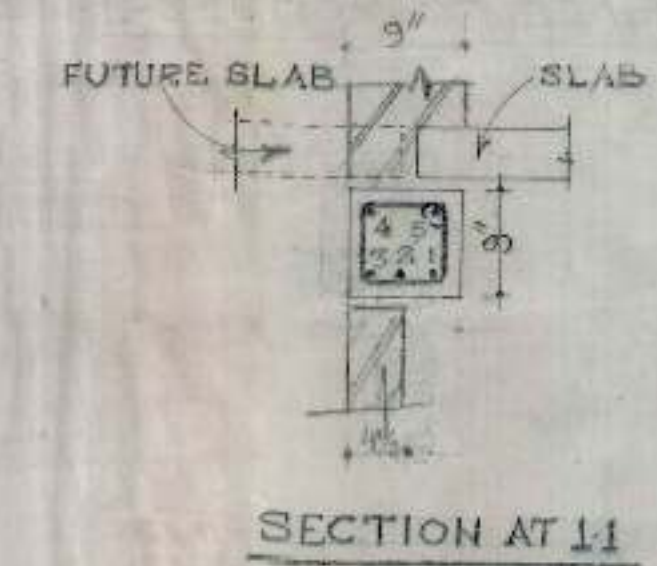


- | SNO | NOTES |
|-----|---|
| 1. | FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG NO-6 JOB NO 24. |
| 2. | DIMENSIONS ARE TO BE READ AND NOT TO BE SCALED OFF |
| 3. | STRUCTURAL SIZES AS SHOWN IN THIS DRG SHOULD BE ADOPTED INSPITE OF ANY CONTRARY SIZES SHOWN IN ARCHDRG. |
| 4. | MAX. SAFE STRESS IN STEEL HAS BEEN TAKEN AS 18000 LBS/IN ² WHICH SHOULD BE ENSURED AT SITE. |
| 5. | SUITABLE LINTELS MAY BE PROVIDED OVER OPENINGS SUCH AS DOORS & WINDOWS. |
| 6. | ANCHORAGE IN REINFORCEMENT SHALL BE 40 TIMES THE DIAMETER WHERE EVER REQUIRED. |
| 7. | CLEAR COVER TO BE KEPT FOR BEAMS & FOR SLAB. |
| 8. | LAPS IN REINFORCEMENT SHALL BE IN ACCORDANCE WITH LATEST I.S.I SPECIFICATIONS. |
| 9. | DISCREPANCIES BETWEEN DETAILS SHOWN IN THIS DRG & ARCH DRG IF ANY SHOULD BE GOT CLARIFIED FROM THIS OFFICE BEFORE ADOPTING THIS DESIGN. |


NOTE: LINTELS & BEAMS HAVE BEEN DESIGNED FOR ONE STOREY LOAD ONLY.

OFFICE OF THE SUPERINTENDING ENGINEER CHANDIGARH HOUSING BOARD CHANDIGARH		
DRN BY J. Singh	E.W.S. SCHEME ONE ROOM AT DADU- MATRAS KARSAN VILL	1 DRG NO
SCALE 3/4" = 1'-0"	DETAIL OF REINFORCE- MENT IN SLAB AND BEAMS.	24 JOB NO
A.E.D. J. Singh 17.5.80	E.E.D. C. Singh	S.E. C.H.B.

C.H.B.

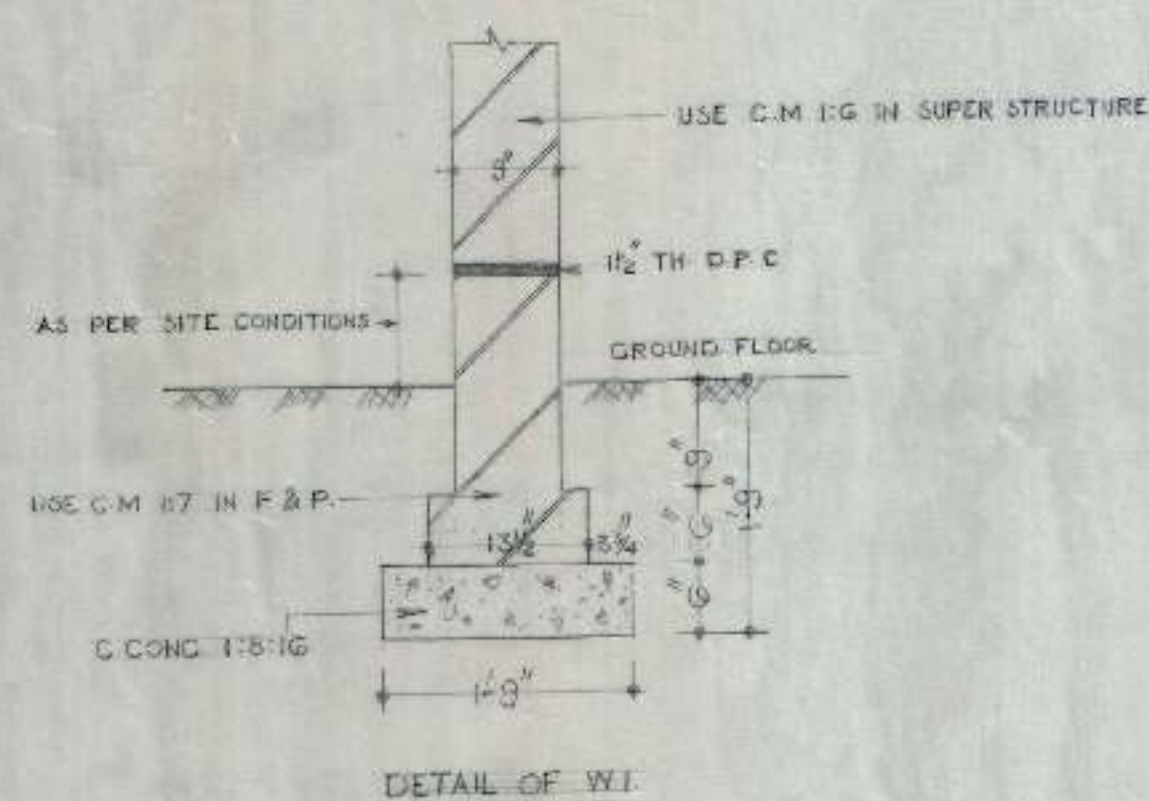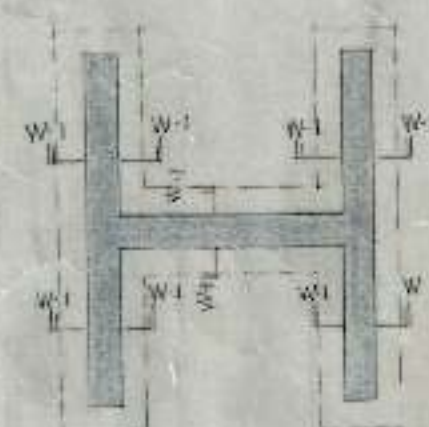

(FOR WALL HEIGHT UPTO 5'-6" MAX.)

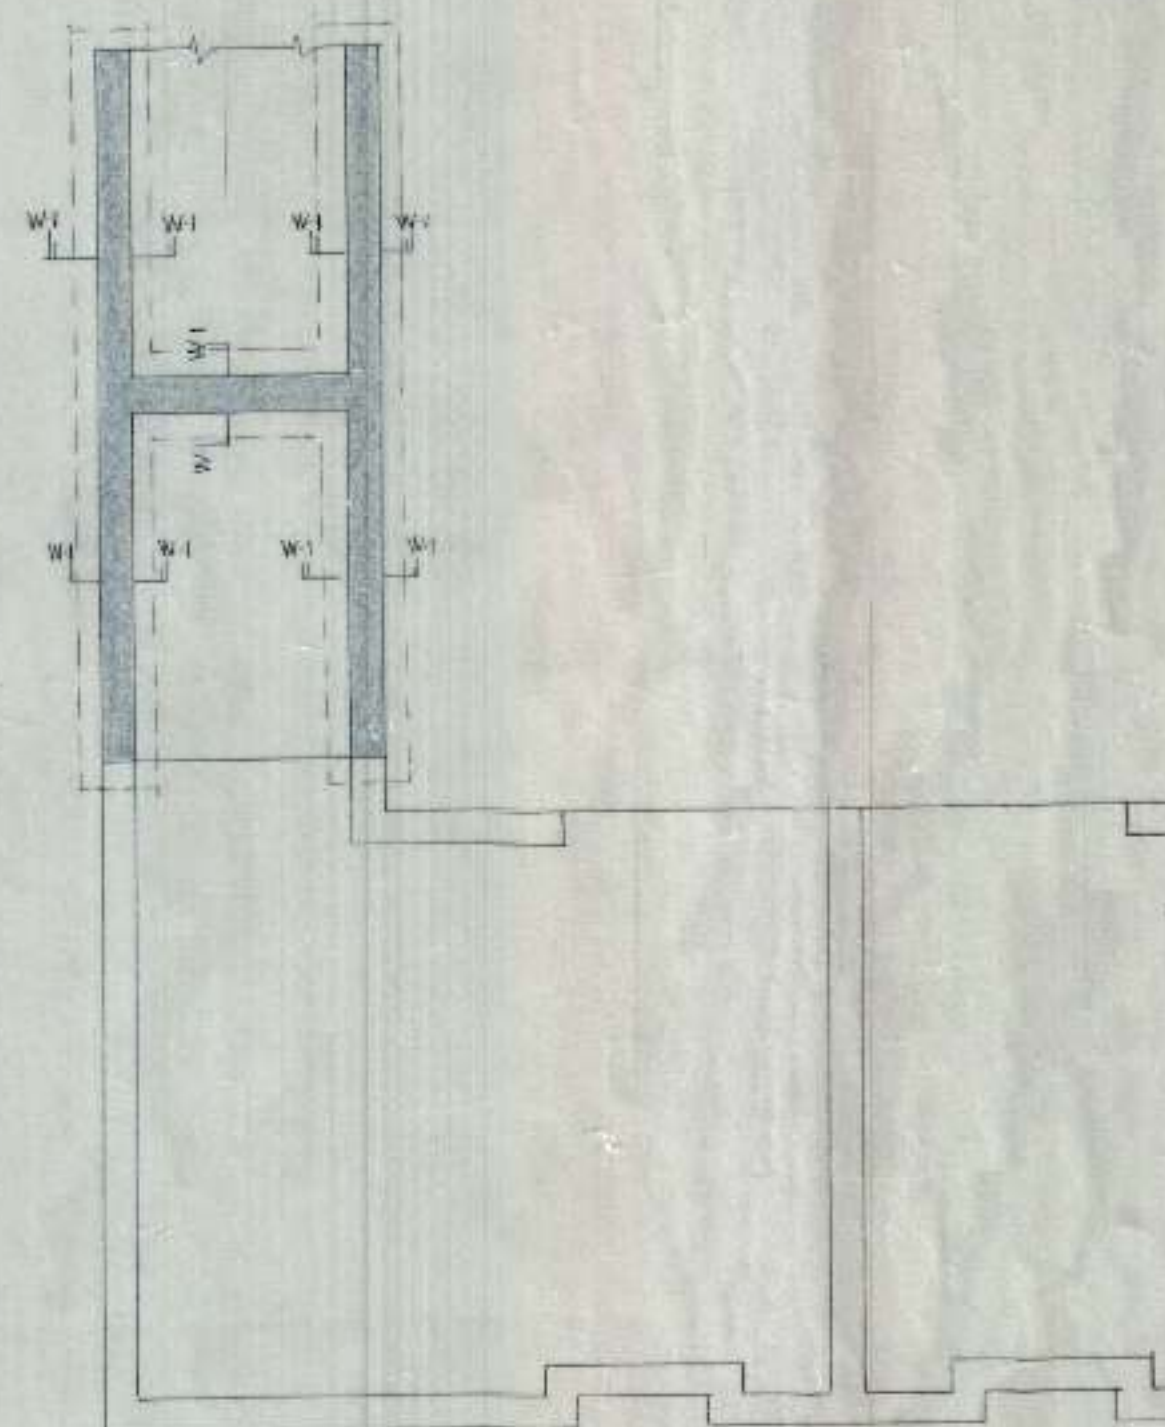






KEY PLAN
SCALE 1/4"=1'-0"

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

DRN. BY *Atindash* SITE & SERVICES SCHEME AT DHANAS & KARSAN DRG. No. 2

SCALE 3/4"=1'-0" DETAIL OF FOUNDATION OF W.C/BATH WALLS JOB No. 24.

1/19/85 A.E.D. *17/11/85* E.E-1 S.E.H.B.

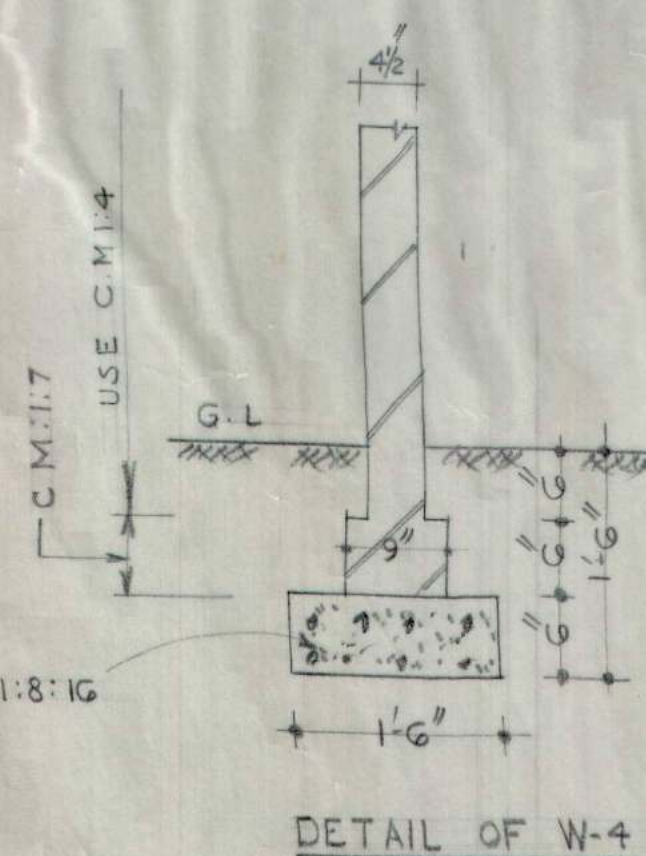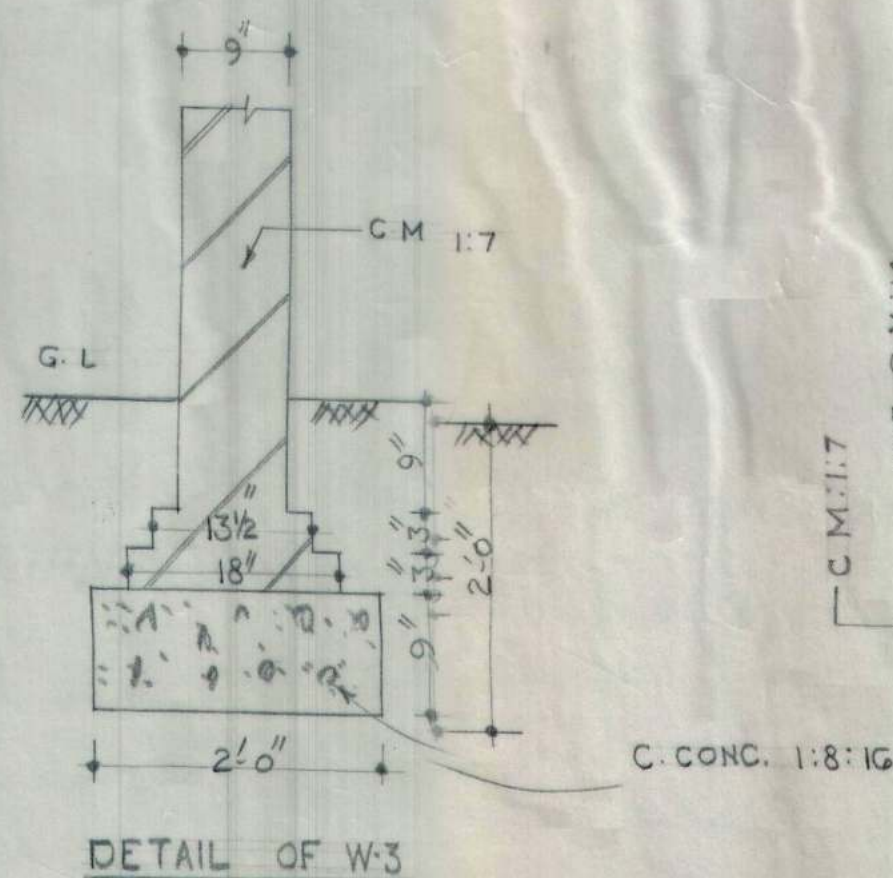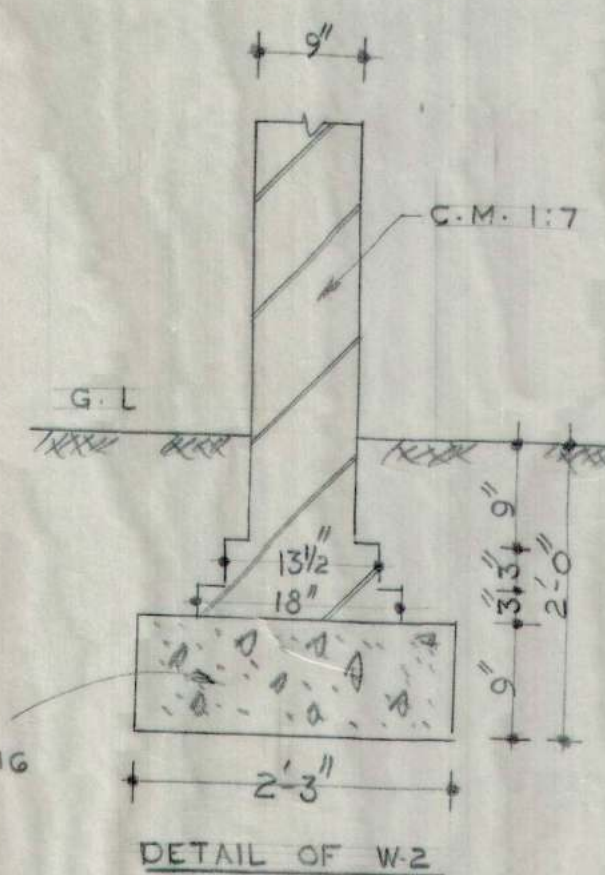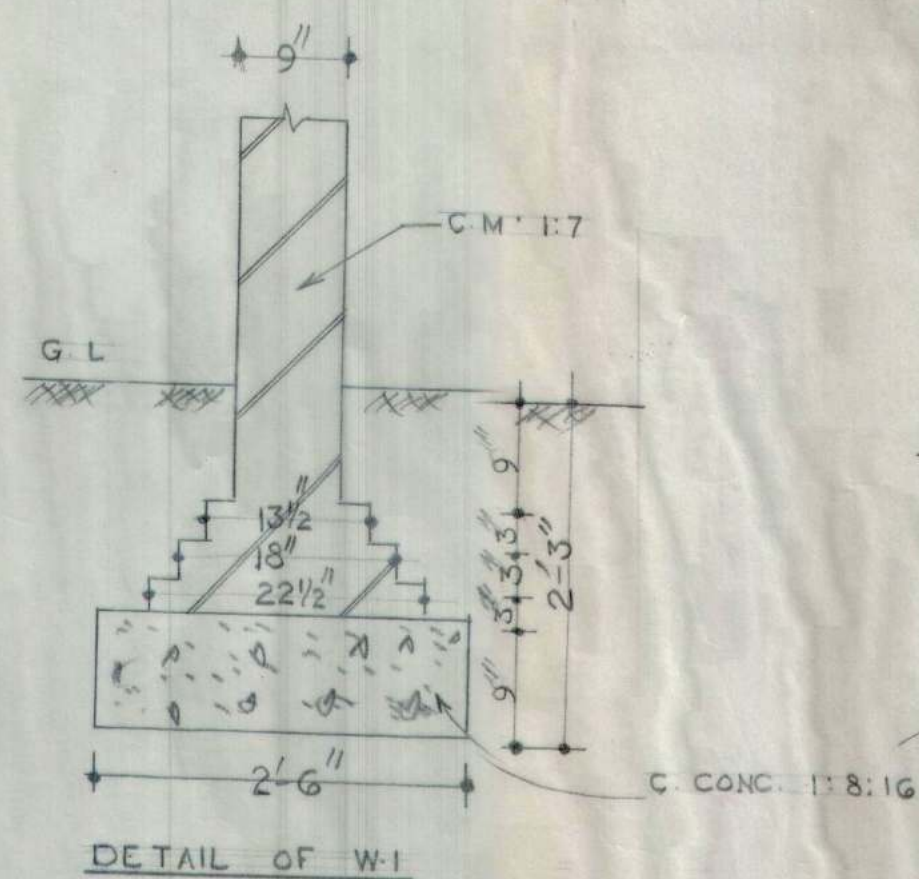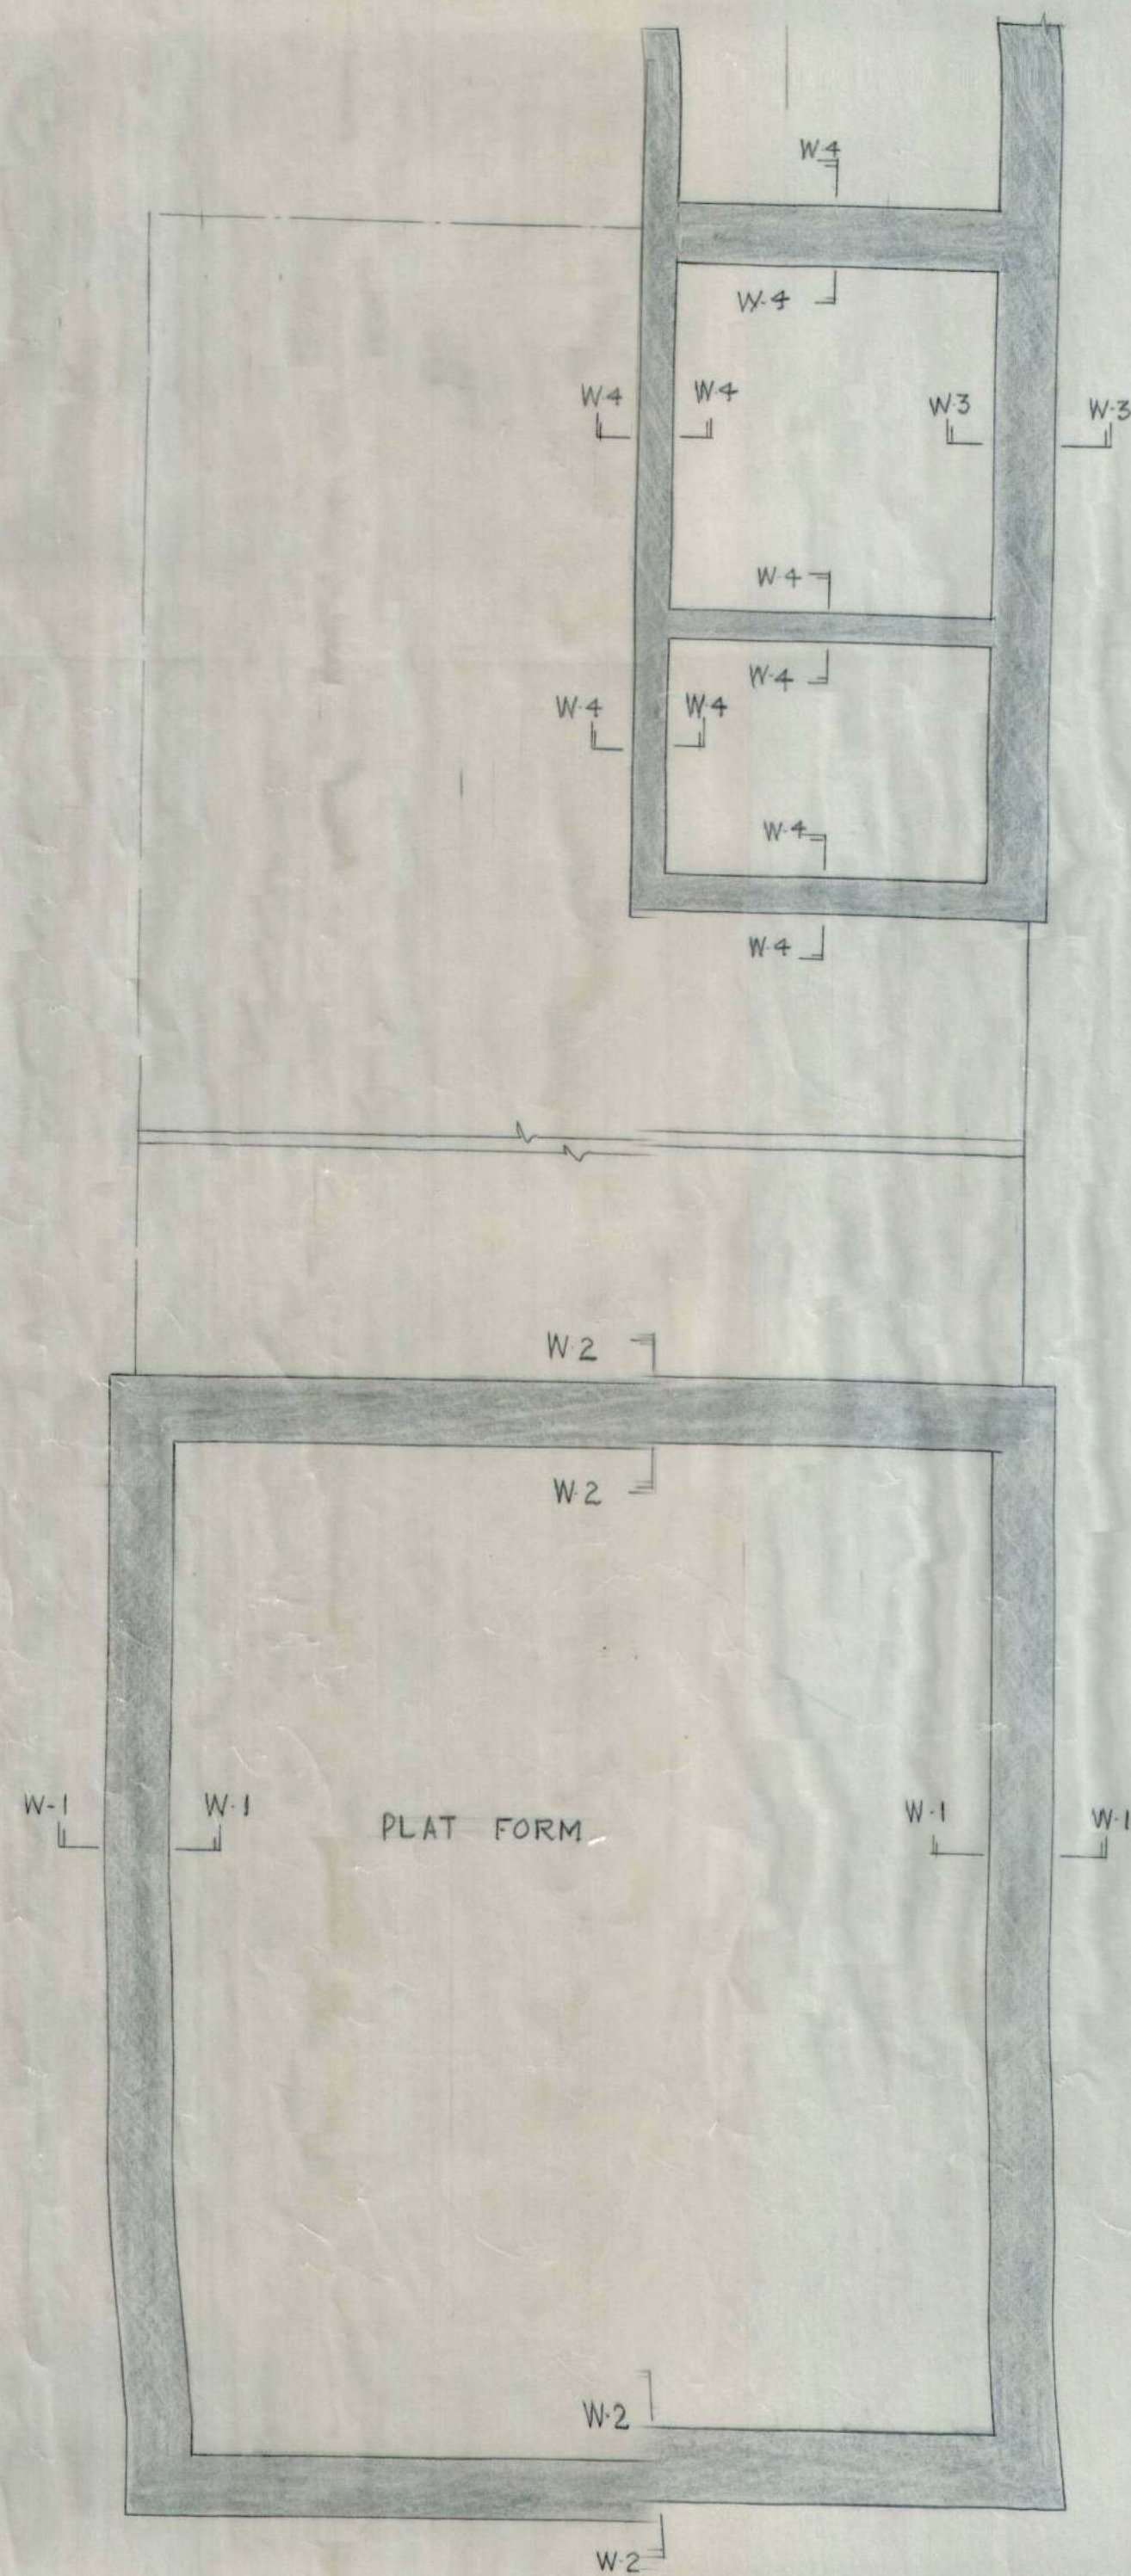

CHILD

S.No	NOTES
1	FOR CENTRE LINE DIMENSIONS REFER ARCH. DRG No 1 JOB No. 1054 / 1/232
2	DIMENSIONS ARE TO BE READ & NOT TO BE SCALED OFF
3	SUITABLE D.P.C MAY BE PROVIDED AT SITE.
4	THE SAFE BEARING CAPACITY OF SOIL HAS BEEN ASSUMED AS ONE TON/ft ² WHICH SHOULD BE ENSURED AT SITE.

OFFICE OF THE SUPERINTENDING ENGINEER
CHANDIGARH HOUSING BOARD CHANDIGARH

Detundobh	SITE CUM SERVICES	DRG No
DRN BY	SCHEME	3
SCALE	DETAIL OF	JOB NO
3/4"=1'-0"	FOUNDATIONS	24
A.E.D.	E.E-1	S.E.H.B.