


It has been observed that main electricity supply cables are passing under the proposed lift well. The applicant may have to shift these services at his own cost from the concerned Deptt. under size of lift/well may be taken as per approved RMC code (NRC) & specifications of CPWD for lifts.

Lifts can be provided in this category of flats on a structure about 76 concerned subject to shifting of any services coming in the area of lifts. Further the slab at second level is required to be dismantled and retrofitting of slab for lift area is to be done under the supervision and guidance of structural engineers employed by

The lift can be accommodated within the CRB area / layout plan subject to structural, electrical, architectural aspects & all available for need based requirements as no zoning is available.

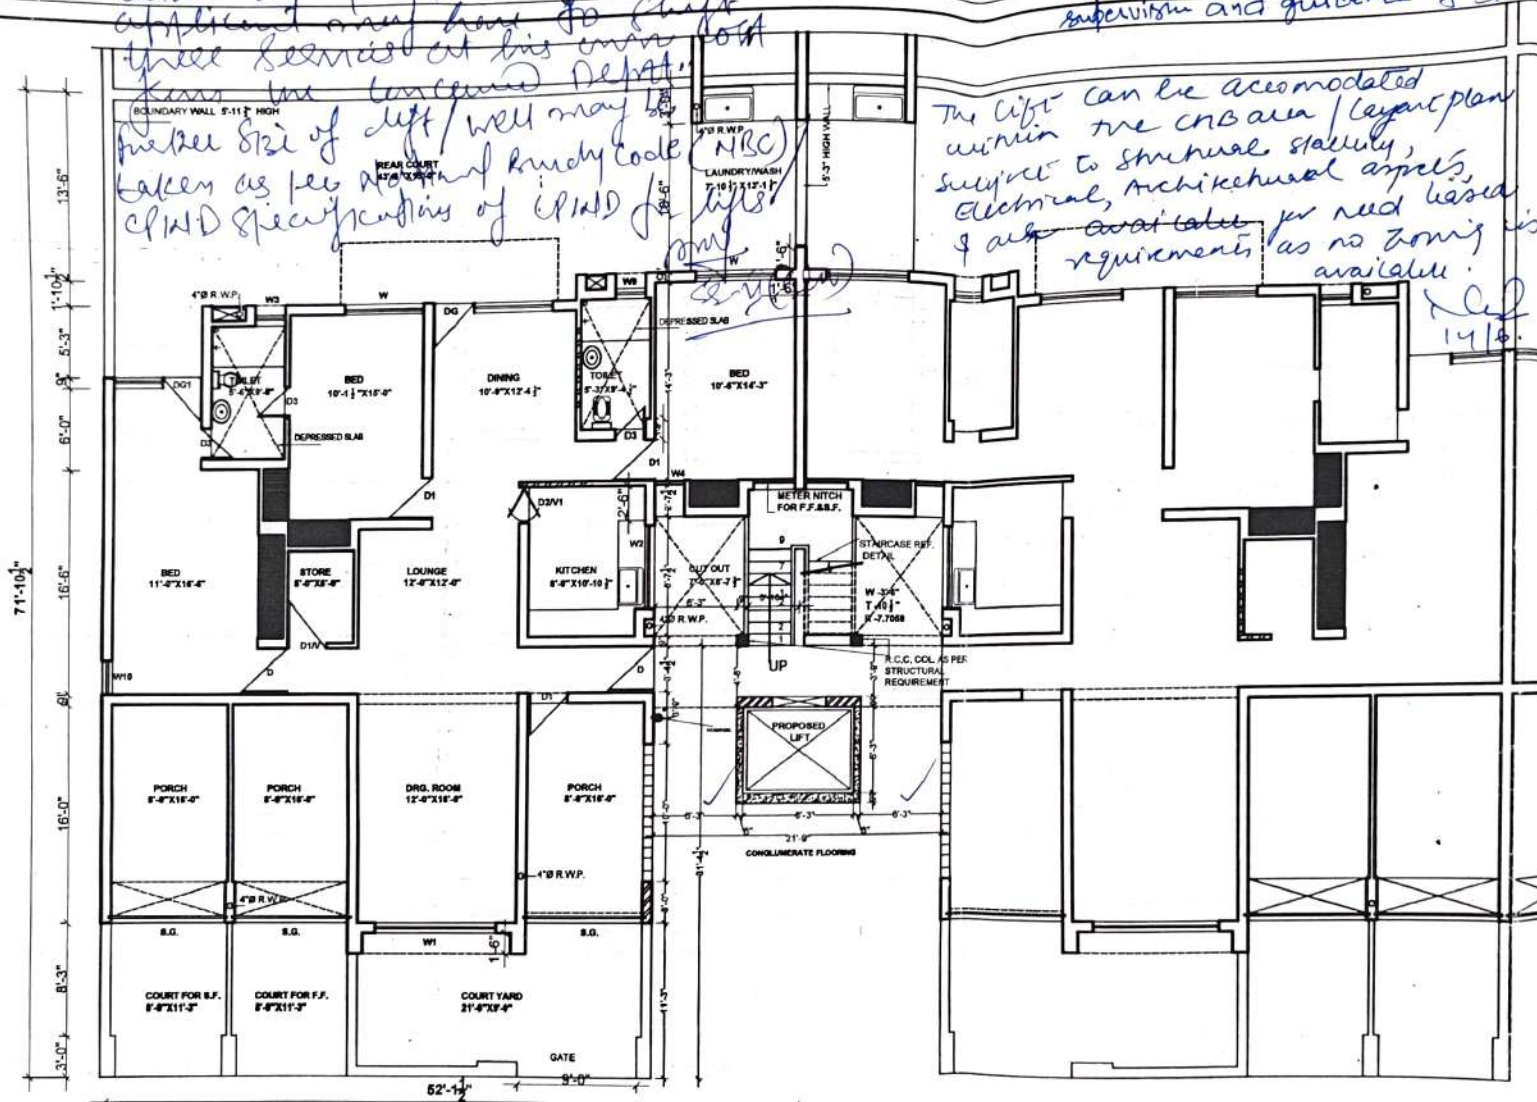

GROUND FLOOR PLAN

lift proposal is Architecturally O.K. However the location & any additional area may be seen by T.P member

NOTE:
NO. OF PERSONS - 13
LIFT WELL SIZE - 2500x1900mm
(AS PER NBC)
DEPTH OF LIFT PIT - 1500mm
ENTRANCE - 900mm

CHANDIGARH HOUSING BOARD

Notes:-
1. THE DRAWING IS THE PROPERTY OF THE CHD. CHD. AND MUST NOT BE REPRODUCED OR TRACED IN WHOLE OR IN PART WITHOUT THE PERMISSION OF THE BOARD IN WRITING.
2. NO RAIN WATER PIPES, FUEL VENTILATING PIPE OR ANY OTHER PIPING WORK SHALL BE EXPOSED TO VIEW ON ANY FACE OF THE BUILDING.
3. NO APPLIED DECORATION OF ANY SORT LIKE THE CROSS, BREATHERS ETC. SHALL BE PERMITTED ON THE EXTERNAL FACE OF THE BUILDING OR ON THE BOUNDARY WALL.
4. THE COST OF COMMON WALLS SHALL BE SHARED PROPORTIONATELY BY THE RESPECTIVE ALLOTTEES.
5. NO ADVERTISEMENT IN WHAT-SO-EVER FORM, KIND OR MANNER, WHETHER THE NAME OF THE PERSON OR A FIRM SHALL BE PERMITTED ON THE FACE OF THE BUILDING OR ON OR ALONG THE BOUNDARY WALL EXCEPT THE NUMBER OF THE PREMISES DISPLAYED IN PAINTED NUMERALS ON SPACE ASSIGNED FOR THE PURPOSE.
6. FOR ANY OTHER DETAIL / NOTED REF. DRG. NO. 6, 7, 8 JOB NO. 154
7. ADDITIONAL CONSTRUCTION HAS BEEN SHOWN HAS HATCHED

JOINERY DETAIL :-

Type	Size	Chill
D0	9'-0" X 5'-0"	2'-4"
D01	6'-7 1/2" X 9'-7 1/2"	2'-4"
D02	6'-0" X 5'-0"	2'-4"
D03	4'-6" X 5'-0"	2'-4"
D	3'-4 1/2" X 5'-0"	
D1	3'-0" X 5'-0"	
D2/V1	2'-7 1/2" X 7 1/2"	
D3	2'-3" X 5'-0"	
W	6'-0" X 4'-6"	2'-4"
W1	6'-0" X 5'-0"	
W2	6'-0" X 4'-1 1/2"	3'-4 1/2"
W3	2'-3" X 3'-7 1/2"	5'-2 1/2"
W4	2'-3" X 4'-6"	2'-4"
W5	6'-7 1/2" X 4'-6"	2'-4"
W6	6'-0" X 3'-10 1/2"	2'-10 1/2"
W7	2'-3" X 4'-6"	5'-2 1/2"
D1/V	3'-0" X 5'-7 1/2"	
S.G.	5'-4"	
D4	3'-4 1/2" X 5'-3"	
W8	6'-0" X 5'-0"	2'-4"
W9	2'-3" X 3'-1 1/2"	5'-2 1/2"
W10	2'-4" X 4'-1 1/2"	2'-3"
W11	2'-4" X 4'-5"	2'-3"
W12	2'-4" X 4'-5"	2'-3"

Naresh Sharma
Architect

SCALE : 1/4" = 1'-0"
DATE : 13-06-2023
JOB NO. 164
DRG. NO. 30

CHECKED BY:
STANDARD DESIGN OF G.H.S. IN WEST OF SECTOR - 38 CHANDIGARH. (U.T.) H.L.G. (UPPER)
GROUND FLOOR PLAN (Location of lift)

PH services i.e. C.I. pipes are passing along through the proposed lift well. The applicant therefore may have to arrange the shifting of these services at an appropriate location/area at his own cost before taking up the installation of lift at proposed location.

EE-VI (PH)

Lift can be provided subject to compliance with norm as per NBC. In view of fire safety and escape route not be obstructed.

CHANDIGARH HOUSING BOARD

Notes:-

1. THIS DRAWING IS THE PROPERTY OF THE G.H.S. AND MUST NOT BE COPIED, ALTERED OR TRACED IN WHOLE OR IN PART WITHOUT THE PERMISSION OF THE BOARD IN WRITING.

2. NO RAW WATER PIPE, GAS PIPE, VENTILATING PIPE OR ANY OTHER PLUMBING WORK SHALL BE EXPOSED TO VIEW ON ANY FACE OF THE BUILDING.

3. NO APPLIED DECORATION OF ANY SORT LIKE THE CROSS, SWASTIKA ETC. SHALL BE PERMITTED ON THE EXTERNAL FACE OF THE BUILDING OR ON THE BOUNDARY WALL.

4. THE COST OF COMMON WALLS SHALL BE SHARED PROPORTIONATELY BY THE RESPECTIVE ALLOTTEES.

5. NO ADVERTISEMENT IN WHAT SO EVER FORM, LETTERS OR BANNERS, WHETHER THE NAME OF THE PERSON OR A FIRM SHALL BE PERMITTED ON THE FACE OF THE BUILDING OR ON OR ALONG THE BOUNDARY WALL EXCEPT THE NUMBERS OF THE PREMISES DISPLAYED IN PAINTED NUMERALS ON SPACE ASSIGNED FOR THE PURPOSES.

6. FOR ANY OTHER DETAIL / NOTES REF. DRG. NO. 6.7.3 JOB NO. 144

7. ADDITIONAL CONSTRUCTION HAS BEEN SHOWN HAS HATCHED

JOINERY DETAIL :-

Type	Size	Cill
D0	5'-0" X 5'-0"	2'-4"
D01	5'-7 1/2" X 5'-7 1/2"	2'-4"
D02	5'-0" X 5'-0"	2'-4"
D03	5'-0" X 5'-0"	2'-4"
D	3'-4 1/2" X 5'-0"	
D1	3'-0" X 5'-0"	
D01/V1	2'-7 1/2" X 5'-7 1/2"	
D3	2'-3" X 4'-0"	2'-4"
W	5'-0" X 4'-0"	
W1	5'-0" X 5'-0"	
W2	5'-0" X 4'-1 1/2"	3'-4 1/2"
W3	2'-3" X 3'-7 1/2"	5'-2 1/2"
W4	2'-3" X 4'-0"	2'-4"
W5	5'-7 1/2" X 4'-5"	2'-4"
W6	5'-0" X 3'-10 1/2"	2'-10 1/2"
W7	2'-3" X 4'-5"	5'-2 1/2"
D1/V	3'-0" X 5'-7 1/2"	
S.S.	5'-0"	
D4	3'-4 1/2" X 5'-3"	
W8	5'-0" X 5'-0"	2'-4"
W9	2'-3" X 3'-1 1/2"	5'-2 1/2"
W11	2'-4" X 4'-0"	2'-3"
W10	2'-4" X 4'-0"	2'-3"

Nalini Sharma
Architect.

SCALE: 1/8" = 1'-0"

DATE: 13-06-2023

REVISION BY: R/S

164

31

CHECKED BY:


STANDARD DESIGN OF G.H.S.
IN WEST OF SECTOR - 38
CHANDIGARH. (U.T.)
H.I.O. (UPPER)

FIRST FLOOR PLAN (Location of R/R)

NOTE:

NO. OF PERSONS - 13
LIFT WELL SIZE - 2500 X 1500mm
(AS PER NBC)
DEPTH OF LIFT PFT - 1500mm
ENTRANCE - 900mm

FIRST FLOOR PLAN

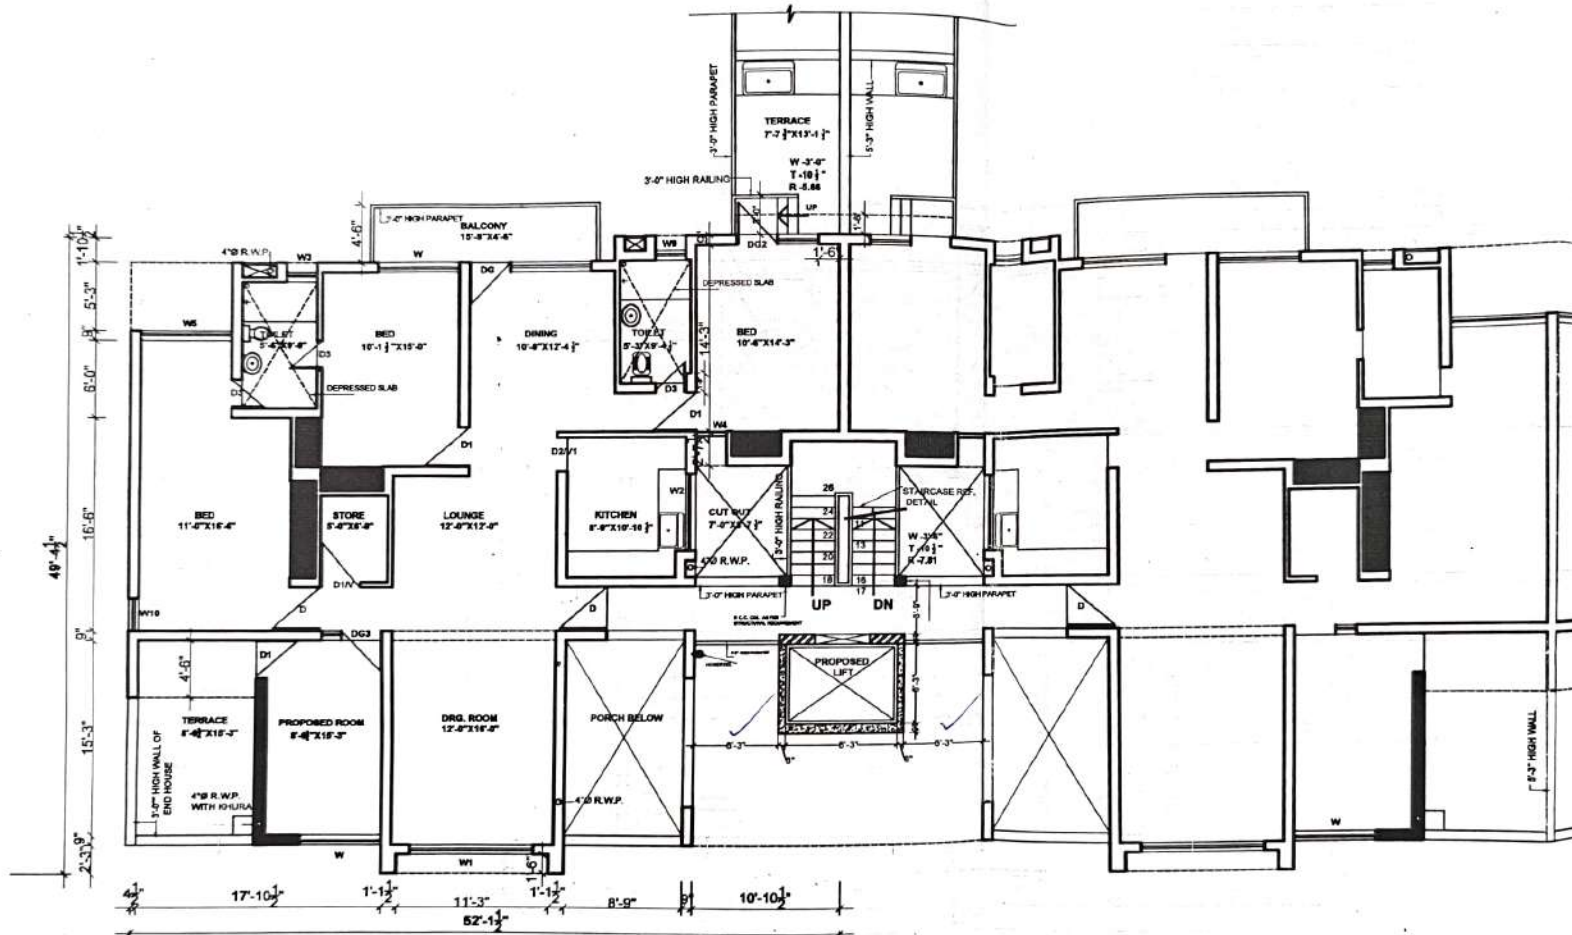

CHANDIGARH HOUSING BOARD

Notes:-

- THIS DRAWING IS THE PROPERTY OF THE CHS, CHS, AND MUST NOT BE COPIED, ALTERED OR TRACED IN WHOLE OR IN PART WITHOUT THE PERMISSION OF THE BOARD IN WRITING.
- NO SANI WATER PIPE, SANI, VENTILATING PIPE OR ANY OTHER PIPING WORK SHALL BE EXPOSED TO VIEW ON ANY FACE OF THE BUILDING.
- NO APPLIED DECORATION OF ANY SORT LIKE THE CROSS, WHEELS ETC. SHALL BE PERMITTED ON THE EXTERNAL FACE OF THE BUILDING OR ON THE BOUNDARY WALL.
- THE COST OF GROUND WALLS SHALL BE SHARED PROPORTIONATELY BY THE RESPECTIVE ALLOTTEES.
- NO ADVERTISEMENT IN WHATEVER FORM, KIND OR MANNER, WHETHER THE NAME OF THE PERSON OR A FIRM SHALL BE PERMITTED ON THE FACE OF THE BUILDING OR ON OR ALONG THE BOUNDARY WALL EXCEPT THE NUMBER OF THE FLOORING DISPLAYED IN PAINTED NUMBERS OR IN PLATE AFFIXED FOR THE PURPOSES.
- FOR ANY OTHER DETAIL / NOTES REF. DRG. NO. S.T.A. 9 JOB NO. 104
- ADDITIONAL CONSTRUCTION HAS BEEN SHOWN HAS HATCHED

JOINERY DETAIL :-

Type	Size	Cill
D0	5'-0" X 6'-0"	2'-4"
D01	5'-7 1/2" X 8'-7 1/2"	2'-4"
D02	6'-0" X 6'-0"	2'-4"
D03	4'-6" X 6'-0"	2'-4"
D1	3'-4 1/2" X 5'-0"	
D2/V1	2'-7 1/2" X 8'-7 1/2"	
D3	2'-3" X 8'-0"	
W	6'-0" X 4'-0"	2'-4"
W1	5'-0" X 6'-0"	
W2	6'-0" X 4'-1 1/2"	3'-4 1/2"
W3	2'-3" X 7'-7 1/2"	5'-2 1/2"
W4	2'-3" X 4'-0"	2'-4"
W5	6'-7 1/2" X 4'-0"	2'-4"
W6	6'-0" X 3'-10 1/2"	2'-10 1/2"
W7	2'-3" X 4'-0"	5'-2 1/2"
D1/V	3'-0" X 8'-7 1/2"	
S.O.	8'-0"	
D4	3'-4 1/2" X 5'-3"	
D5	6'-0" X 8'-0"	2'-4"
W8	2'-3" X 3'-1 1/2"	5'-2 1/2"
W9	2'-6" X 5'-4 1/2"	2'-3"
W10	2'-6" X 4'-0"	2'-3"

Naini Sharma
Architect.

SCALE : 1/4" = 1'-0"

DATE :- 13-06-2023

DRAWN BY *Rash*

164

35

CHECKED BY:

JOB NO.

DRG. NO.

STANDARD DESIGN OF G.H.S.
IN WEST OF SECTOR - 38
CHANDIGARH. (U.T.)
H.I.G. (UPPER)

TERRACE FLOOR PLAN (Location of lift)

NO. OF PERSONS - 13
LIFT WELL SIZE - 2500X1900mm
(AS PER NBC)
DEPTH OF LIFT PIT - 1500mm
ENTRANCE - 900mm

TERRACE FLOOR PLAN

